


DESIGNED BY	DATE	REVIEWED	DATE	APPROVED	DATE	NO.	DATE	BY	REVISIONS
K.E.B.	Oct. '63	ARCHITECTURAL	12-17-63		1	1	4-64	RMB	REVISED AS CORRECTED
D.M.C.	Oct. '63	ENGINEERING	12-17-63		2	2			
B.H.C.	11-20-63	LANDSCAPE	12-17-63		3	3			
					4	4			
					5	5			
					6	6			

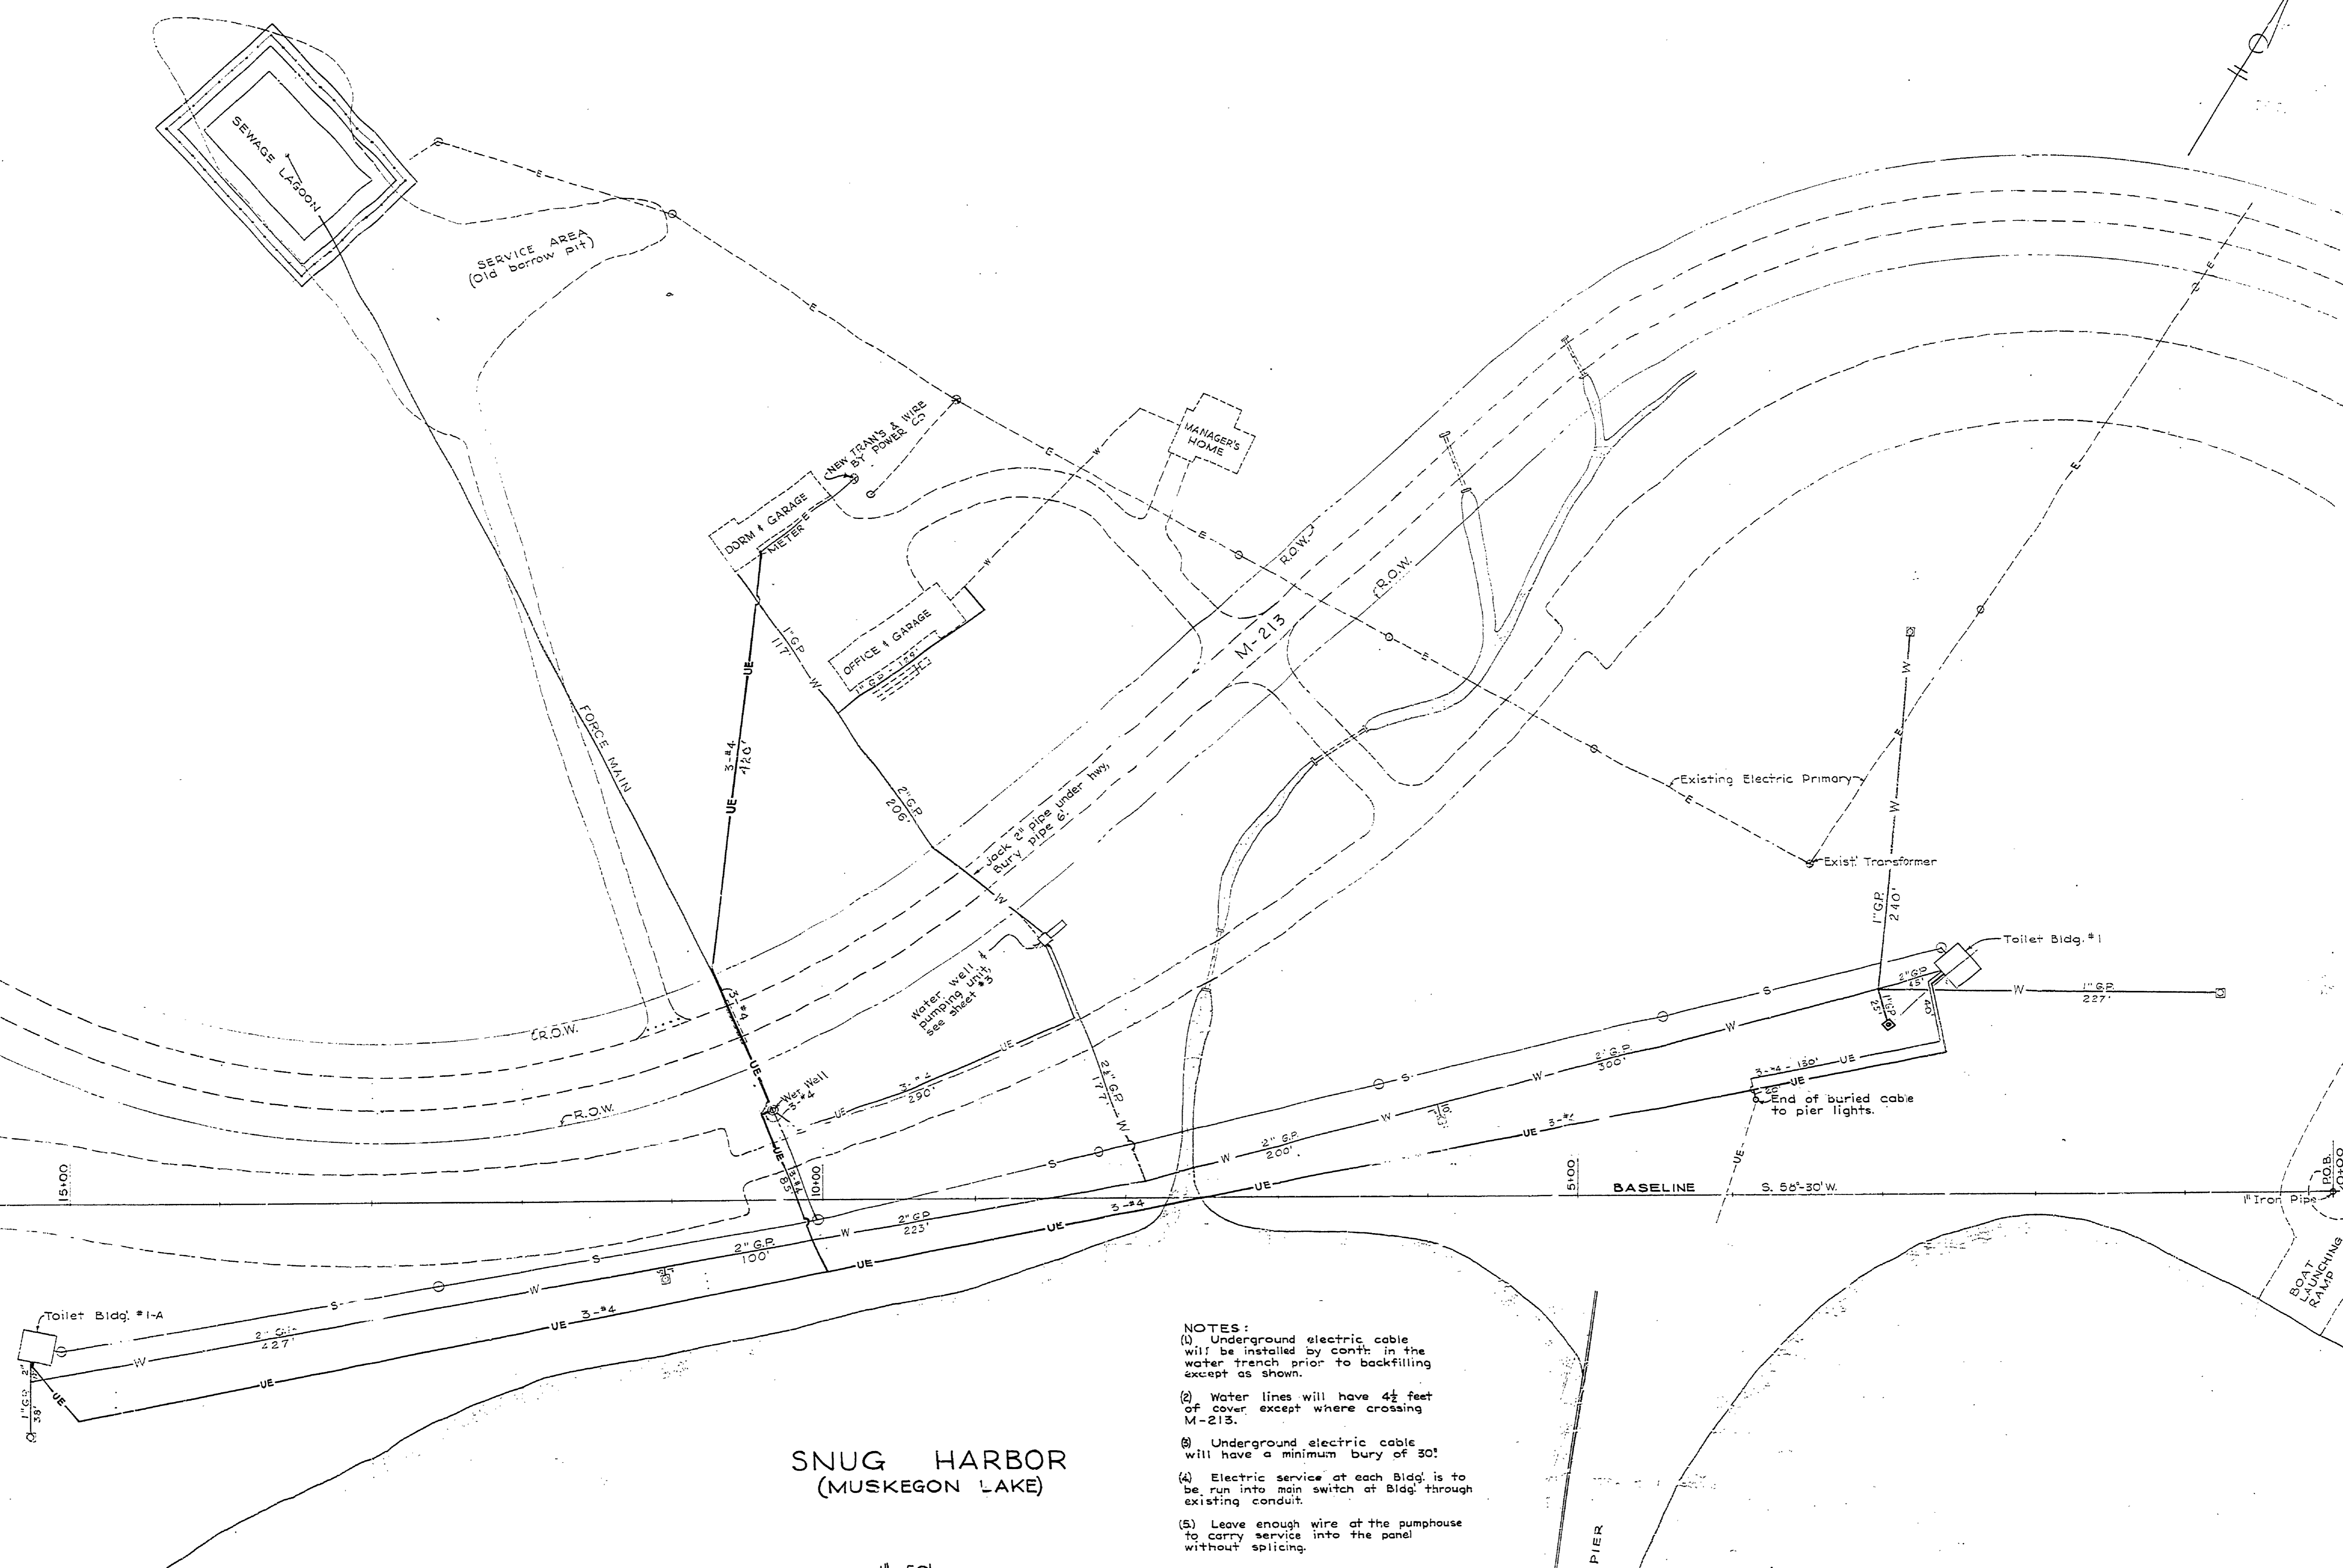

SNUG HARBOR
(MUSKEGON LAKE)

1" = 50'

- NOTES:
- (1) Underground electric cable will be installed by conth in the water trench prior to backfilling except as shown.
 - (2) Water lines will have 4 1/2 feet of cover, except where crossing M-213.
 - (3) Underground electric cable will have a minimum bury of 30'.
 - (4) Electric service at each Bldg. is to be run into main switch at Bldg. through existing conduit.
 - (5) Leave enough wire at the pumphouse to carry service into the panel without splicing.

ELECTRIC & WATER PLAN.

MICHIGAN
DEPARTMENT OF CONSERVATION
PARKS AND RECREATION DIVISION

MUSKEGON STATE PARK
SNUG HARBOR PICNIC AREA
WATER & SEWER SYSTEMS

SHEET
No. 2
OF 4

PLAN NO.
E-110