


NOTE: Shut-off valve in service box. Open faucet on fountain and pump air through sniffer valve for winter shut down.

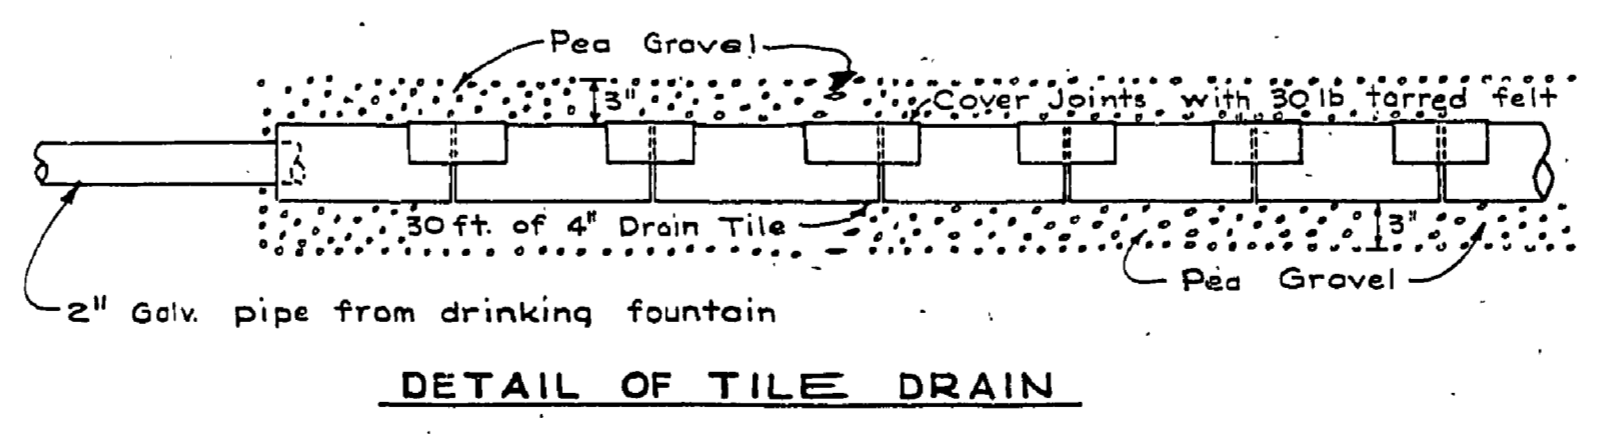

SURVEYED BY	DRAWN BY COTE	Sept '65	NO. DATE BY	REVISIONS	NO. DATE BY	REVISIONS	MICHIGAN DEPARTMENT OF CONSERVATION	DRINKING FOUNTAIN PLAN HOFFMASTER ST. PARK.	SHEET NO. 8 OF 8 FOR PROJECT NO. 1064	SHEET 8 OF 8 PLAN NO. 1031A-104
DESIGNED BY BARKER	CHECKED BY W.H.E.	DATE	1. 6-23 H.L.R. Extension Type Service Box in Slab	3.	2. 8-24 JHN Tank Connection to Casing	4.				

SE 149