



**PANEL "A"**  
 400 AMP BREAKER PANEL FRAME  
 300 AMP MAIN DISCONNECT  
 26 POLES INCLUDING MAIN DISCONNECT

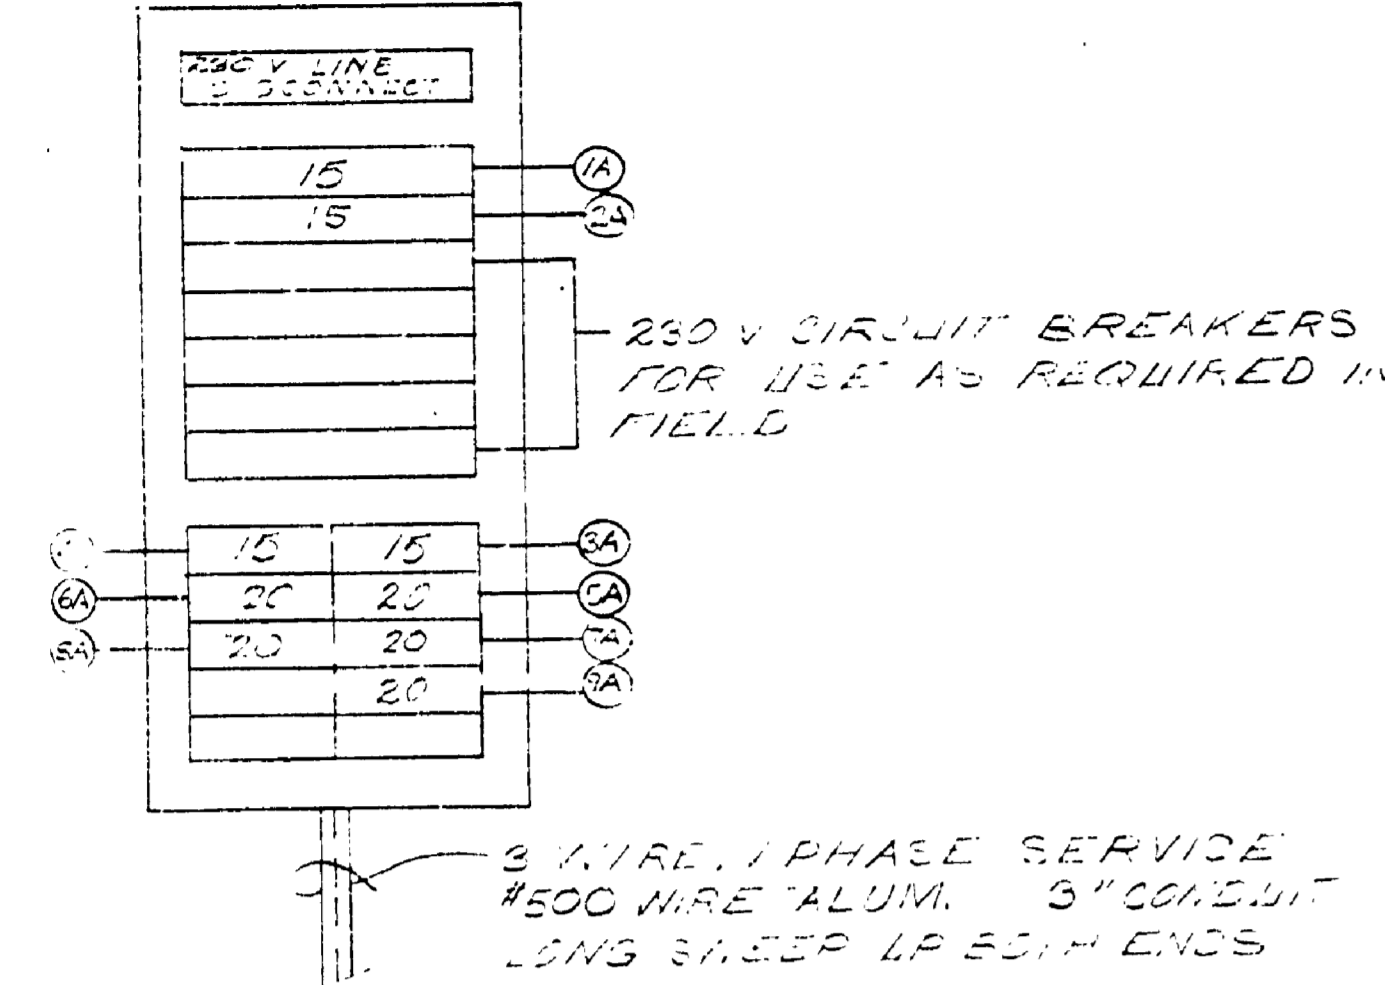

**CIRCUIT DATA FOR PANEL "A"**

1A	230V	AIRSAN UNIT MOTOR CONTROLLER
2A	230V	WATER HEATER
3A	115V	LIGHTING, SERVING AREA
4A	115V	LIGHTING, PREPARATION AREA & EMPLOYEES TOILET
5A	115V	CONVENIENCE OUTLETS, PREPARATION AREA
6A	115V	CONV. OUTLETS UNDER FRONT COUNTER (TOP RECP.)
7A	115V	" " " (BOTTOM RECP.)
8A	115V	" " " BACK COUNTER (TOP RECP.)
9A	115V	" " " " (BOTTOM RECP.)

**PANEL "B"**  
 100 AMP BREAKER PANEL FRAME  
 30 AMP MAIN DISCONNECT  
 18 POLES INCLUDING MAIN DISCONNECT


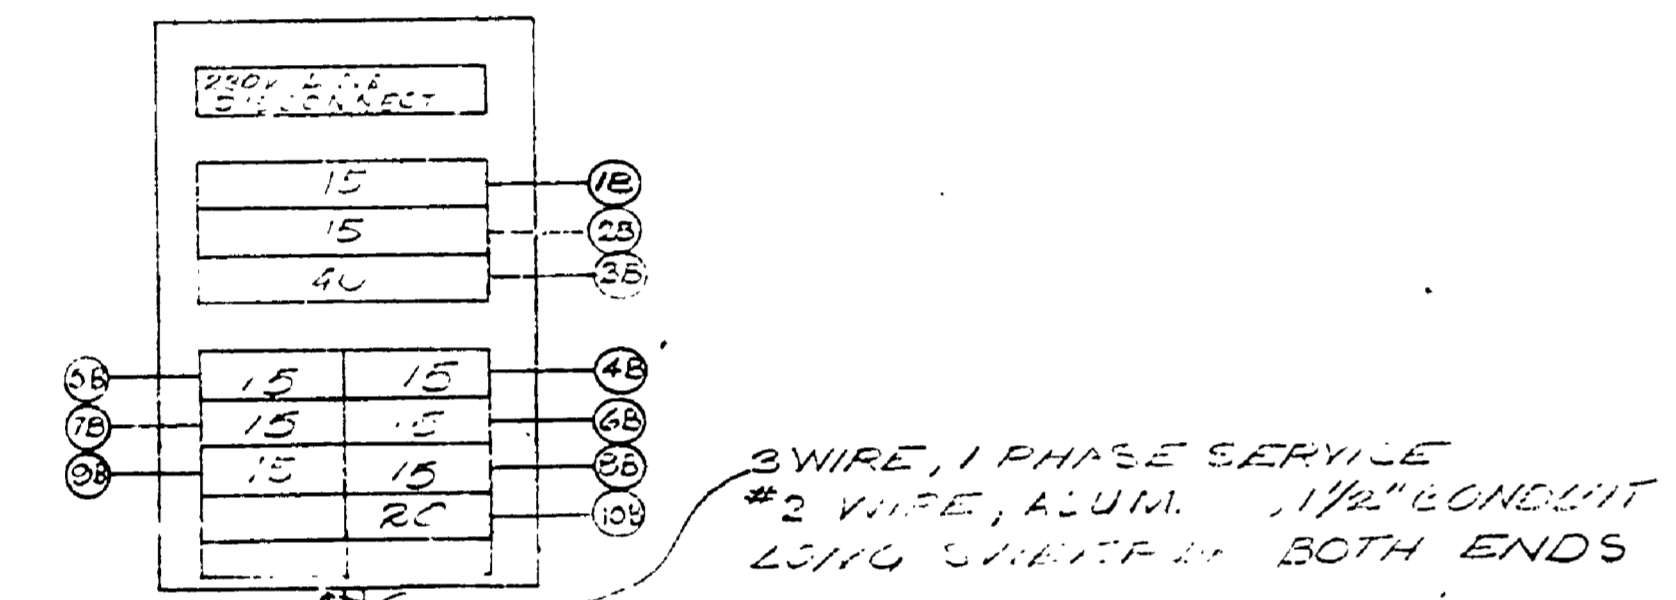


**CIRCUIT DATA FOR PANEL "B"**

1B	230V	#1 WATER PUMP
2B	230V	#2 WATER PUMP
3B	230V	CCT. TO PANEL "C" IN BATHHOUSE
4B	115V	LIGHTING, INTERIOR WALKWAY
5B	115V	LIGHTING, NIGHT LIGHTS (SUPPLEMENTARY)
6B	115V	LIGHTING, MEN'S & WOMEN'S TOILET
7B	115V	LIGHTING, MEN'S & WOMEN'S TOILET
8B	115V	LIGHTING, PIPE ALLEY
9B	115V	LIGHTING, NIGHT LIGHTS
10B	115V	CONVENIENCE OUTLET, PIPE ALLEY

**FIXTURE SCHEDULE**

MARK	NO. REQ'D	MANUFACTURER & NUMBER	LAMP TYPE	WATT	REMARKS
A	6	McPHILBEN #3W-21B (W/LOUVER GUARD)	INCAND	90W PAR 95 FLOOD	MOUNT AT TOP OF MASONRY
B	4	McPHILBEN 93-25A WILEXAN	INCAND	(2) 75W	MOUNT IN STUD WALL 9" ABOVE SLAB (STEPLIGHT)
C	4	McPHILBEN 93-24A WILEXAN	INCAND	(2) 75W	MOUNT 6'-10" ABOVE FINISHED FLOOR (STEPLIGHT)
D	2	MOLDCAST IMPACTA 900 #A-925T FLUOR	FLUOR	(2) 40W	MOUNT TOP OF FIXTURE 6'-10" ABOVE FIN. FL.
E	2	McPHILBEN #43-41	INCAND	(2) 75W	MOUNT HORIZONTAL 6'-10" ABOVE FINISHED FLOOR
F	2	DAY-BRITE EQUA-LITE #5242-4	FLUOR	(2) 40W	MOUNT TOP OF FIXTURE 6'-10" ABOVE FIN. FL.
G	4	McPHILBEN #3W-21B (W/LOUVER GUARD)	INCAND	90W PAR 95 FLOOD	MOUNT CENTERED OVER COUNTER ON LAM. BM.
H	9	McPHILBEN #3W-21B (W/LOUVER GUARD)	INCAND	90W PAR 95 FLOOD	MOUNT ON SIDE OF ROOF BEAM
J	3	STANDARD PORCELAIN FIXTURE	INCAND	(1) 75W	MOUNT 7'-6" ABOVE FINISHED FLOOR
K	2	DAY-BRITE UTILITY #5240S (W/LOUVER GUARD)	FLUOR	1/2 IN "W"	MOUNT 6'-10" HIGH
L	4	McPHILBEN #93-24A WILEXAN	INCAND	(2) 75W	MOUNT AT TOP OF STUD WALL
M	4	DAY-BRITE CHAN-LITE #48295-4	FLUOR	(2) 40W	MOUNT ON BOTTOM OF ROOF BEAMS
N	5	McPHILBEN #93-05A WILEXAN	INCAND	(1) 40W	MOUNT UNDER CONCRETE LEDGE (STEPLIGHT)

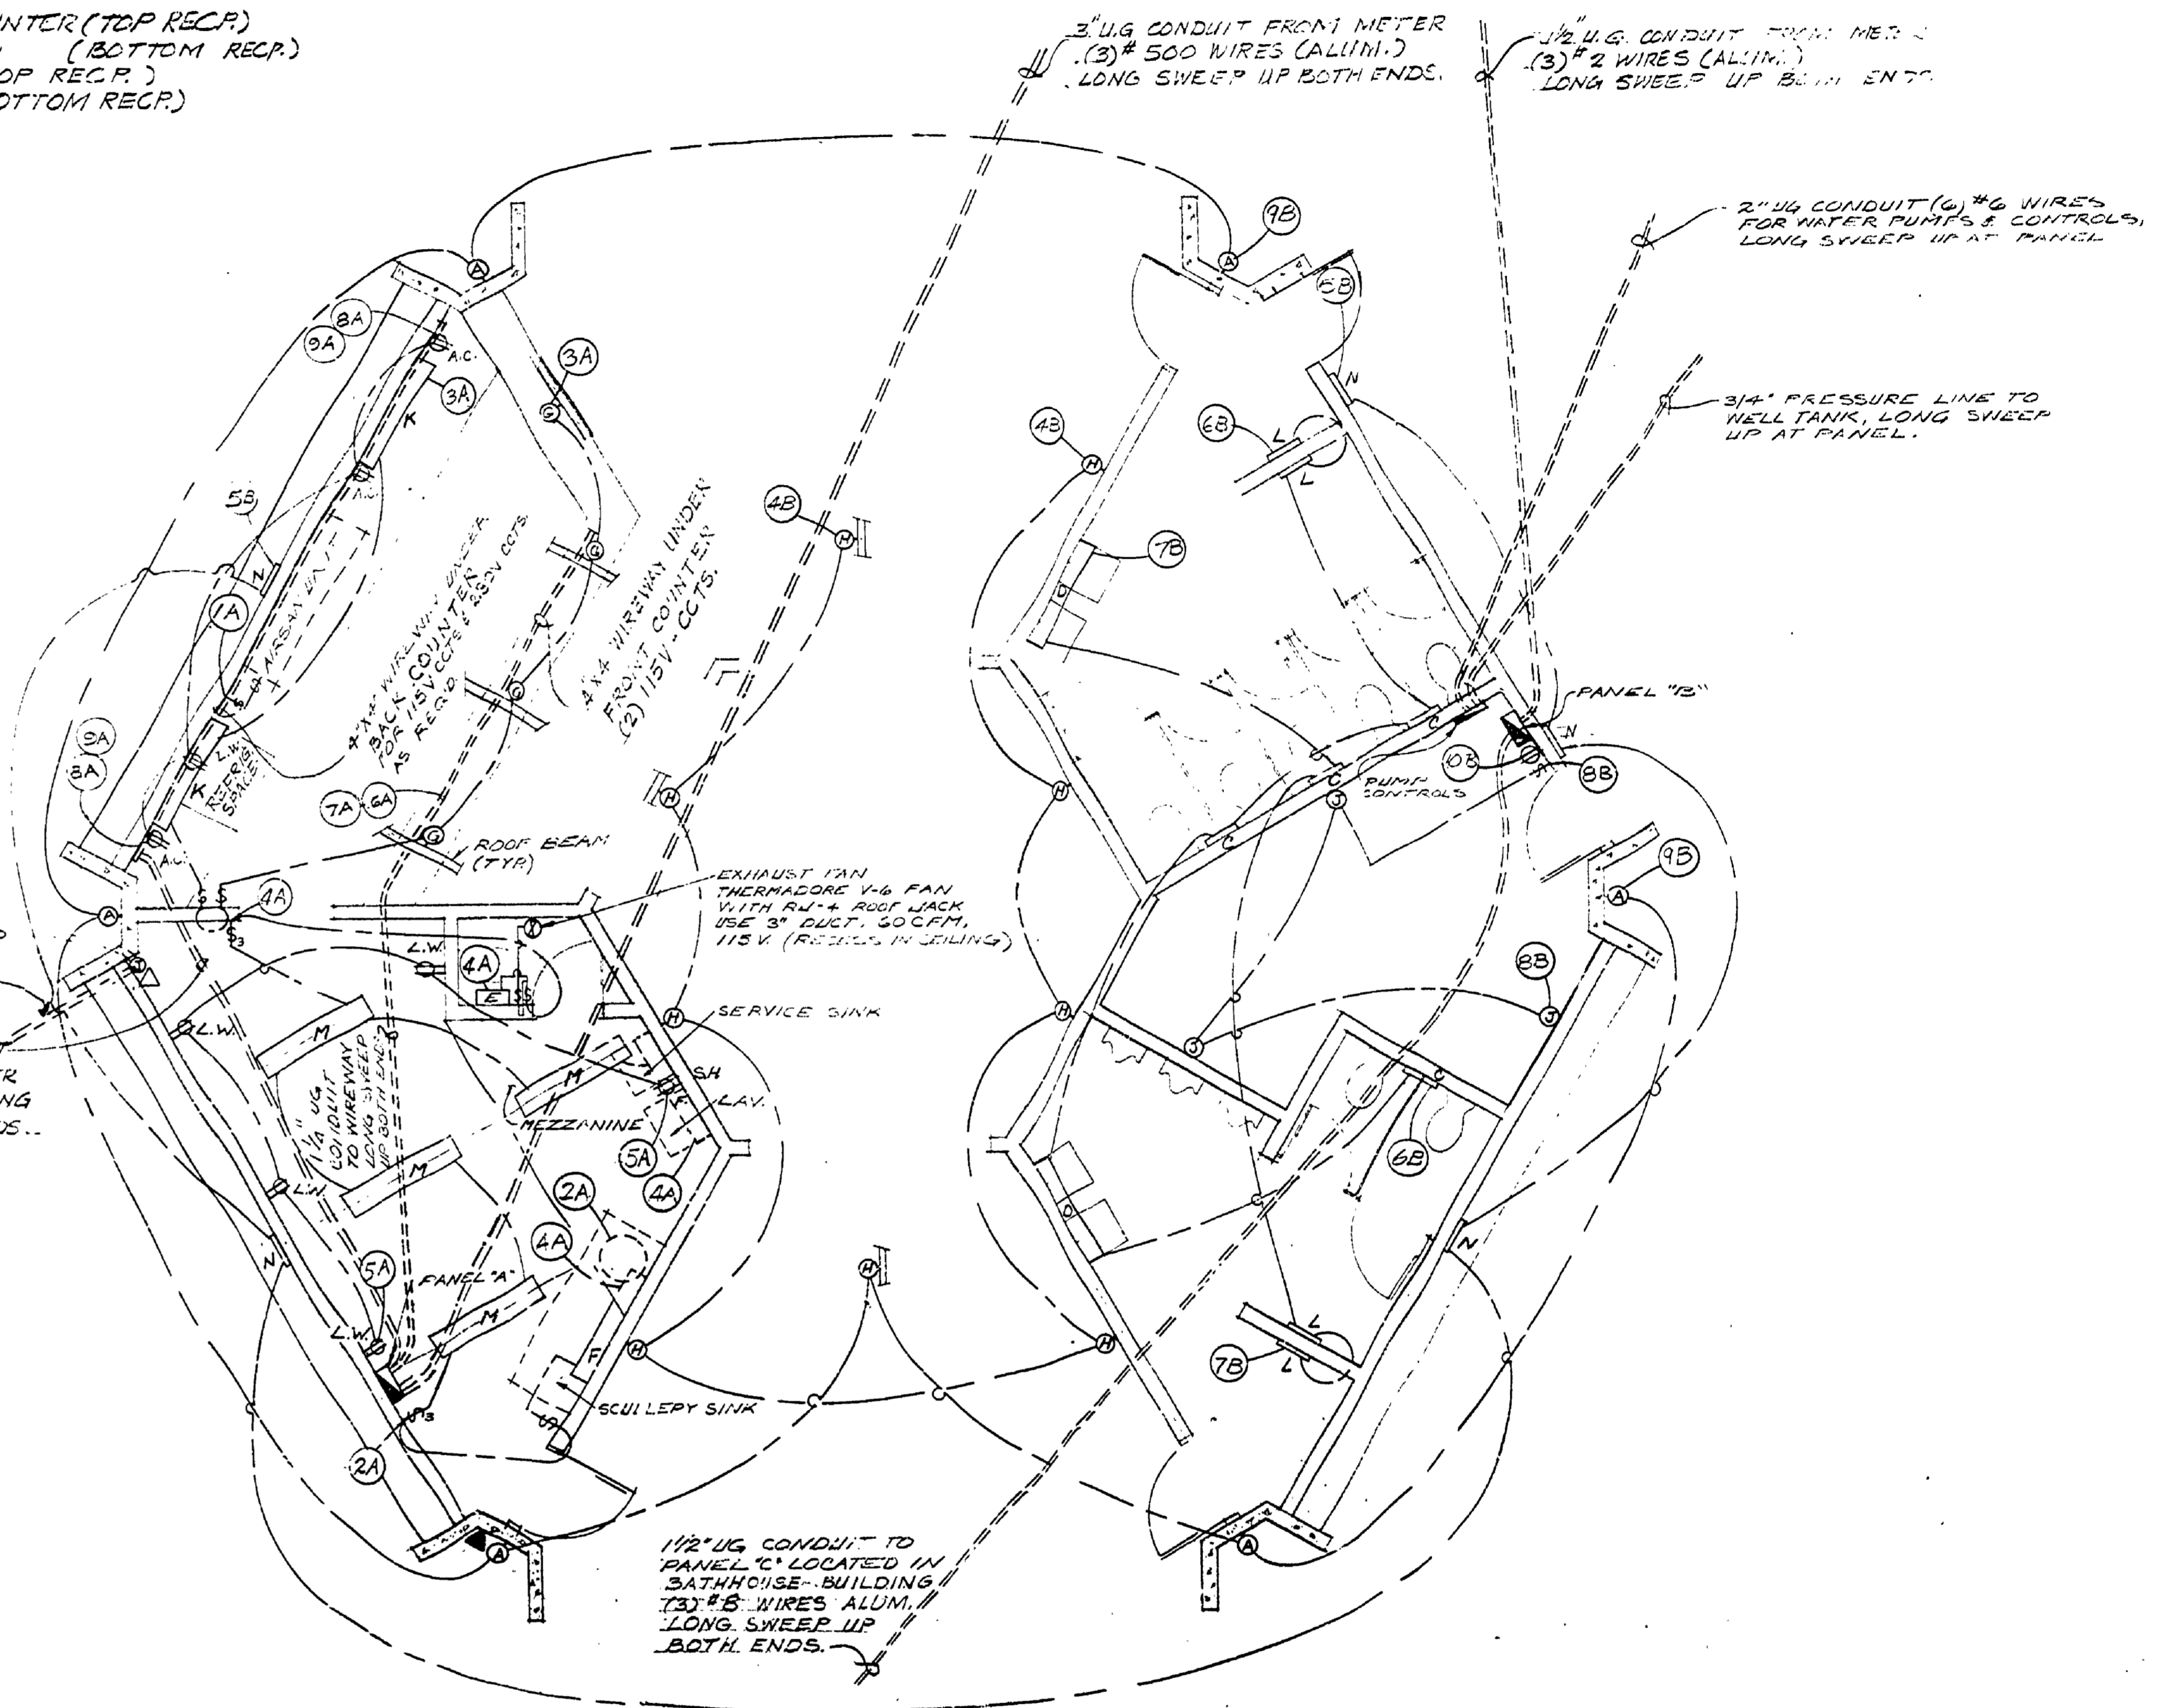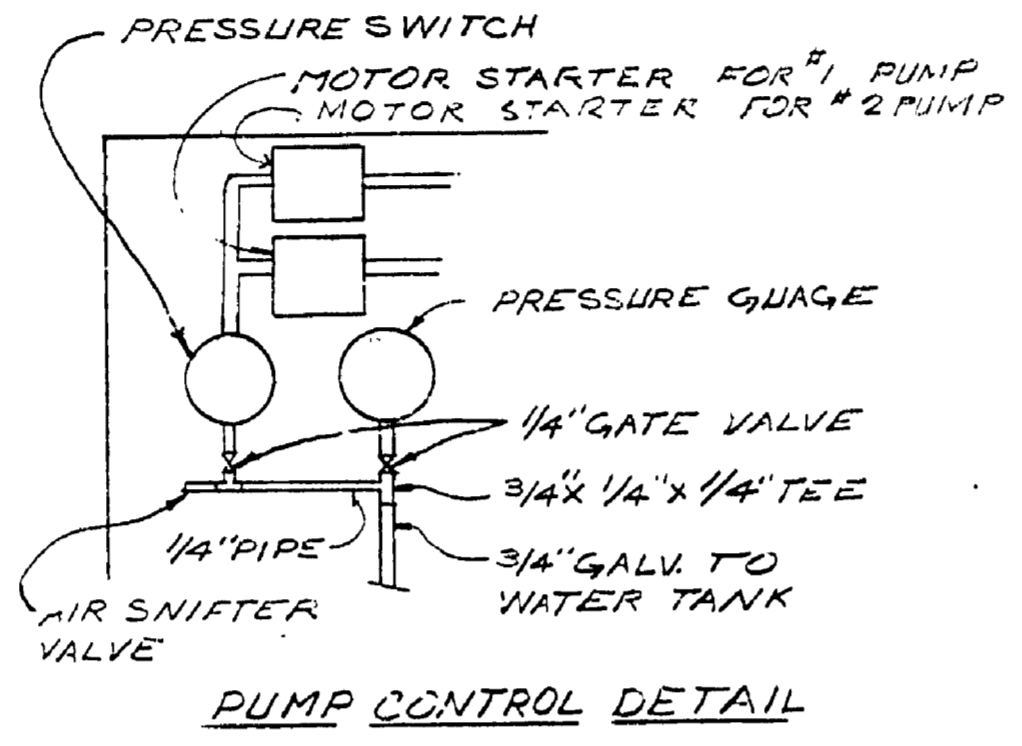

**LEGEND**

LW.	LOWER WALL
▽	PRIVATE TELEPHONE
▽	PUBLIC TELEPHONE
S.H.	SWITCH HEIGHT
⊙	TELEPHONE JUNCTION BOX
LIG.	UNDERGROUND
A.C.	ABOVE COUNTER