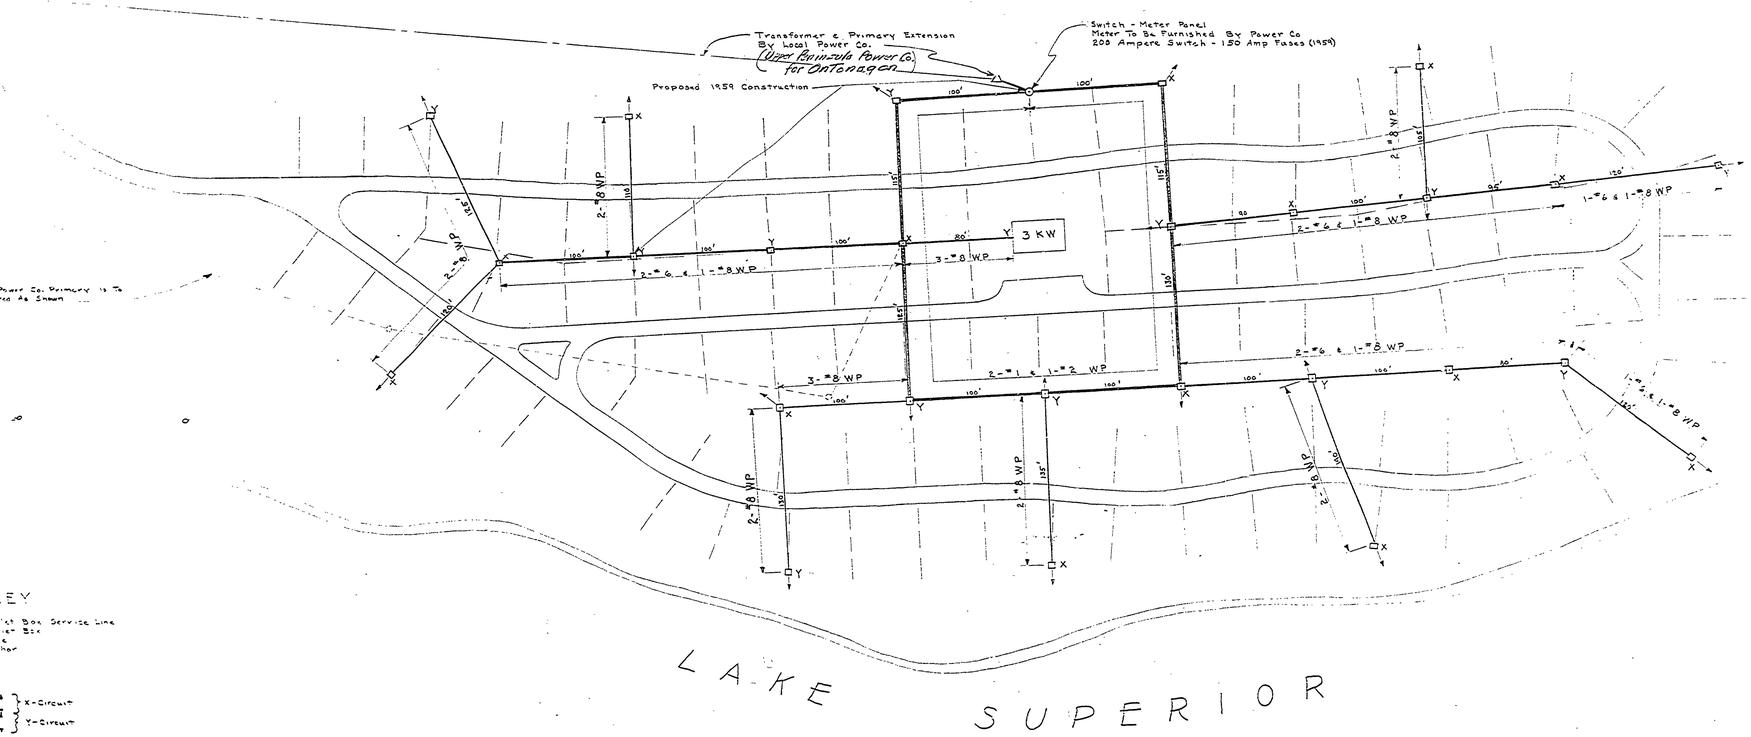

KEY

Outlet Box Service Line
Outlet Box
Pole
Anchor

240 Volts { Neutral — 120 Volt X-Circuit; 120 Volt Y-Circuit }

Note:- Use Galvanized Secondary Heavy Duty Wire, Racks With 8" Spacing For #2 & Larger Wire, 6" Spacing For #4 & Smaller Wire.

DRAWN BY	B.H.G.	REVIEWED BY SECTIONS		DATE	APPROVED BY
TRACED BY		ARCHITECTURAL	J.T.R.	4-16-59	H. C. Mortenson
CHECKED BY	E. J. P.	ENGINEERING	J.T.R.	4-16-59	ASSISTANT CHIEF IN CHARGE
DATE	3 April 1959	LANDSCAPE	J.T.R.	4-16-59	OF DESIGN DATE 16 Apr 59

NO.	DATE	BY
1		
2		
3		

REVISIONS

4		
5		
6		

Sheets 2 & 3 Are Standard Plans

Scale 1" = 50'

MICHIGAN
DEPARTMENT OF CONSERVATION
PARKS AND RECREATION DIVISION

PORCUPINE MOUNTAINS STATE PARK
CAMPGROUND ELECTRICAL DISTRIBUTION SYSTEM

SHEET NO. 1 OF 3

PLAN NO. E-116