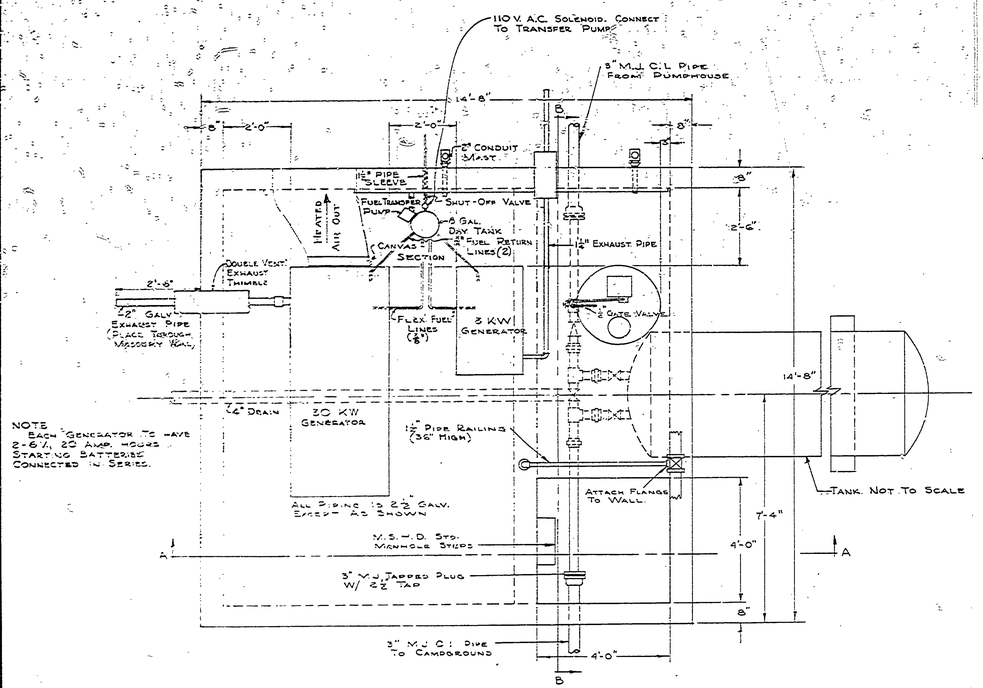

NOTE
EACH GENERATOR TO HAVE 2-6 V., 20 AMP. HOURS STARTING BATTERIES CONNECTED IN SERIES.

PLAN
SCALE ½" = 1'-0"

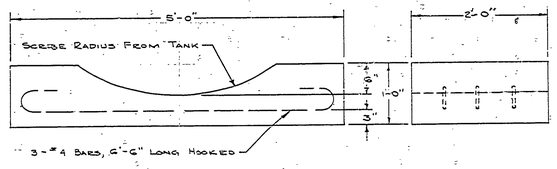

TANK SUPPORT
SCALE 1" = 1'-0"

NOTE:
WIRE INTERLOCK CONTACT OF PUMP STARTER TO CONTROL CIRCUIT OF HYPOCHLORINATOR TO START THIS AUTOMATICALLY WHEN WELL PUMP STARTS.

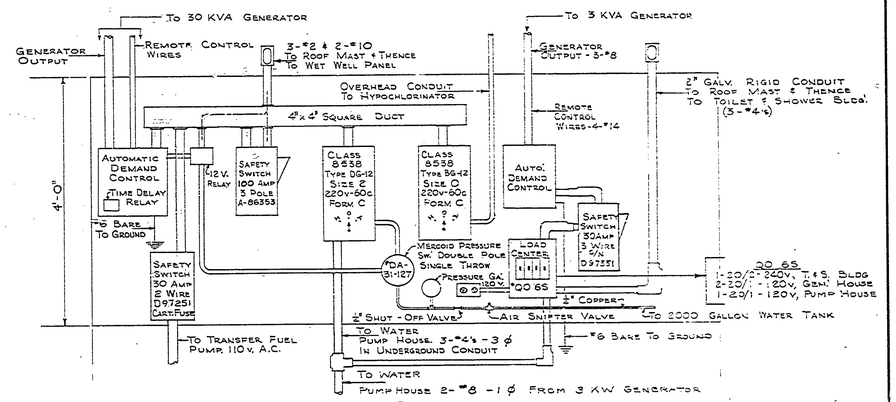

ELECTRICAL PANELBOARD
1" = 1'-0"

WALLS ARE CONSTRUCTED OF CONCRETE BLOCK WATERPROOF BELOW GRADE WITH TWO COATS OF ASPHALT FOUNDATION PAINT. APPLY TWO COATS OF BITUMINOUS PAINT TO EXTERIOR OF 2000 GAL. STORAGE TANK.

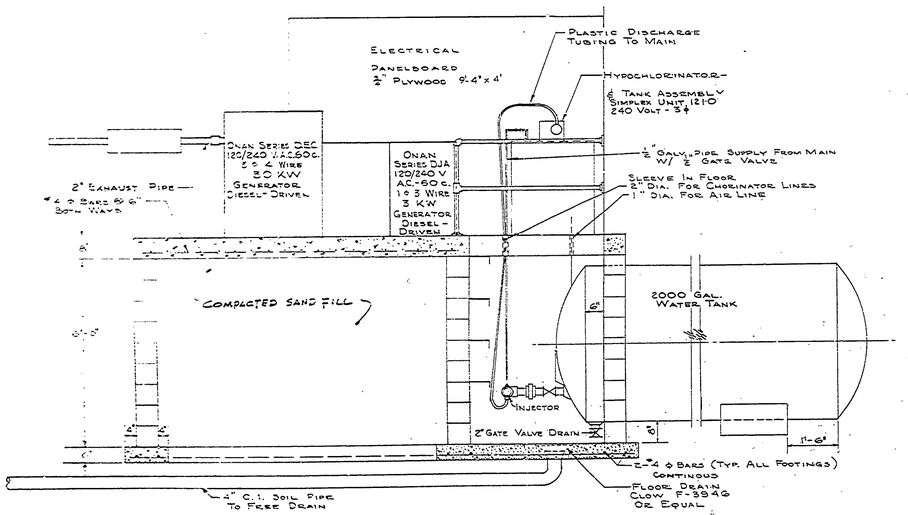

SECTION A-A
½" = 1'-0"

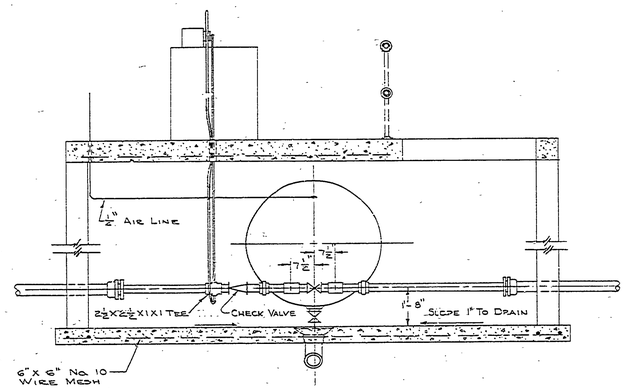

SECTION B-B
(NOT TO SCALE)

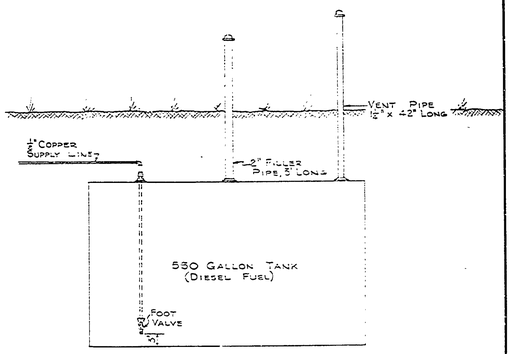

DETAIL OF FUEL TANK

DATE	NO.	BY	REVISIONS	DATE	BY
	1		4		
	2		5		
	3		6		

APPROVED — DATE

REVIEWED — DATE
ARCHITECTURAL — JAN '65
ENGINEERING — JAN '65
LANDSCAPE

DESIGNED BY W.J.P.
DRAWN BY J.Y.
CHECKED BY

MICHIGAN
DEPARTMENT OF CONSERVATION
PARKS AND RECREATION DIVISION

PORCUPINE MOUNTAINS STATE PARK
PRESQUE ISLE SECTION
GENERATOR PLANT HOUSE

SHEET NO. 7 OF 7

PLAN NO. E-118

F256-999-976-002-C1

SHEET 18 OF 18