


PANEL "A"
 300 AMP BREAKER PANEL FRAME
 200 AMP MAIN DISCONNECT
 30 POLES INCLUDING MAIN DISCONNECT

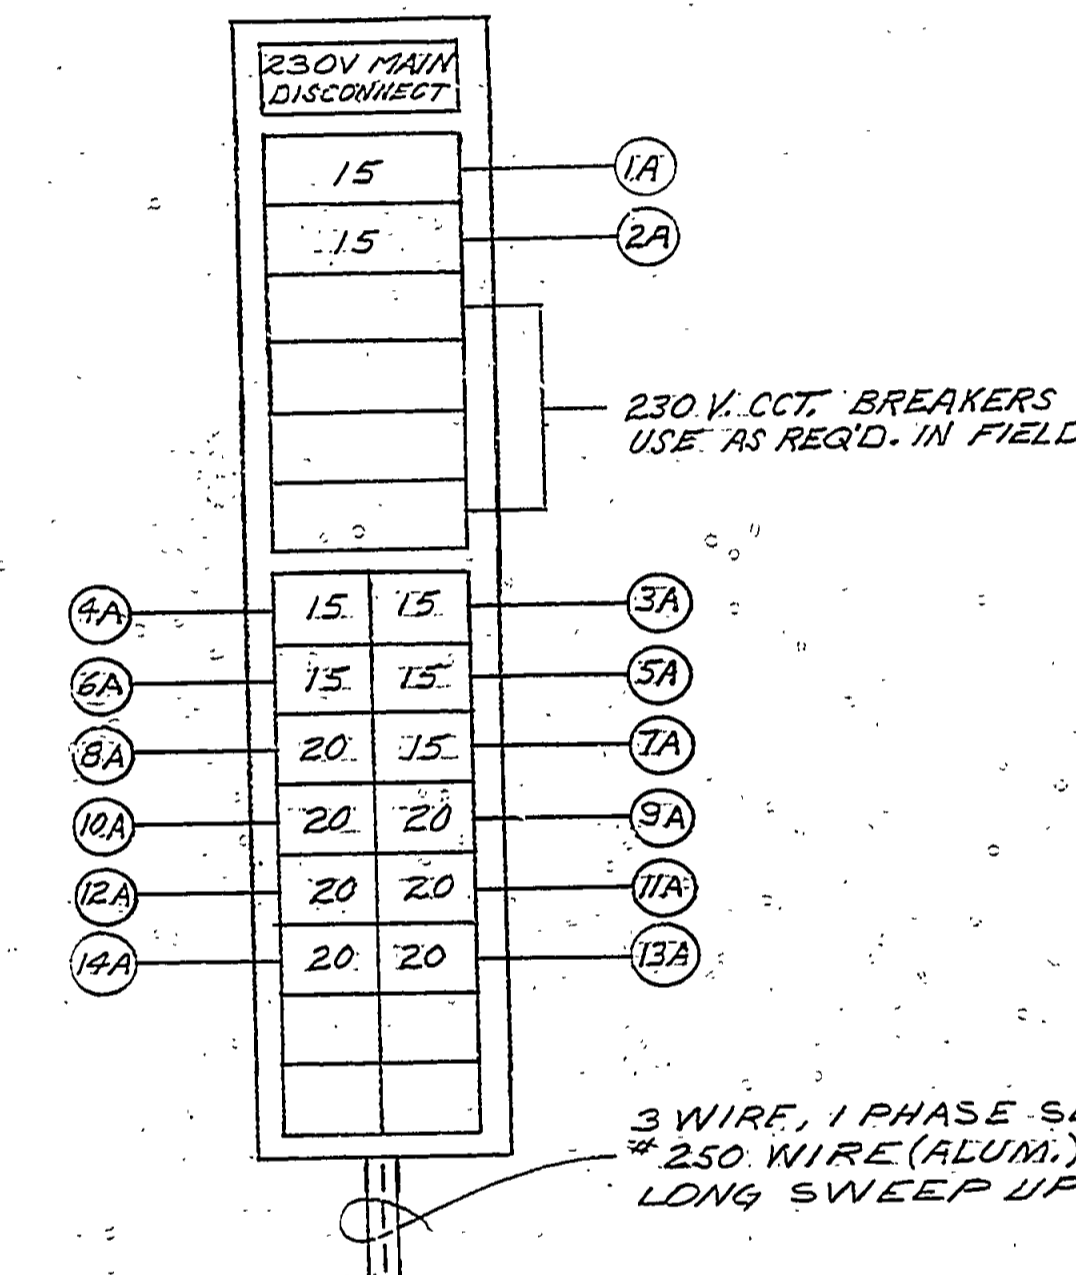


CIRCUIT DATA (PANEL "A")

1A	230V	EXHAUST FAN (AIRSAS UNIT)
2A	230V	WATER HEATER
3A	115V	LIGHTING, STORE ROOM & LMP. TOILET
4A	115V	LIGHTING, SERVING COUNTER & PREP. AREA
5A	115V	LIGHTING, STORAGE ROOM
6A	115V	LIGHTING, PARK STORE
7A	115V	LIGHTING, PARK STORE
8A	115V	CONVENIENCE OUTLETS, STORAGE ROOM (TOP REC.)
9A	115V	CONVENIENCE OUTLETS, STORAGE ROOM (BOT. REC.)
10A	115V	CONVENIENCE OUTLETS, SERVING AREA
11A	115V	CONVENIENCE OUTLETS, PARK STORE (TOP REC.)
12A	115V	CONVENIENCE OUTLETS, PARK STORE (BOT. REC.)
13A	115V	CONVENIENCE OUTLETS, UNDER SERV. COUNT. (TOP REC.)
14A	115V	CONVENIENCE OUTLETS, UNDER SERV. COUNT. (BOT. REC.)

CIRCUIT DATA (PANEL "B")

PANEL "B"
 100 AMP BREAKER PANEL FRAME
 30 AMP MAIN DISCONNECT
 18 POLES INCLUDING MAIN DISCONNECT

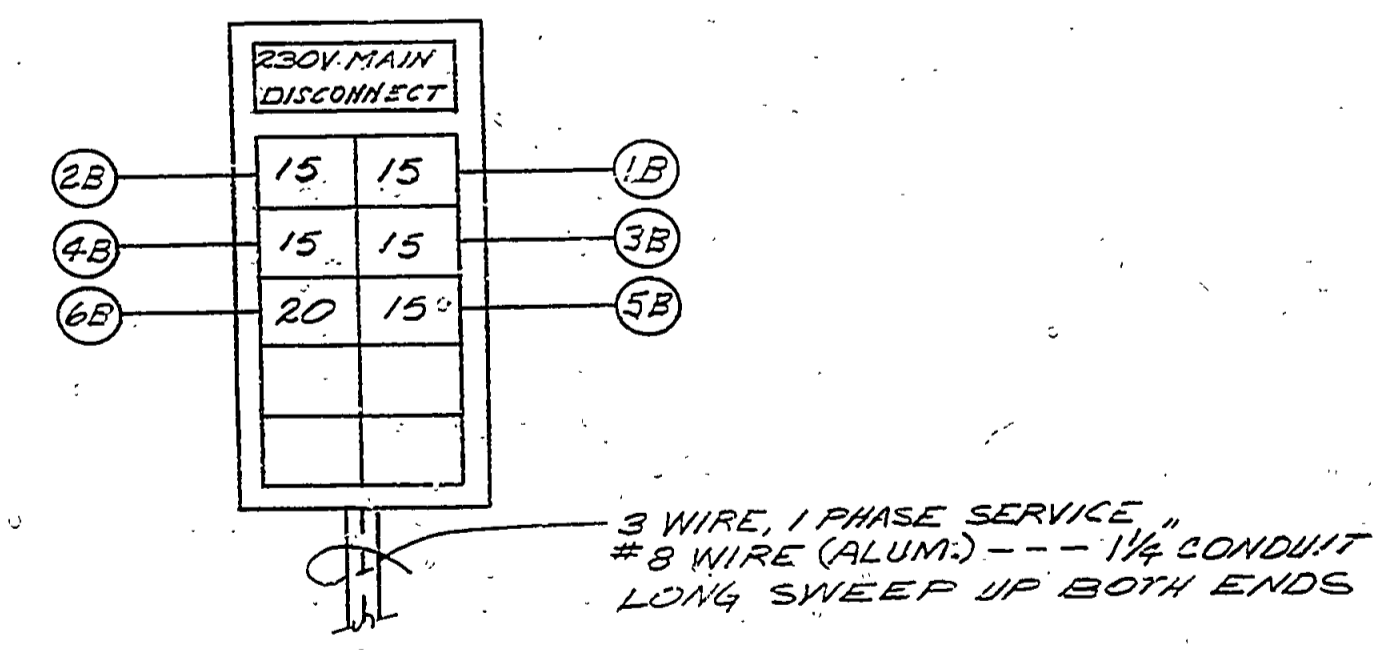

1B	115V	LIGHTING, MENS & WOMENS TOIL & DR. CT.
2B	115V	LIGHTING, MENS & WOMENS TOIL & DR. CT.
3B	115V	LIGHTING, FIRST-AID & PIPE ALLEY
4B	115V	LIGHTING, NIGHT LIGHTS
5B	115V	LIGHTING, NIGHT LIGHTS
6B	115V	CONVENIENCE OUTLETS, FIRST AID & PIPE ALLEY

FIXTURE SCHEDULE					
MARK REQ'D	NO.	MANUFACTURER	LAMP	WATT	REMARKS
		NUMBER	TYPE		
A	7	MOLDCAST #A-925-T	FLUOR.	2(40W)	MOUNT HORIZ. ABOVE TOP COURSE OF MASONRY
B	3	STD. PORCELAIN FIXTURE	INCAND.	150W	MOUNT HORIZ. ABOVE TOP COURSE OF MASONRY
C	7	DAYBRITE #4B290-4	FLUOR.	2(40W)	MOUNT HORIZ. TOP USE OF MASONRY (LONG REFLECTOR UP)
D	2	McPHILBEN #43-4VT(282)	INCAND.	2(60W)	MOUNT HORIZ. ON TOP COURSE OF MASONRY
E	5	DAYBRITE #45242-B (HANDER)	FLUOR.	4(40W)	MOUNT ABOVE WINDOW HEAD (APPROX 9'-6" ABOVE FIN. FL.)
F	2	DAYBRITE #45242-4	FLUOR.	2(40W)	MOUNT ABOVE WINDOW HEAD (APPROX 9'-6" ABOVE FIN. FL.)
G	5	DAYBRITE #45242-4	FLUOR.	2(40W)	MOUNT ABOVE TOP COURSE OF MASONRY
H	5	SWIVELIER #31411/28212 STEIN	INCAND.	150W, 5-40	MOUNT ON ROLL UP DOOR HOOD PER SKETCH
J	3	SWIVELIER #31411/28700 LOUVER	INCAND.	150W, 40	MOUNT ON ROOF FRAMING
K	2	McPHILBEN #43-40VT	INCAND.	100 W.	MOUNT 6'-6" ABOVE FIN. FLOOR
L	1	McPHILBEN #43-40VT	INCAND.	75W	MOUNT ABOVE TOP COURSE OF MASONRY
M	5	McPHILBEN #93-25A	INCAND.	2(75W)	MOUNT ON FRAMING ABOVE MASONRY
N	4	McPHILBEN #93-25A	INCAND.	2(75W)	MOUNT ON THIRD COURSE OF MASONRY (WITHOUT GAPS)
O	3	McPHILBEN #93-25A	INCAND.	2(75W)	MOUNT ON TOP COURSE OF MASONRY

LEGEND

- ▽ PUBLIC TELEPHONE
- PRIVATE TELEPHONE
- TELEPHONE JUNCTION BOX
- △ ABOVE COUNTER
- L.W. LOWER WALL
- S.H. SWITCH HEIGHT
- H.D. HAND DRYER
- U.G. UNDERGROUND
- U.S. COURSE
- M.S. MASONRY
- FIN. FL. FINISHED FLOOR