

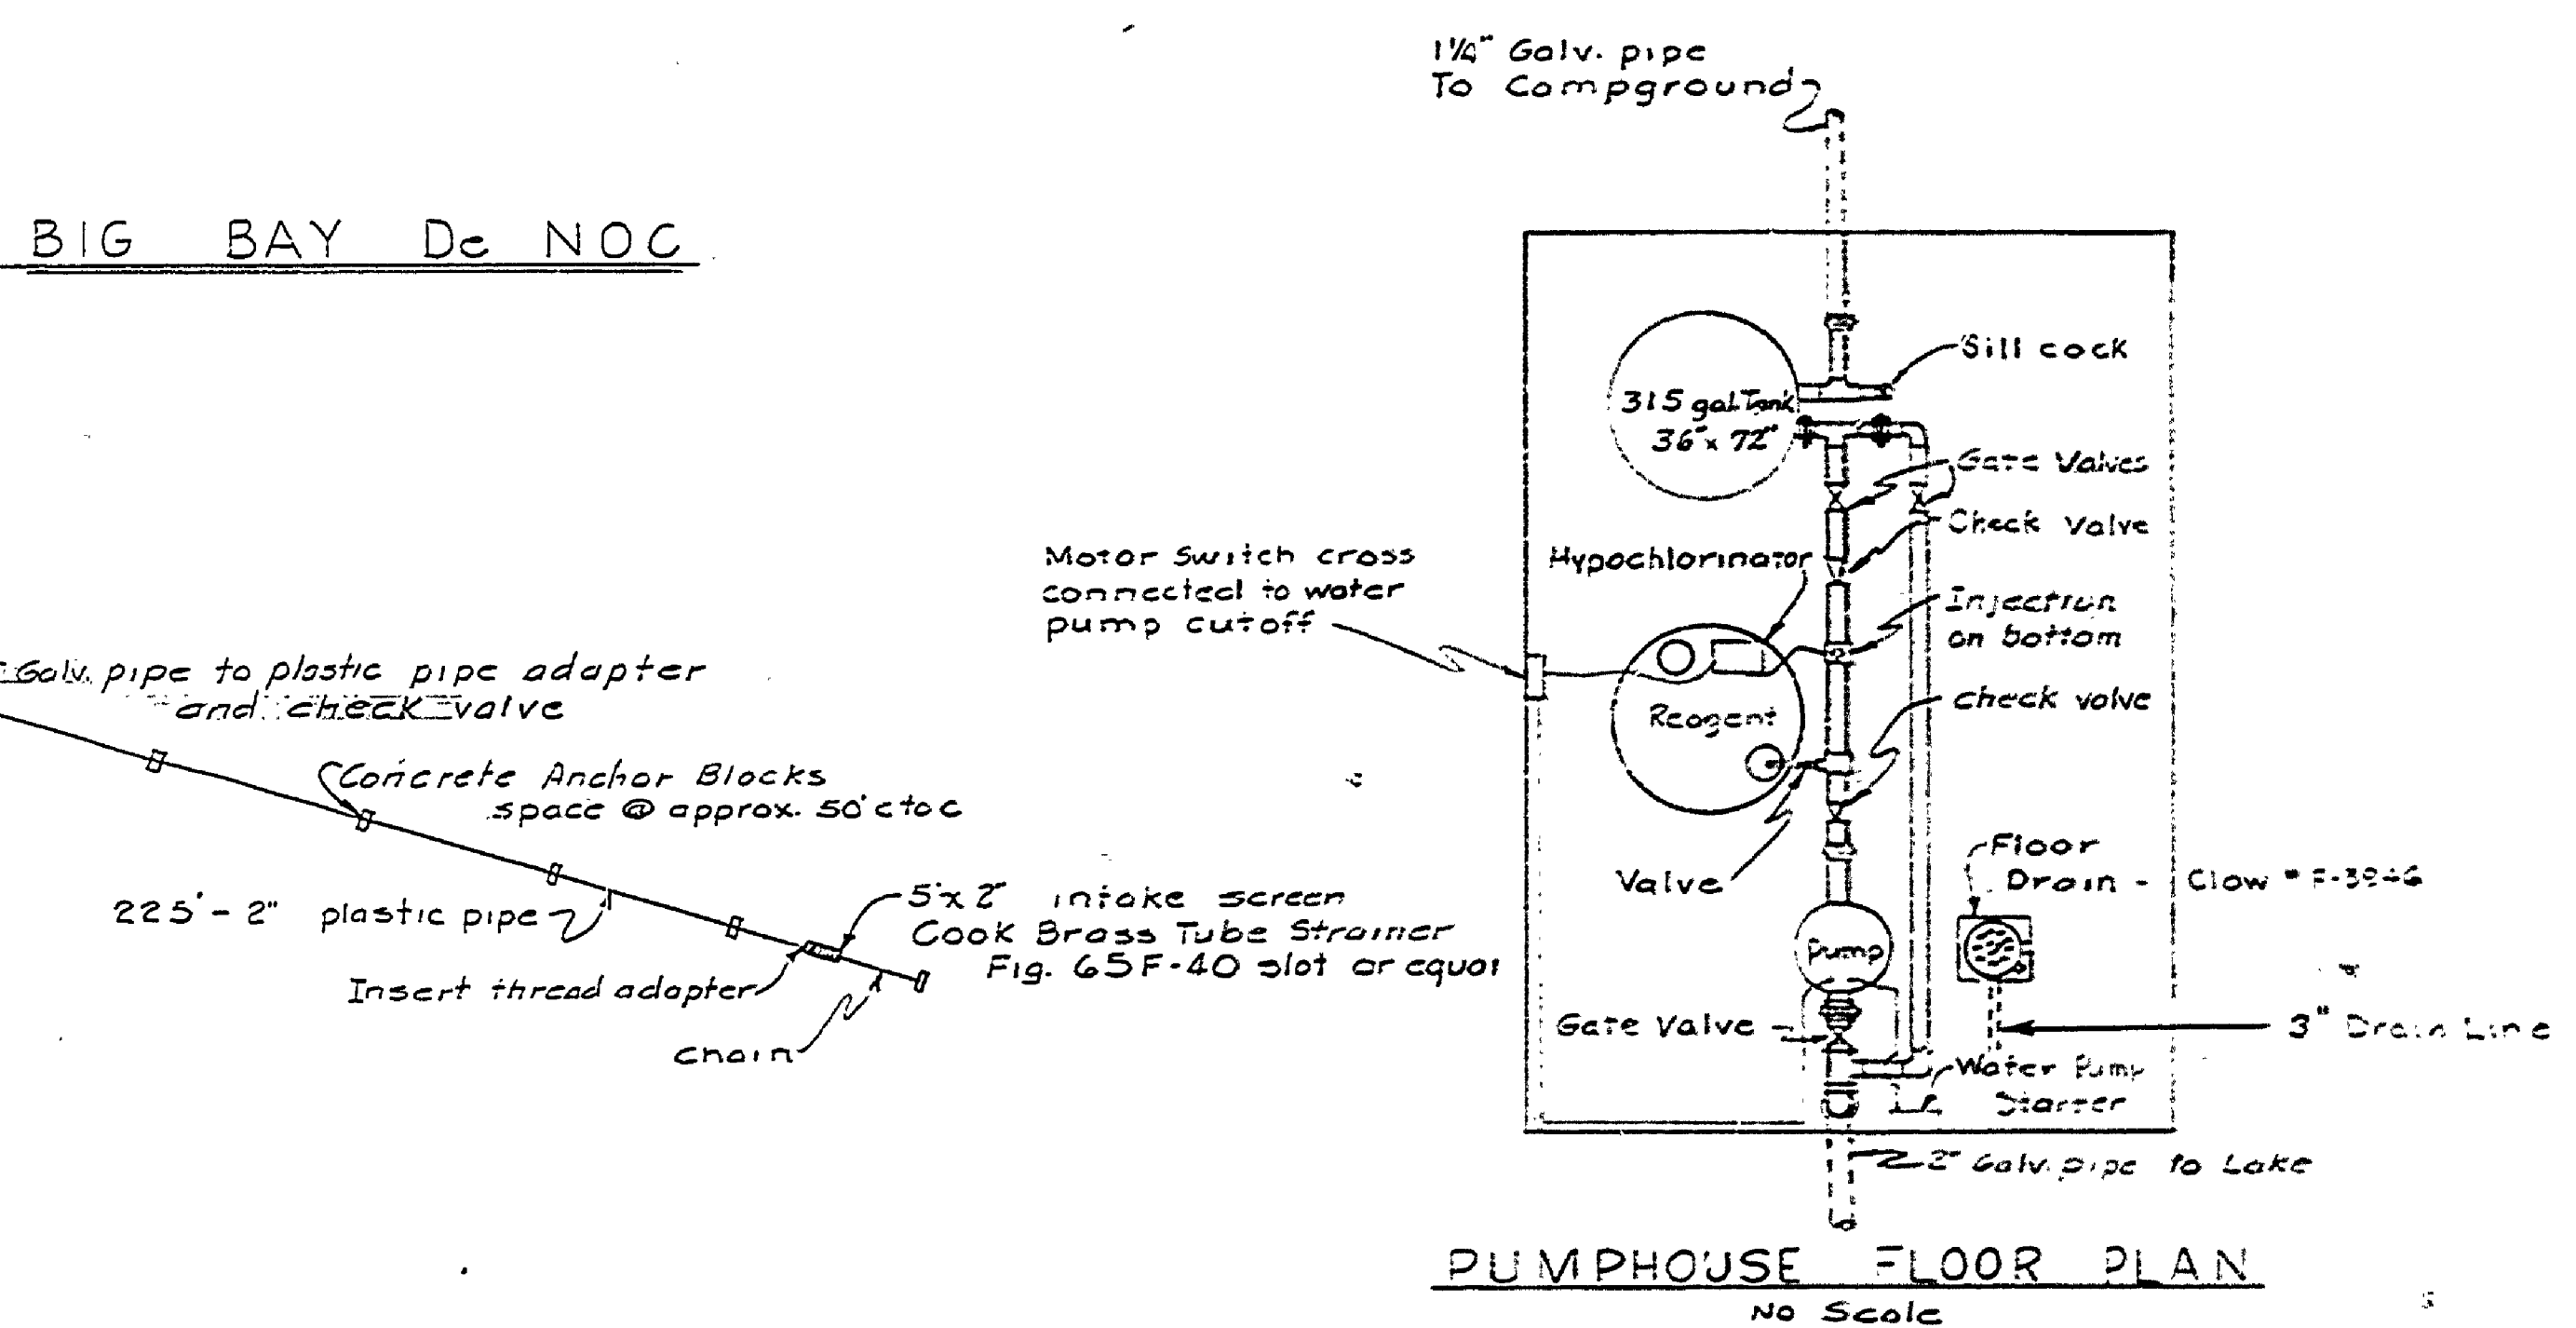
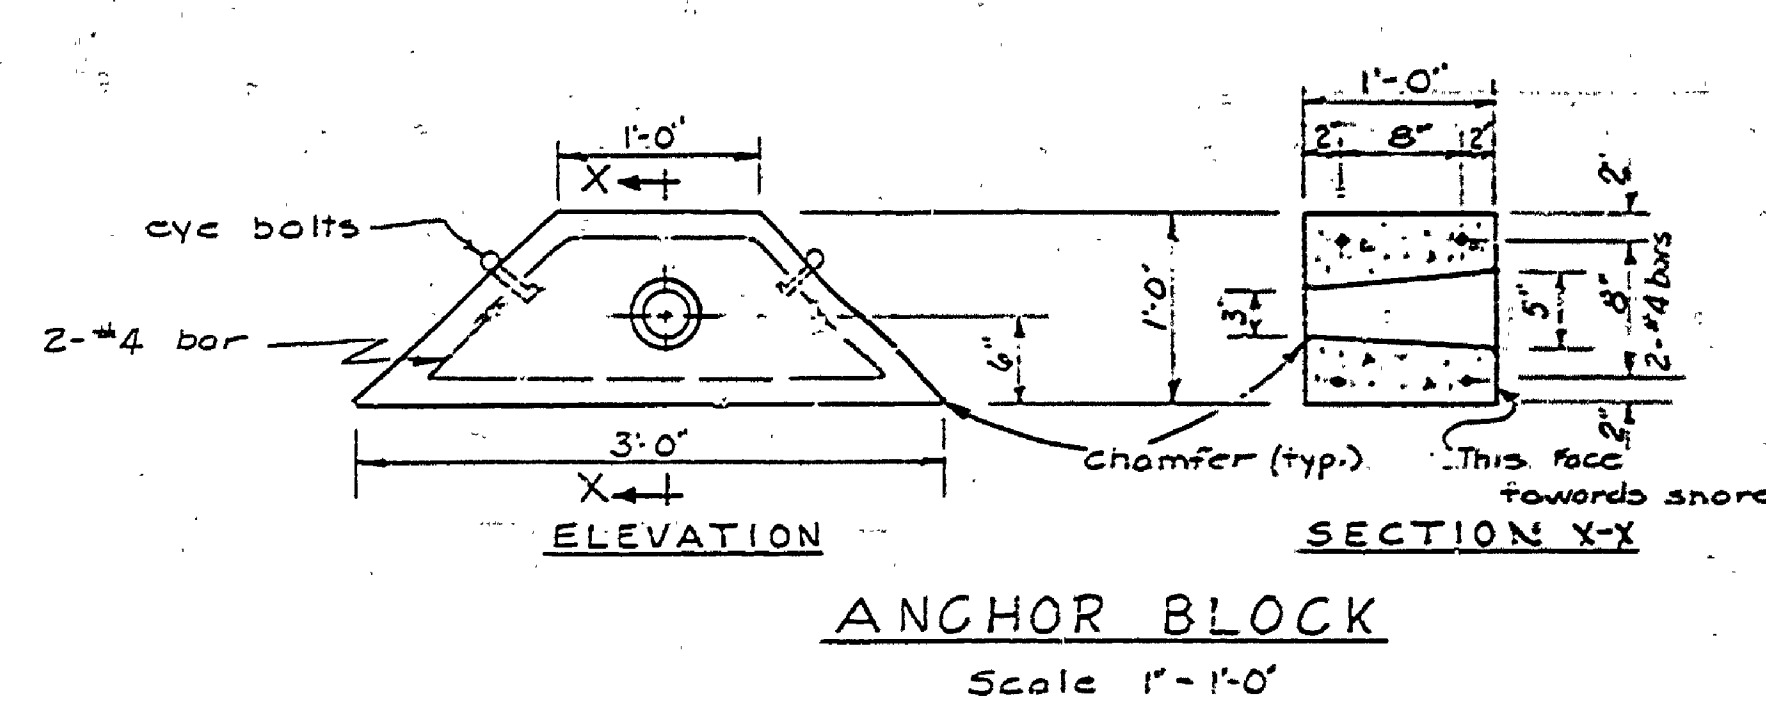


DESIGNED BY	REVIEWED	DATE	APPROVED	DATE	NO.	DATE	BY	REVISIONS
RECKE II	ARCHITECTURAL	1-65			1			4
DRAWN BY	ENGINEERING	1-65			2			5
CHECKED BY	LANDSCAPE				3			6

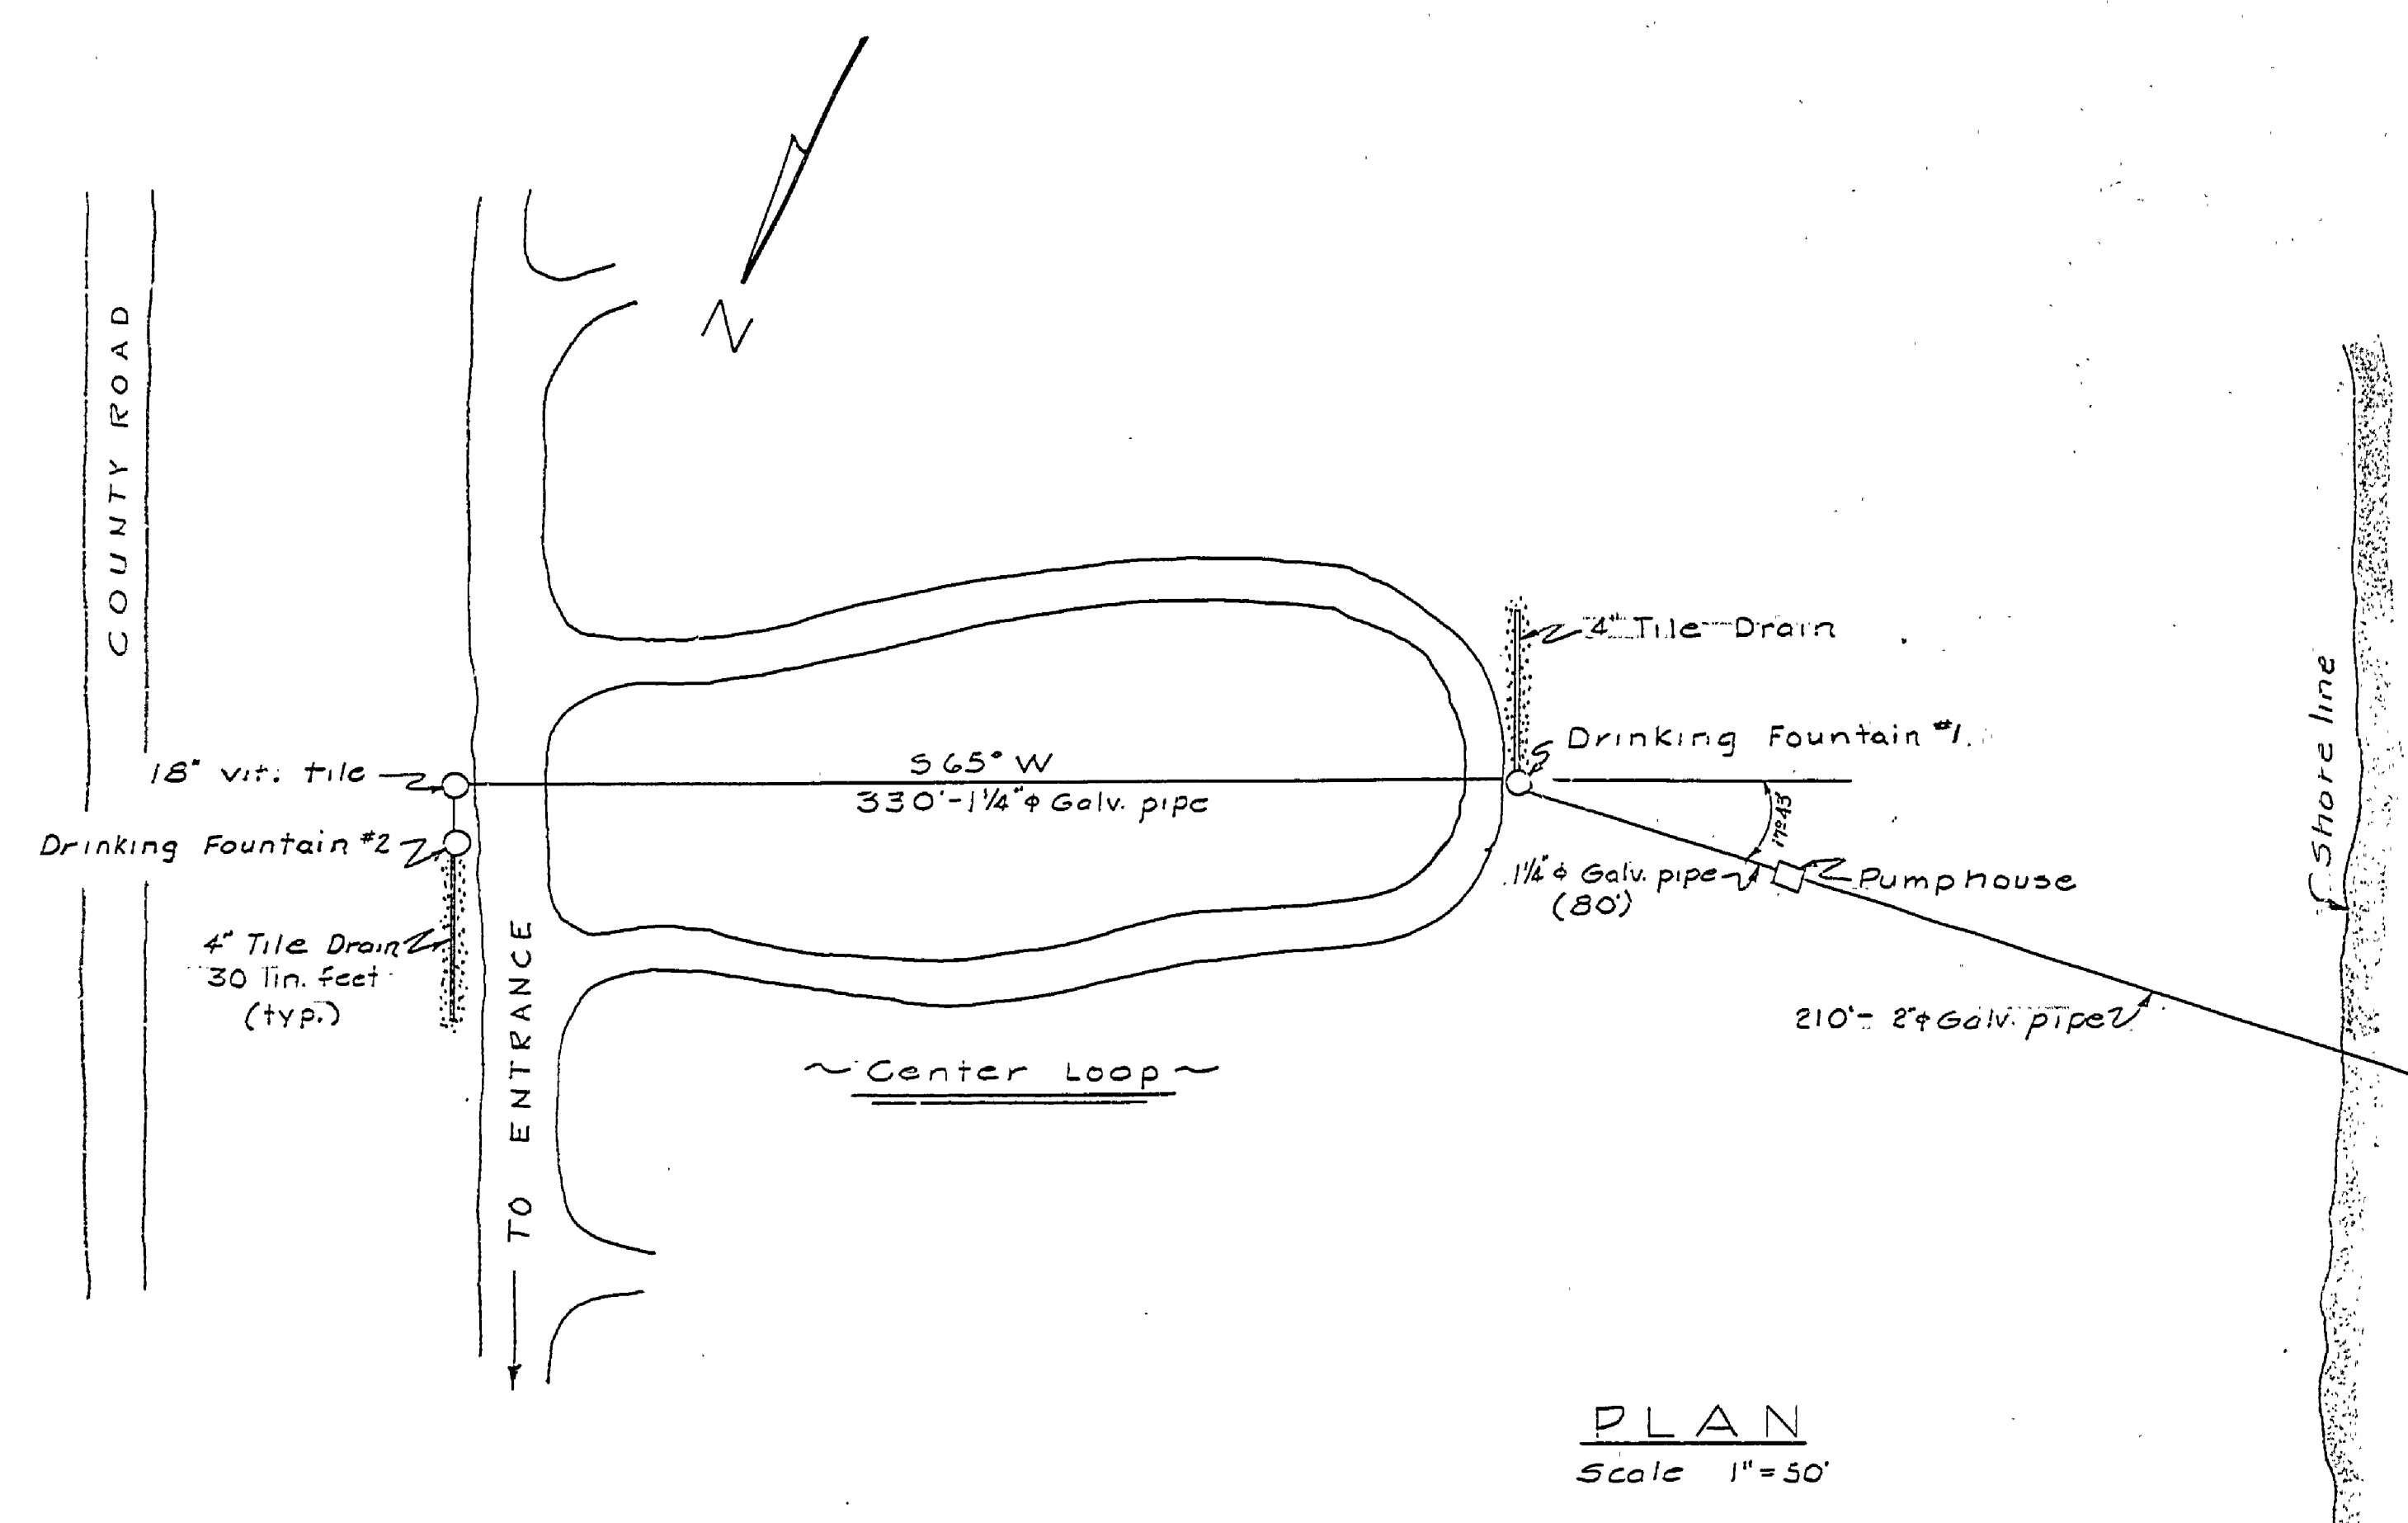

Notes:
 Pump shall be a Jacuzzi TJX3, 3/4 hp motor
 of just discharge pressure to be 250 psi max
 Total dynamic head is 154 feet.
 The plastic pipe shall be 100' pressure
 rated (Heavy duty). The pipe shall be taken
 out of the water each fall.
 Buoys shall be the styrofoam type.
 The hypochlorinator shall be a Model
 1201-4 Precision Chemical Pump or equal.
 A Comparator with test limits from .05 to 100
 parts per million shall accompany the
 hypochlorinator.

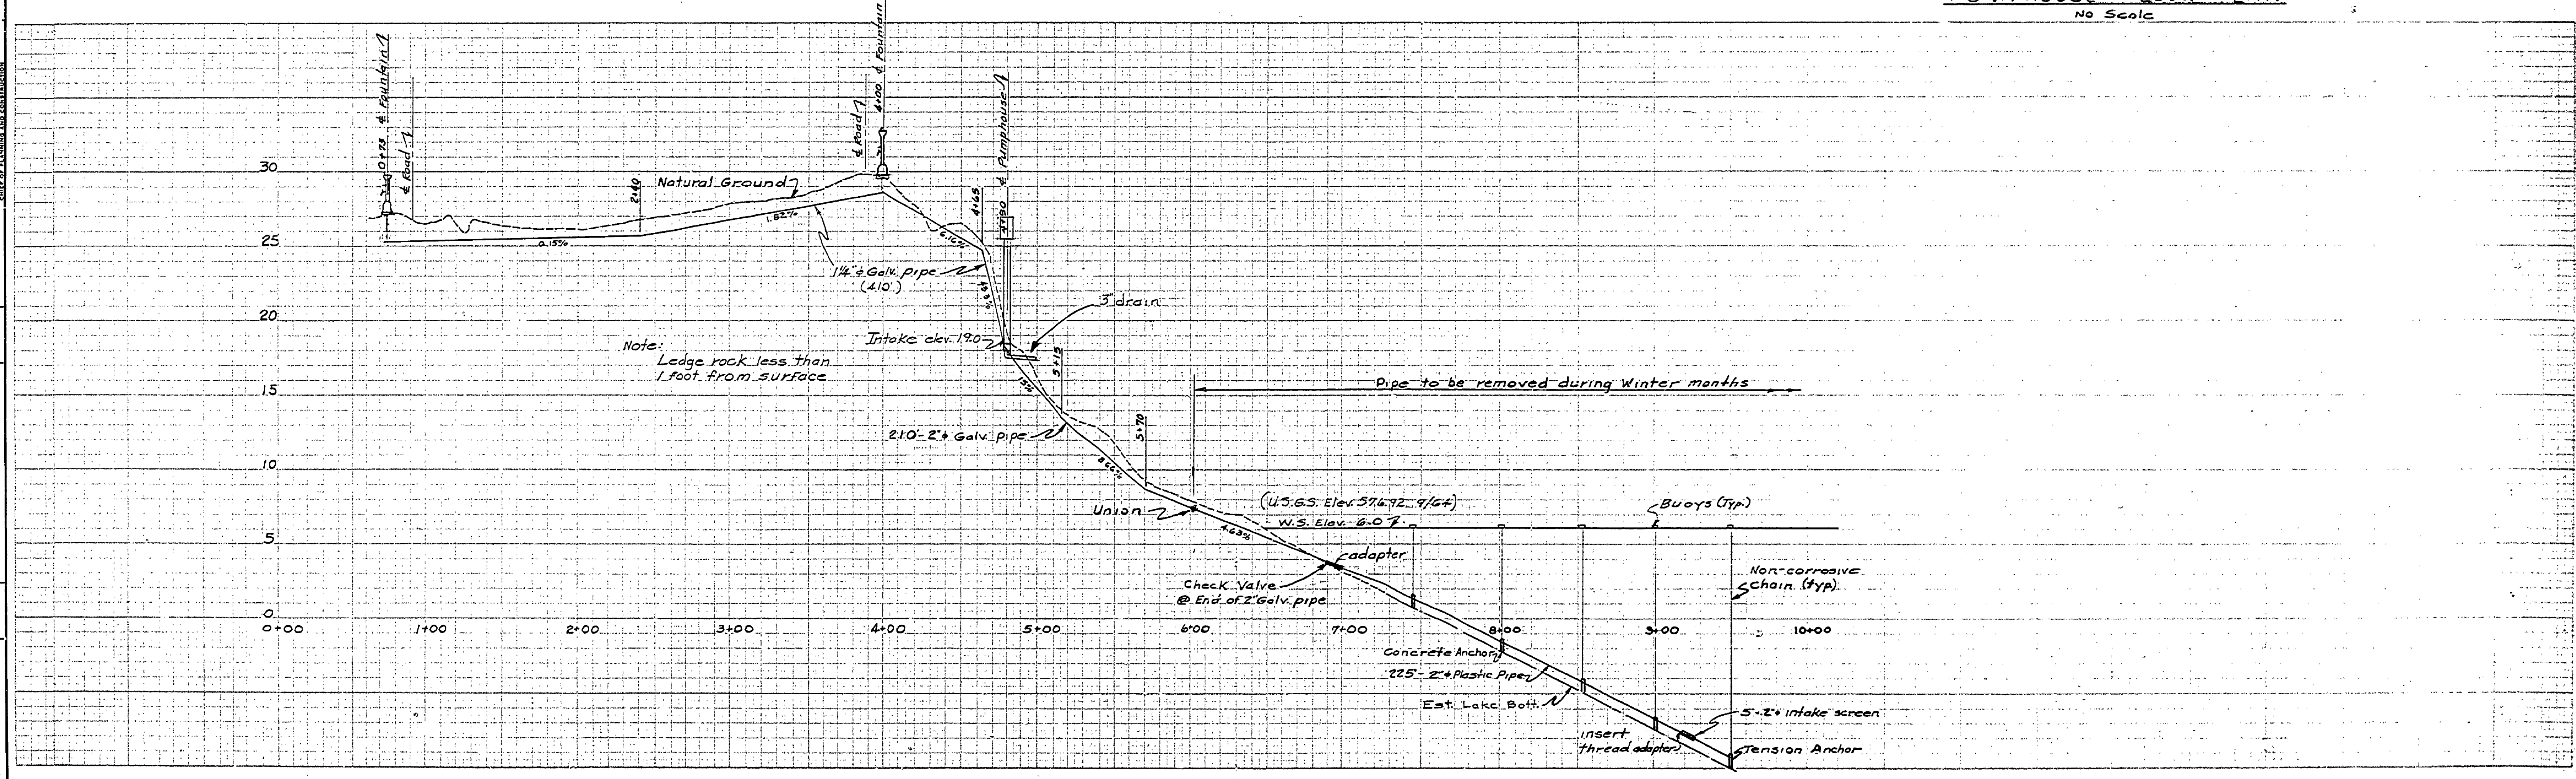

MICHIGAN
 DEPARTMENT OF CONSERVATION
 PARKS AND RECREATION DIVISION

FAYETTE
 CAMPGROUND-WATER

SHEET
 NO. 2
 OF 3
 PLAN NO.
 E 103