



NO.	DATE	BY
1		
2		
3		
4		
5		
6		

NOTE.
 Electrical Requirements.
 Mess Hall 3 KW
 Latrine 1 KW
 Pump House 2 KW
 Recreation Hall 1 KW
 Huts 0.2 KW
 Entrancer Wire To Be #8 Spacing Of Poles May Be Changed In Order To Facilitate Wiring Of Huts, But Distance Between Poles Not To Exceed 125'

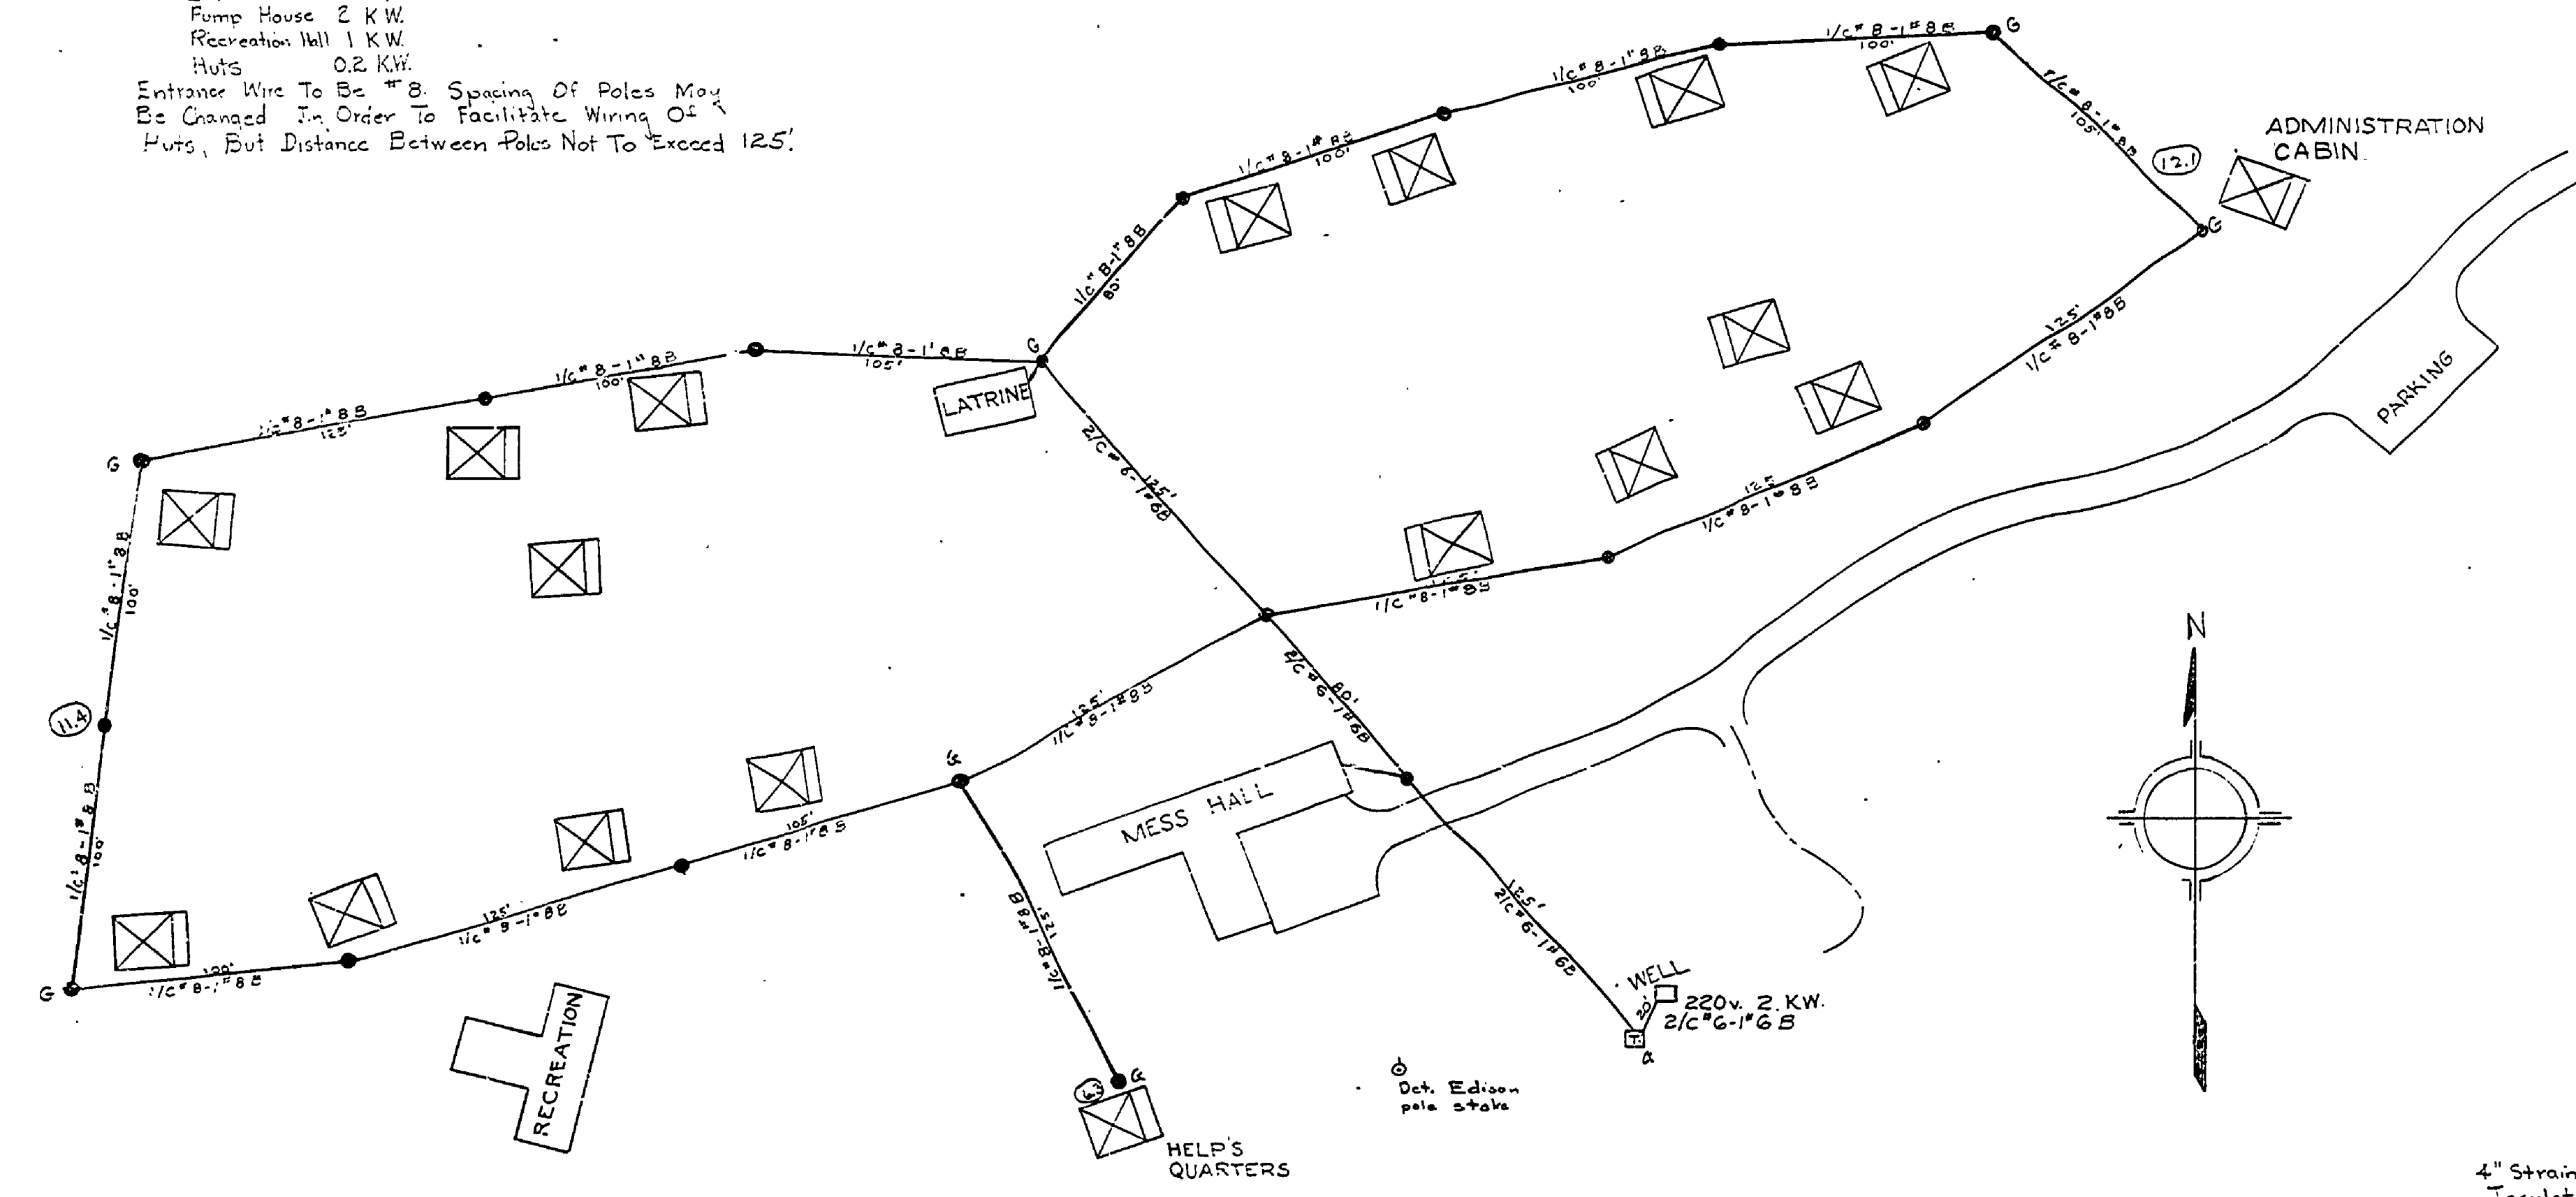


ELECTRICAL DISTRIBUTION SYSTEM PLAN
 Scale 1"=50'-0"

LEGEND
 Transformer
 21/2" x 6-1/2" Two Covered #6 Wire - One #8 Wire Barc.
 Pole With Guy Wire And Anchor.
 3 Volts Drop From Transformer To That Point.

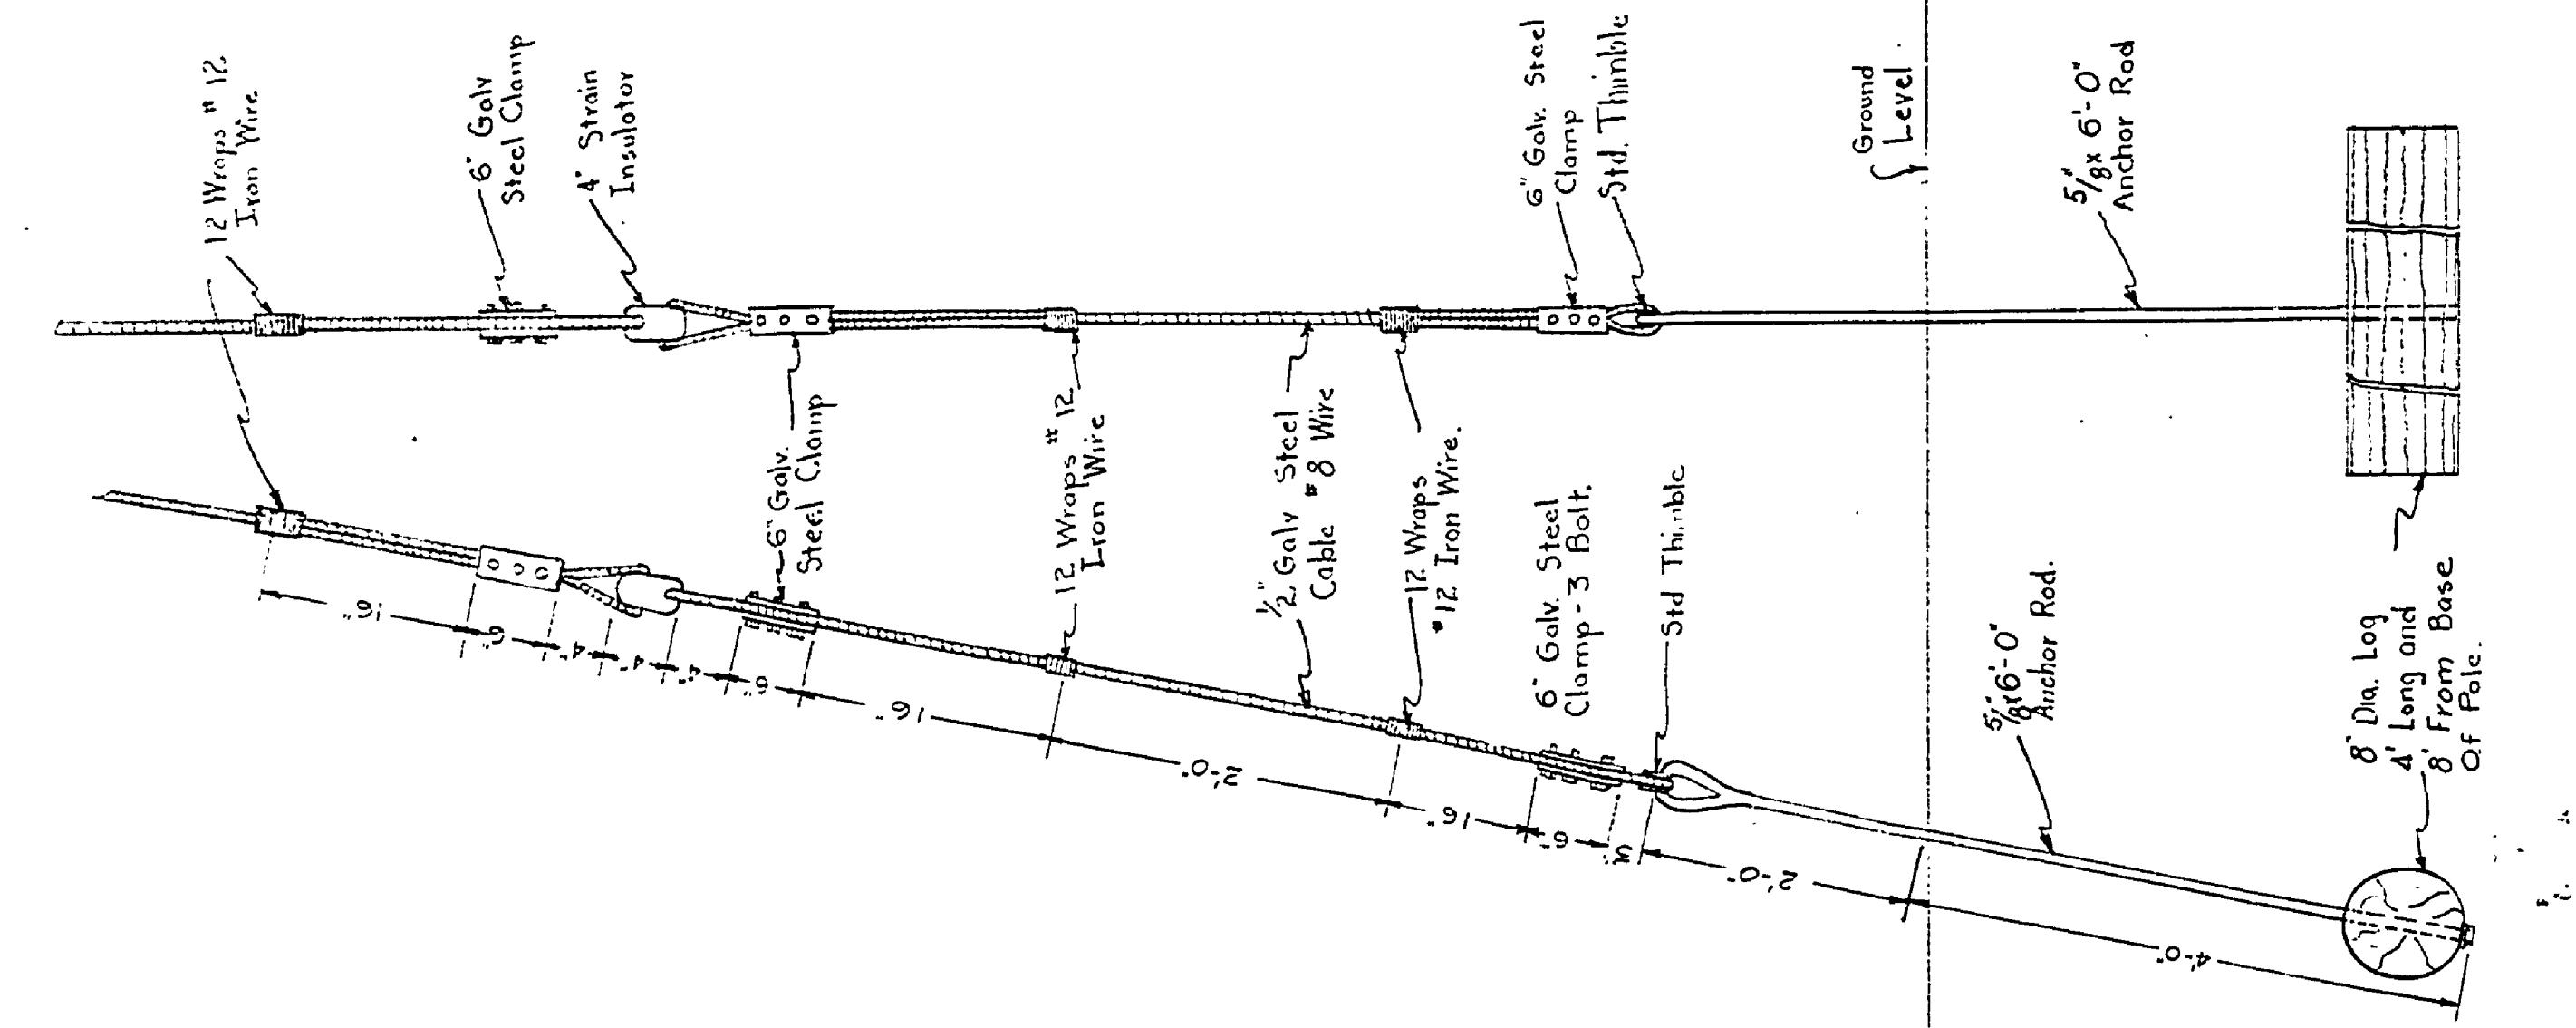

ANCHOR DETAIL
 Not to Scale.

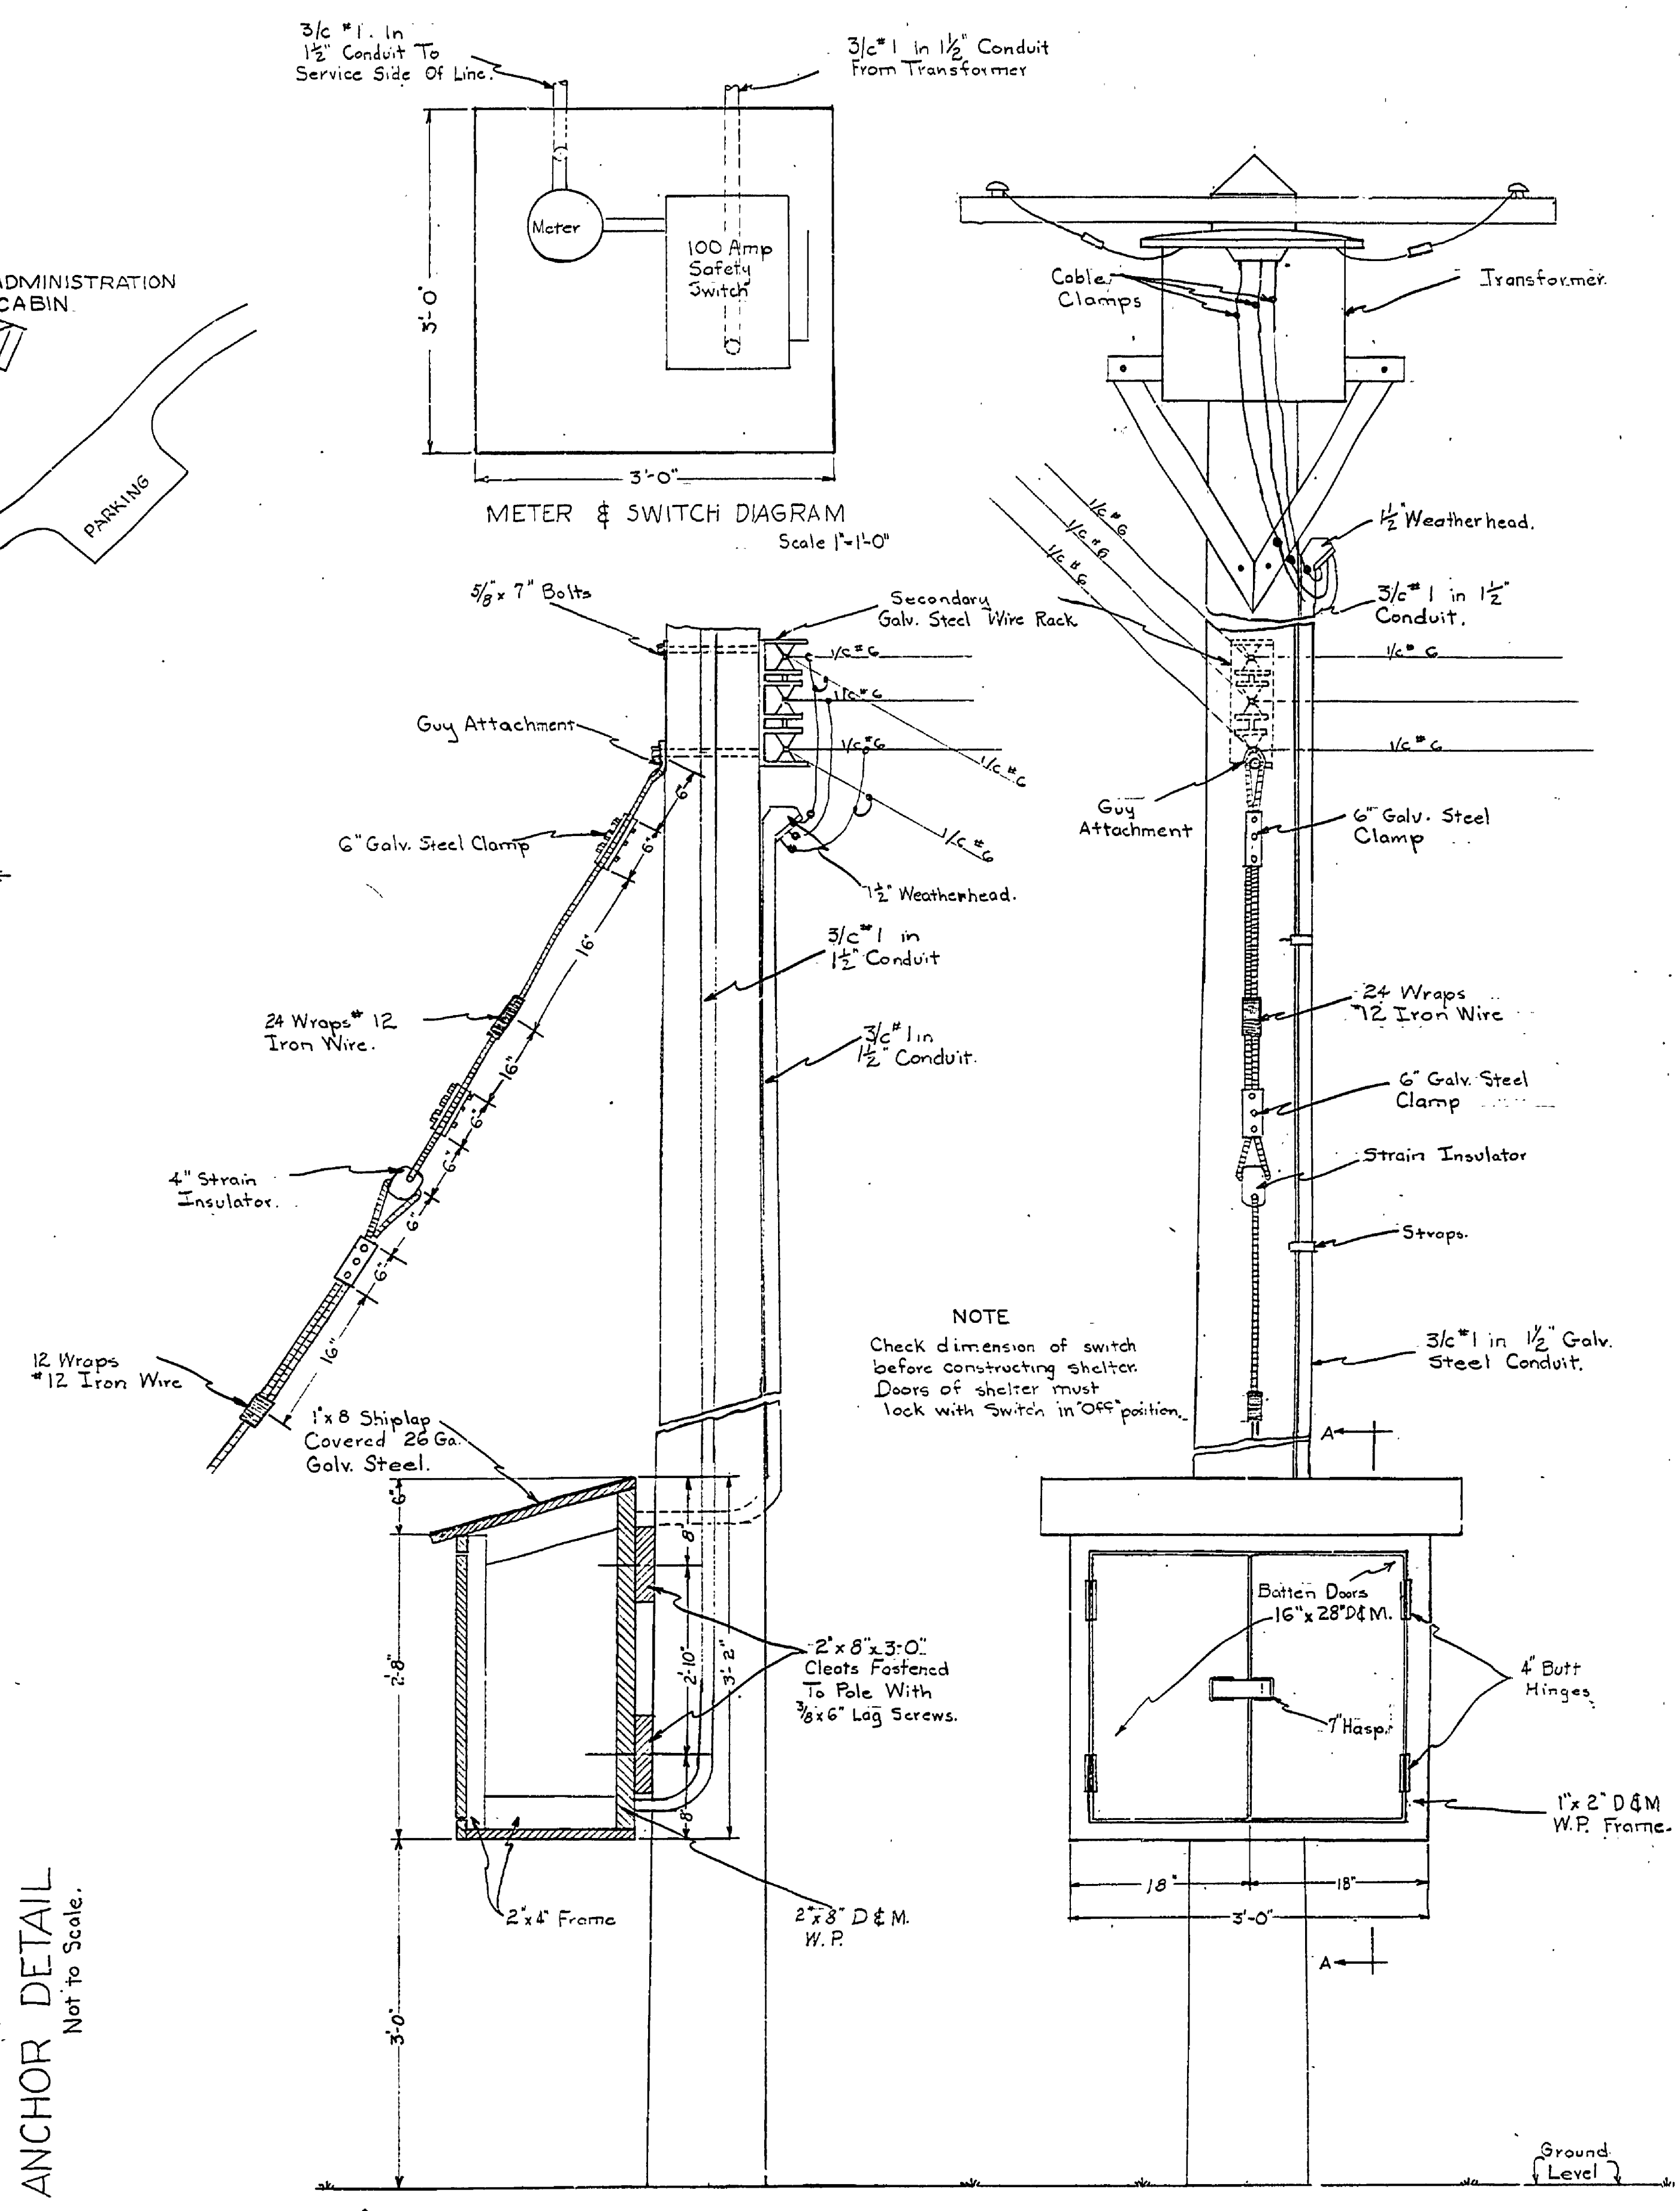

SECTION A-A
 FRONT VIEW
 SWITCH SHELTER DETAILS
 Scale 1"=1'-0"

APPROVED BY: [Signature]
 ASSISTANT CHIEF IN CHARGE
 DATE: 9-6-46
 OF DESIGN DATE: 2-23-46

REVIEWED BY SECTIONS:
 ARCHITECTURAL: [Signature]
 ENGINEERING: [Signature]
 LANDSCAPE: [Signature]

DRAWN BY: [Signature]
 TRACED BY: [Signature]
 CHECKED BY: [Signature]
 DATE: 7-2-46