
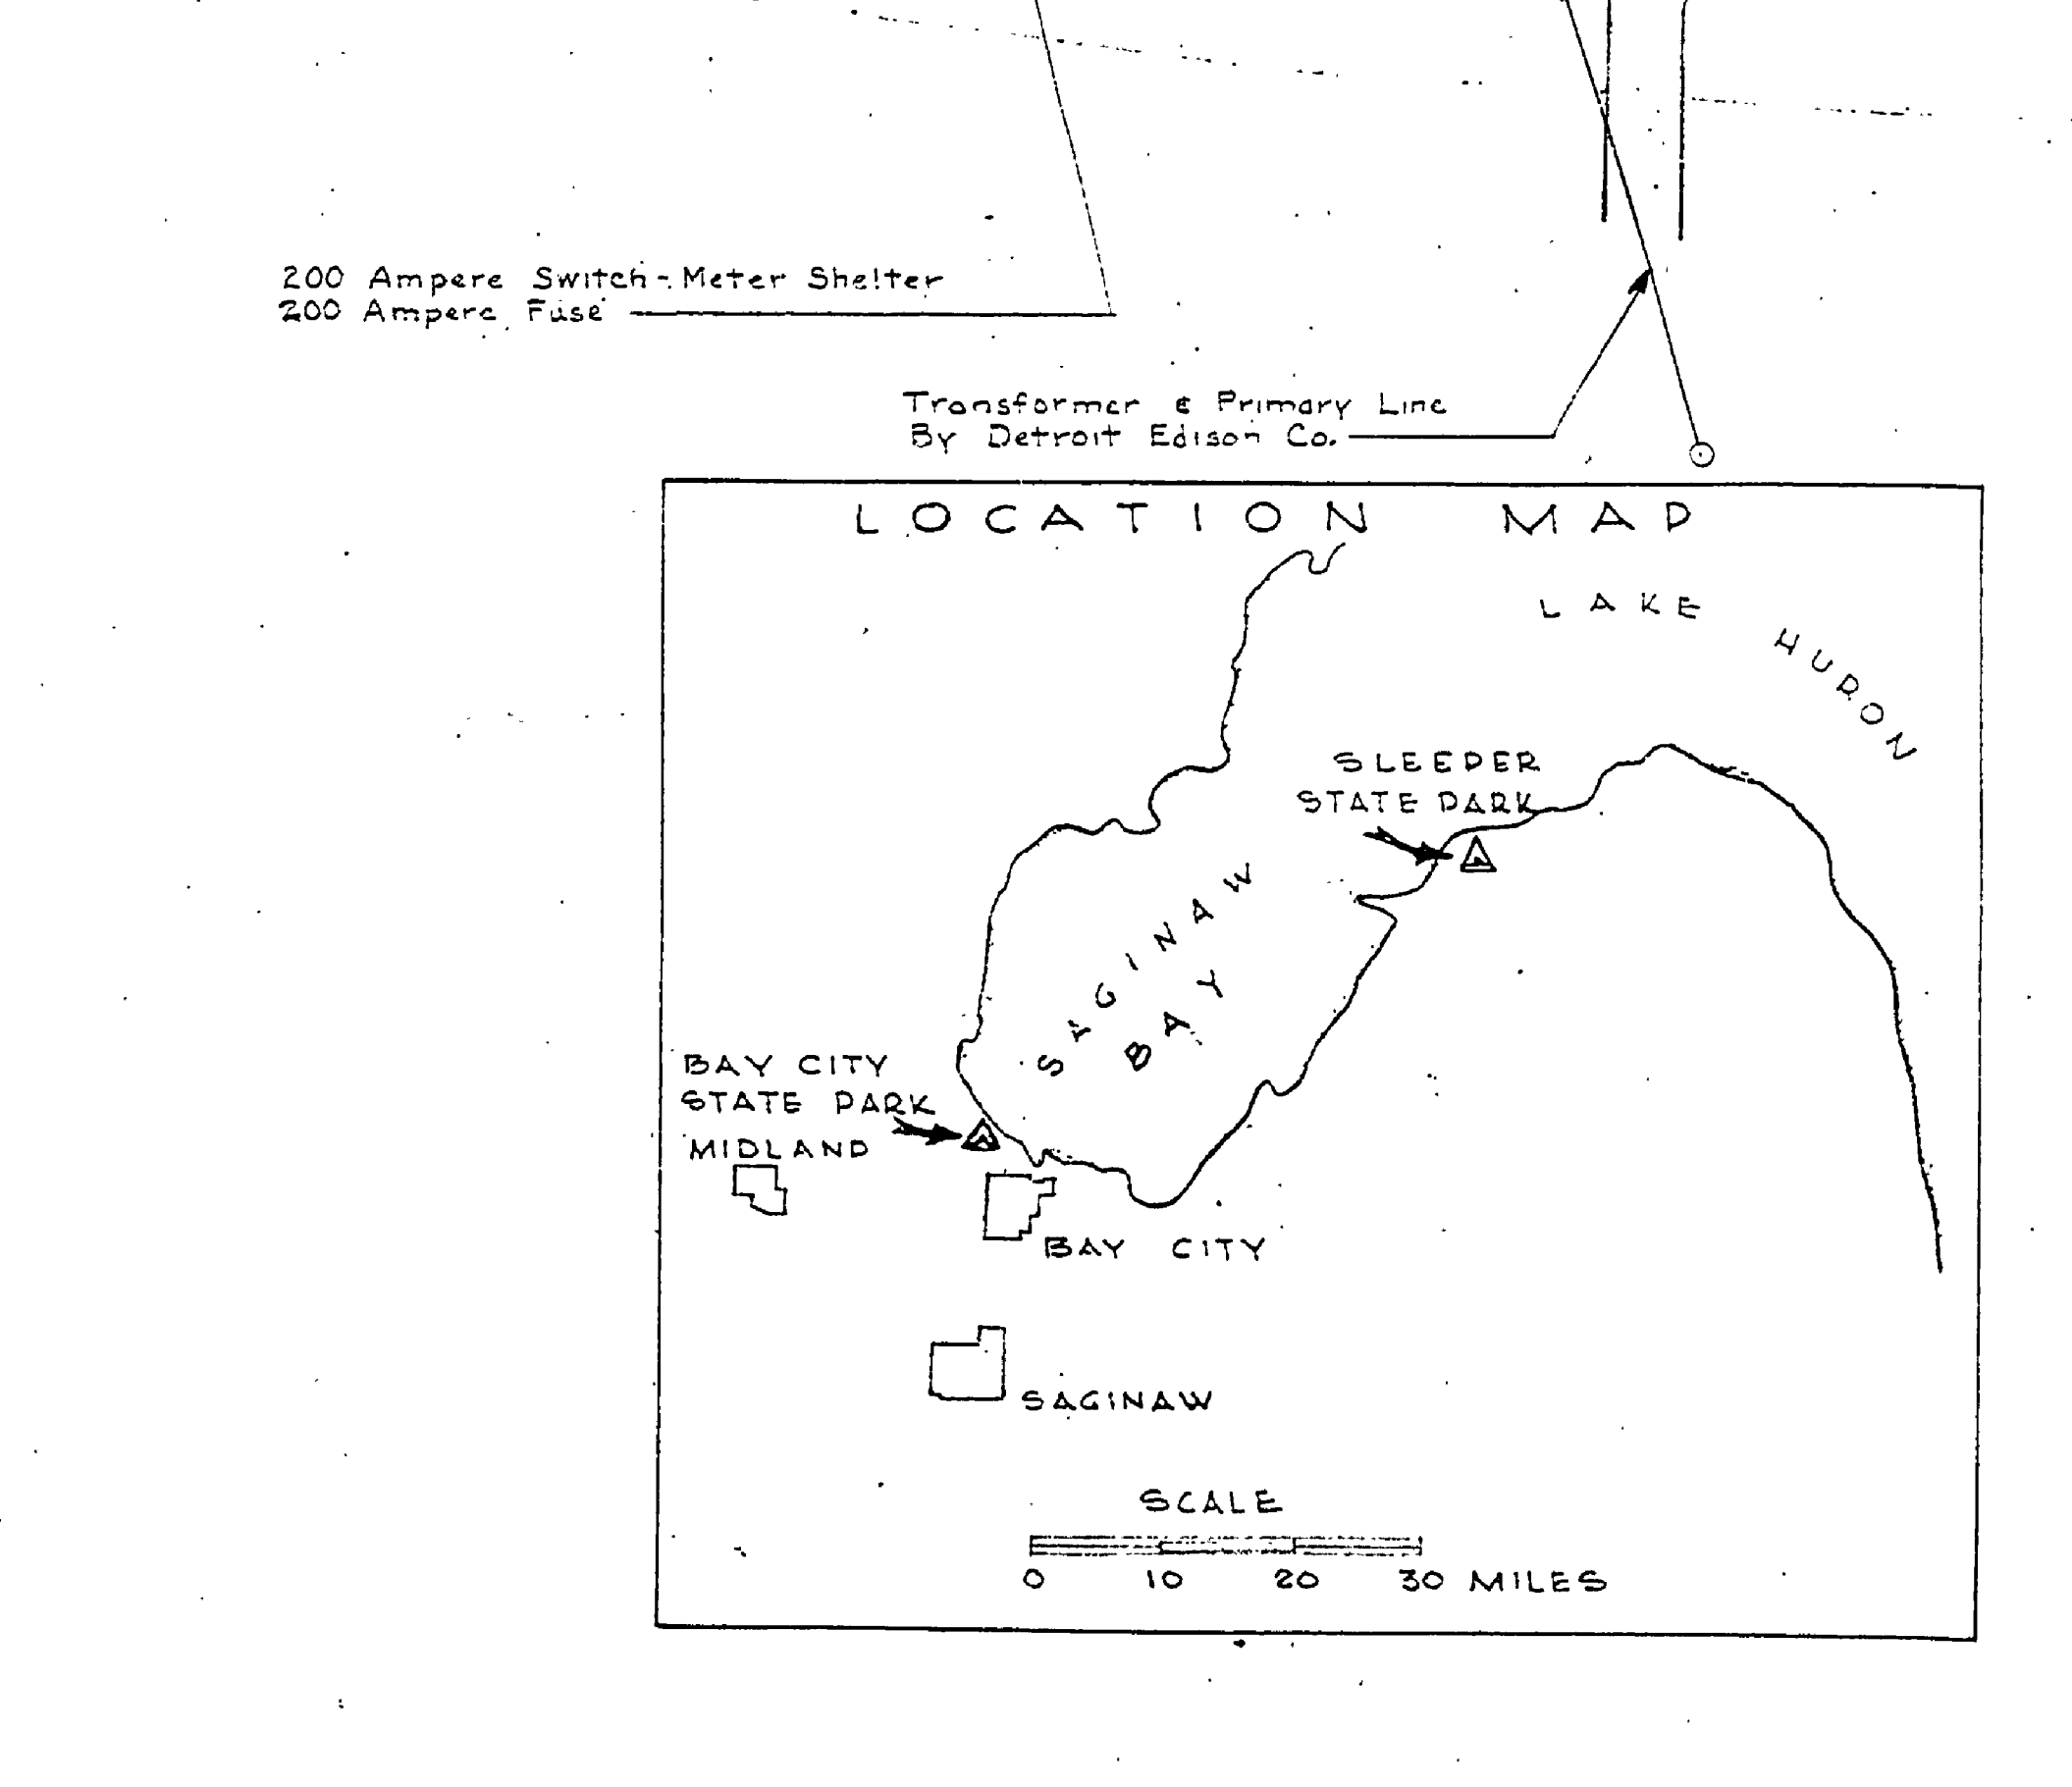
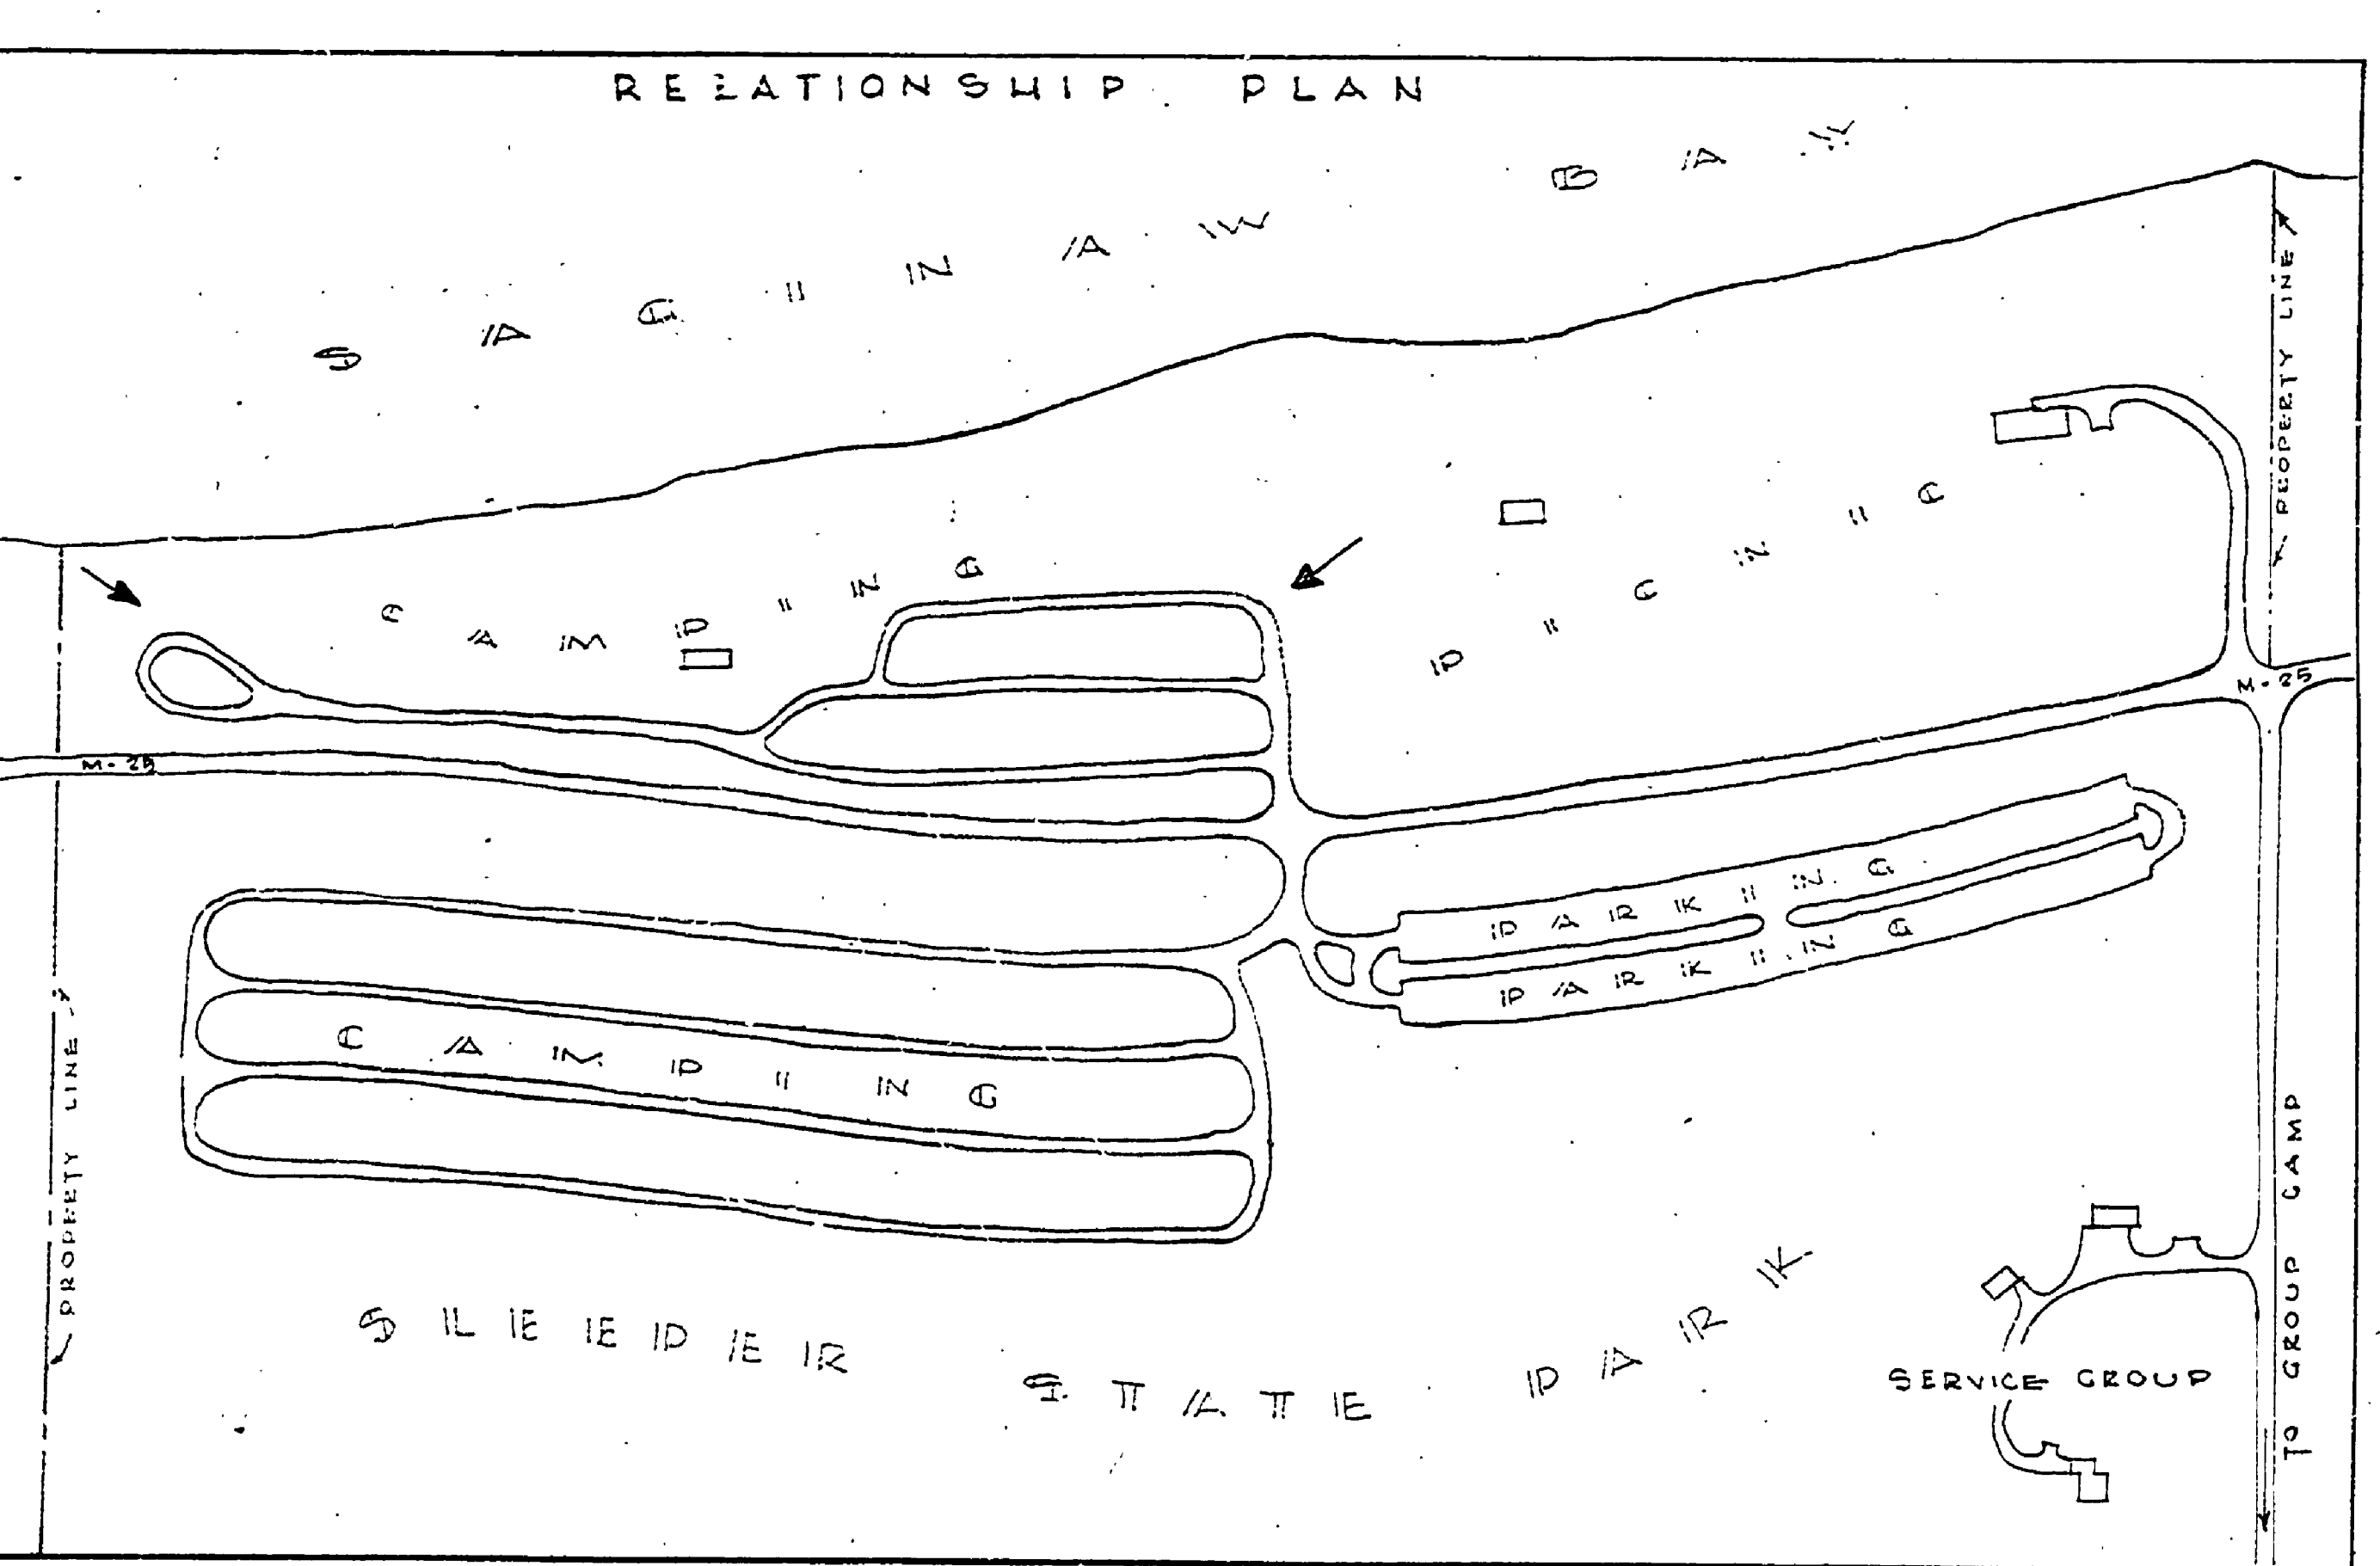


DATE BY	REVISIONS	NO. DATE BY	APPROVED BY	REVIEWED BY SECTIONS	DATE
	1	1	H.C. Madaris ASSISTANT CHIEF IN CHARGE OF DESIGN - DATE 23/1/57	ARCHITECTURAL	5-21-57
	2	2		ENGINEERING	5-21-57
	3	3		LANDSCAPE	5-21-57
	4				
	5				
	6				
DATE BY					

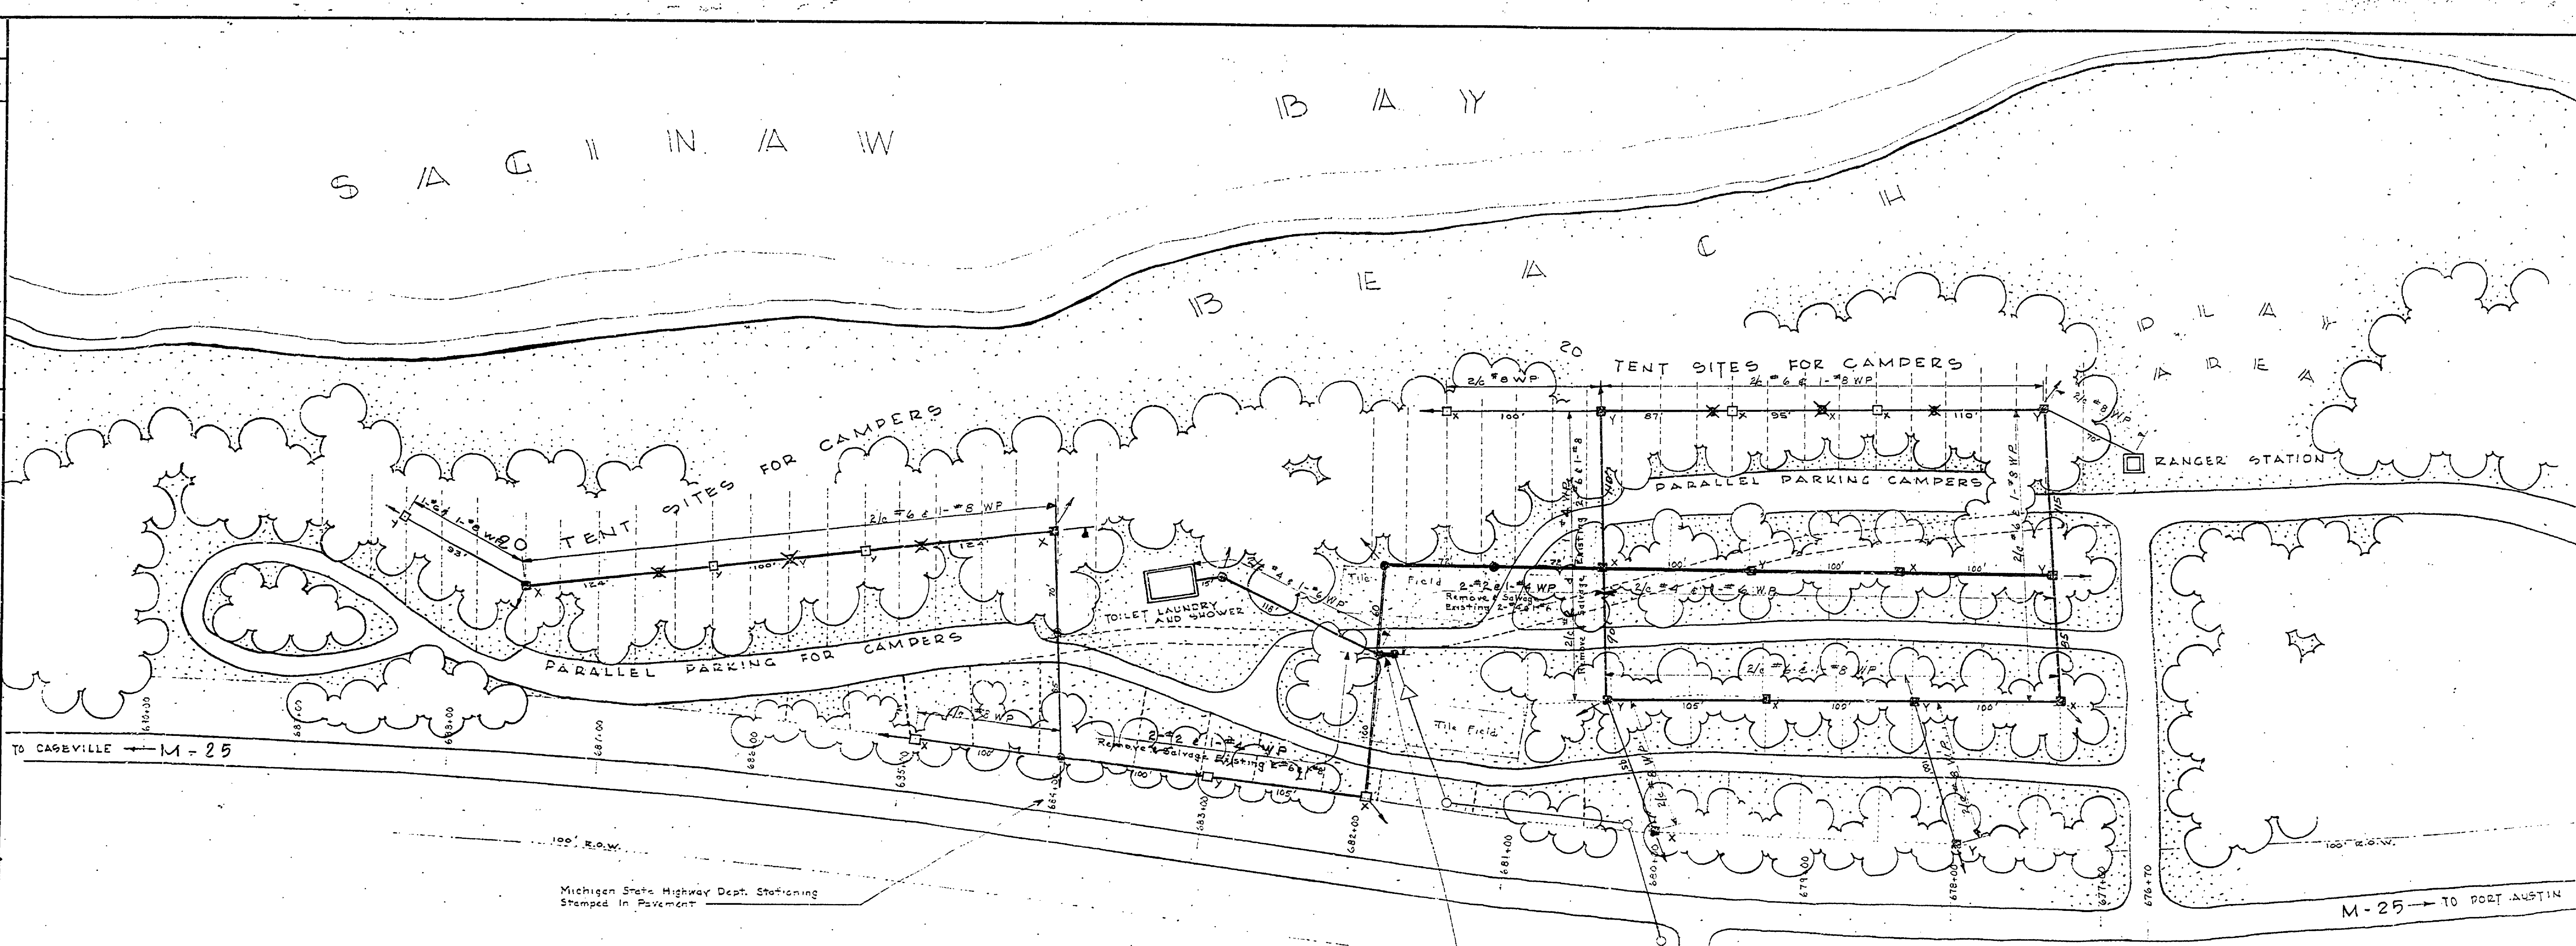

KEY

- Trailer Outlet Service Line
- Trailer Outlet Service Box
- Pole
- Anchor Guy
- Pole or Outlet Box To Be Relocated.
- Outlet Box To Be Added.

240 Volt Neutral 120 Volts X-Circuit 120 Volts Y-Circuit

SCALE
50 25 0 50 100 150 FEET