


DRAWN BY RAH	REVIEWED BY SECTIONS ARCHITECTURAL ENGINEERING LANDSCAPE	DATE 3-13-50 10/16-50 3-13-50	APPROVED BY <i>[Signature]</i>	NO. DATE BY	REVISIONS
CHECKED BY DATE 3/3/50	H.C.M. J.T.R.	3-13-50 10/16-50 3-13-50	ASSISTANT CHIEF IN CHARGE OF DESIGN DATE 3-15-50	1 2 3	4 5 6

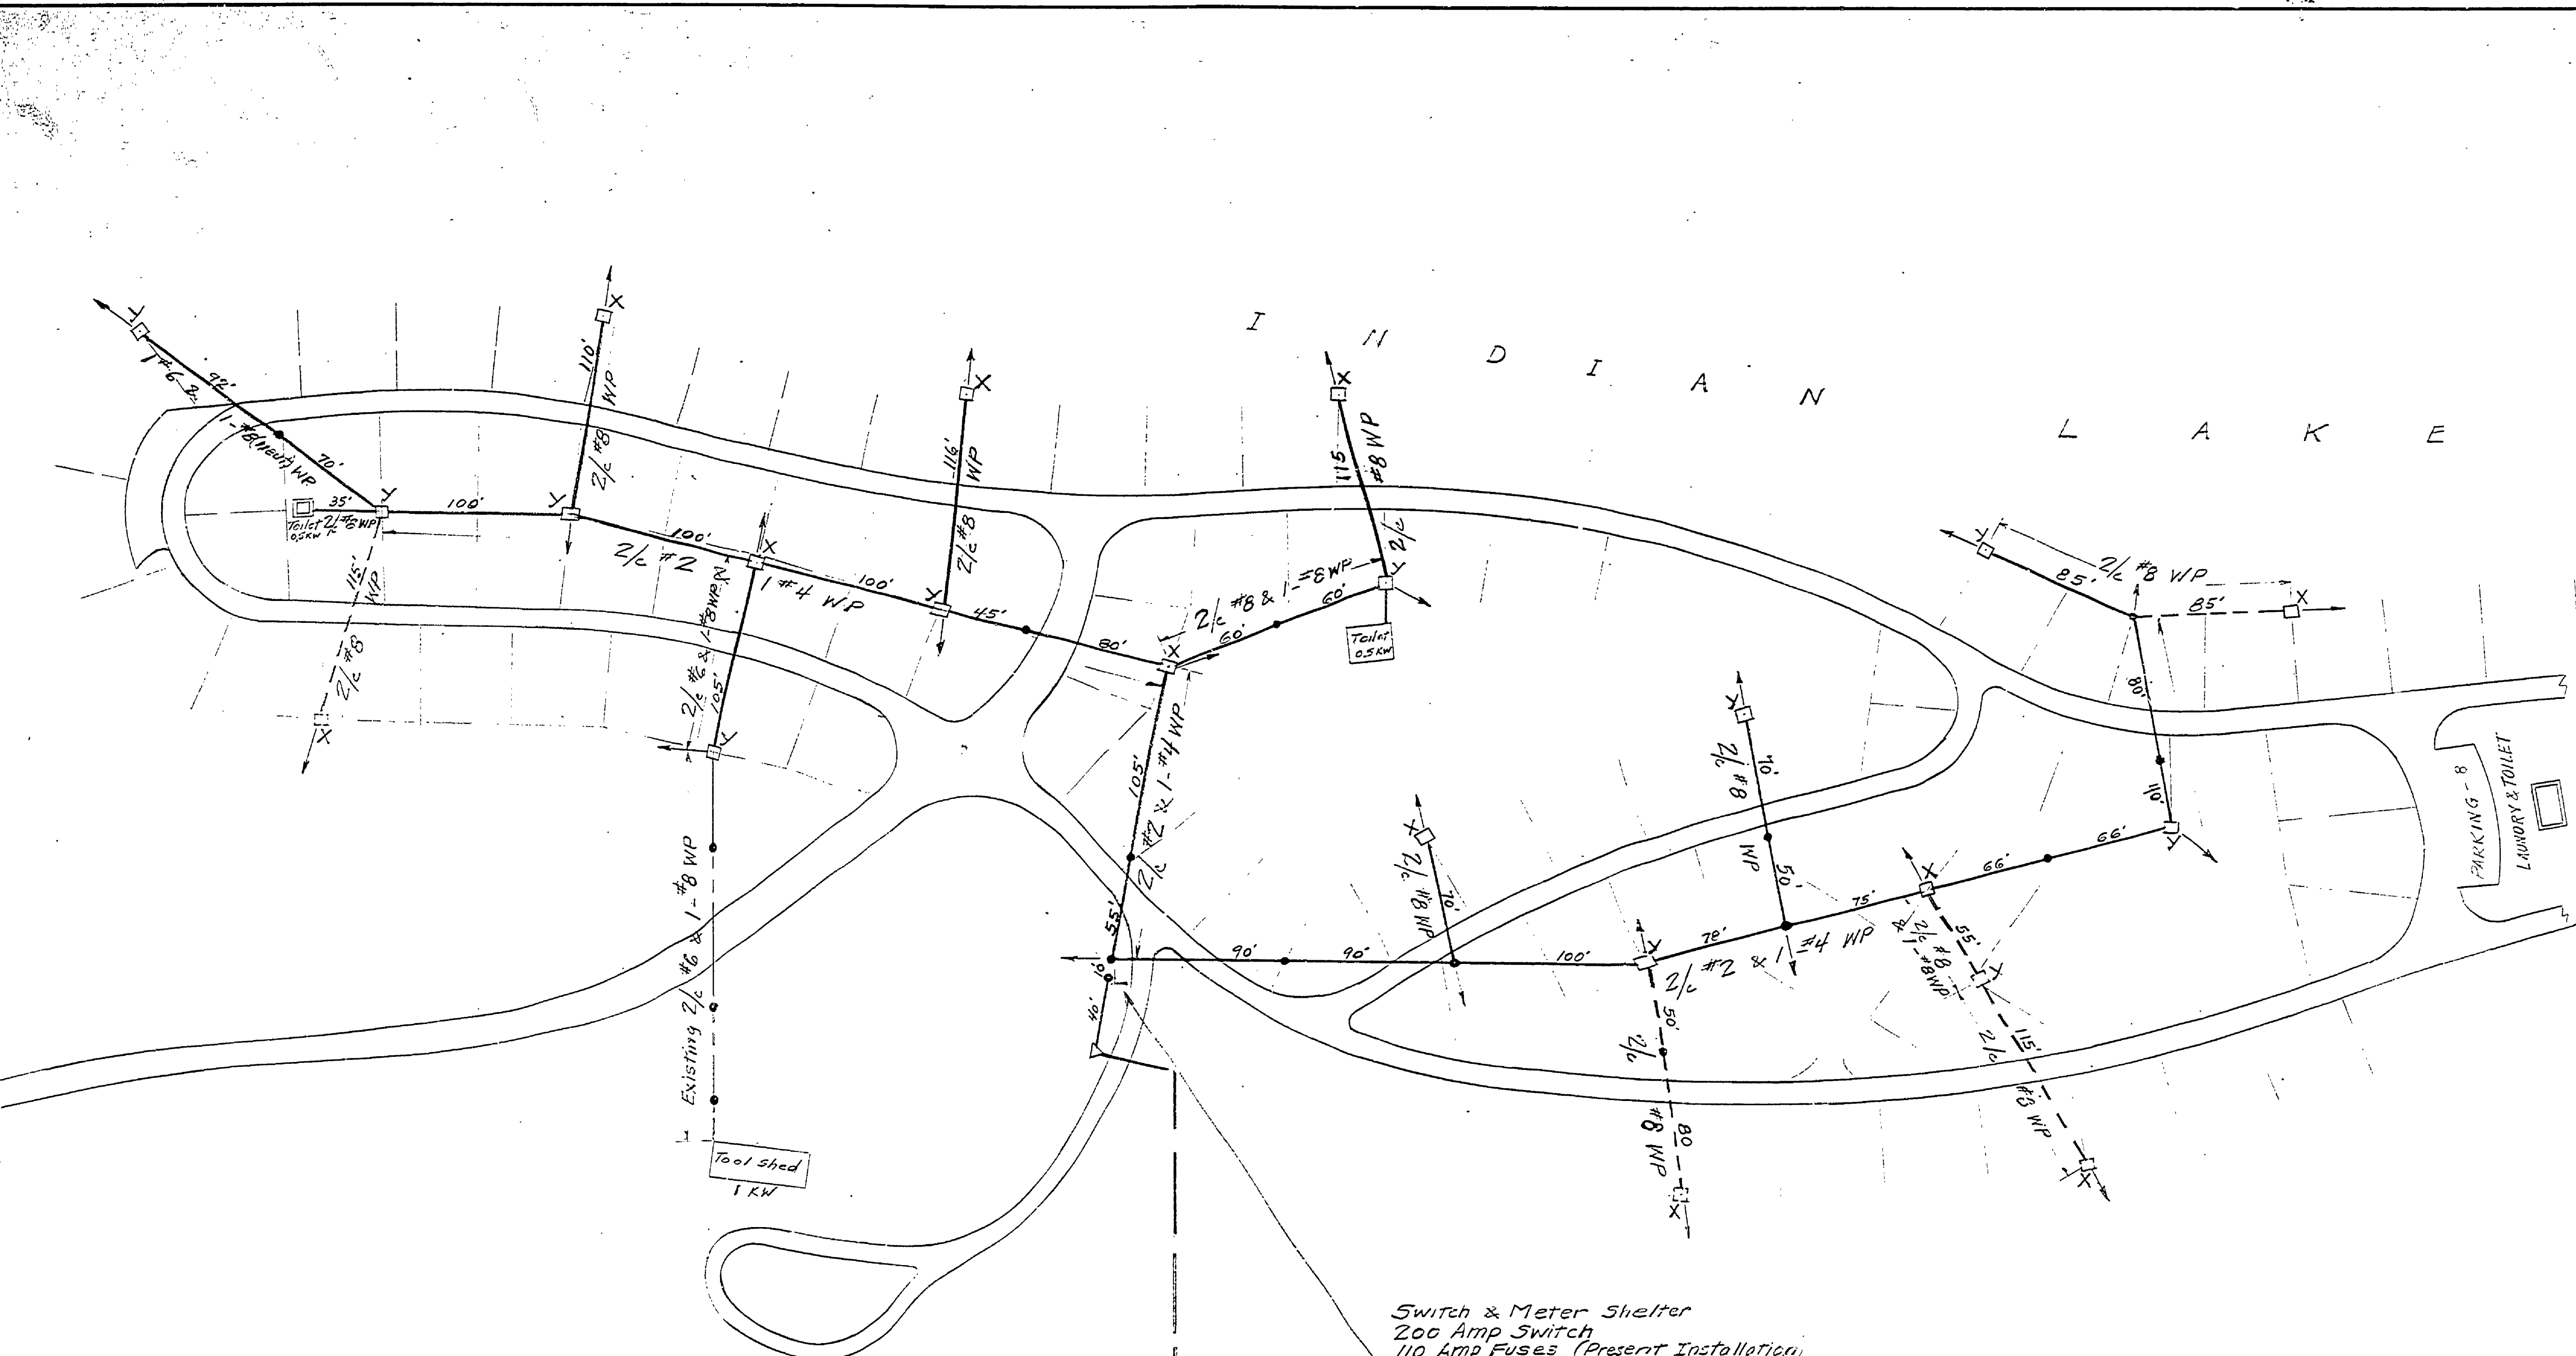

NOTE - Salvage materials in changing over present distribution system to use in proposed new system.
Use Heavy Service Secondary Racks 3 wire - 8" spacing on 2/c #2 & 1 #4 WP circuits. On all other circuits use 2 wire - 6" spacing at end poles and 3 wire - 6" spacing at intermediate poles.

KEY

	Trailer Outlet Service Line
	" " " (Future Installation)
	Trailer Outlet Service Box
	Pole
	Anchor Guy