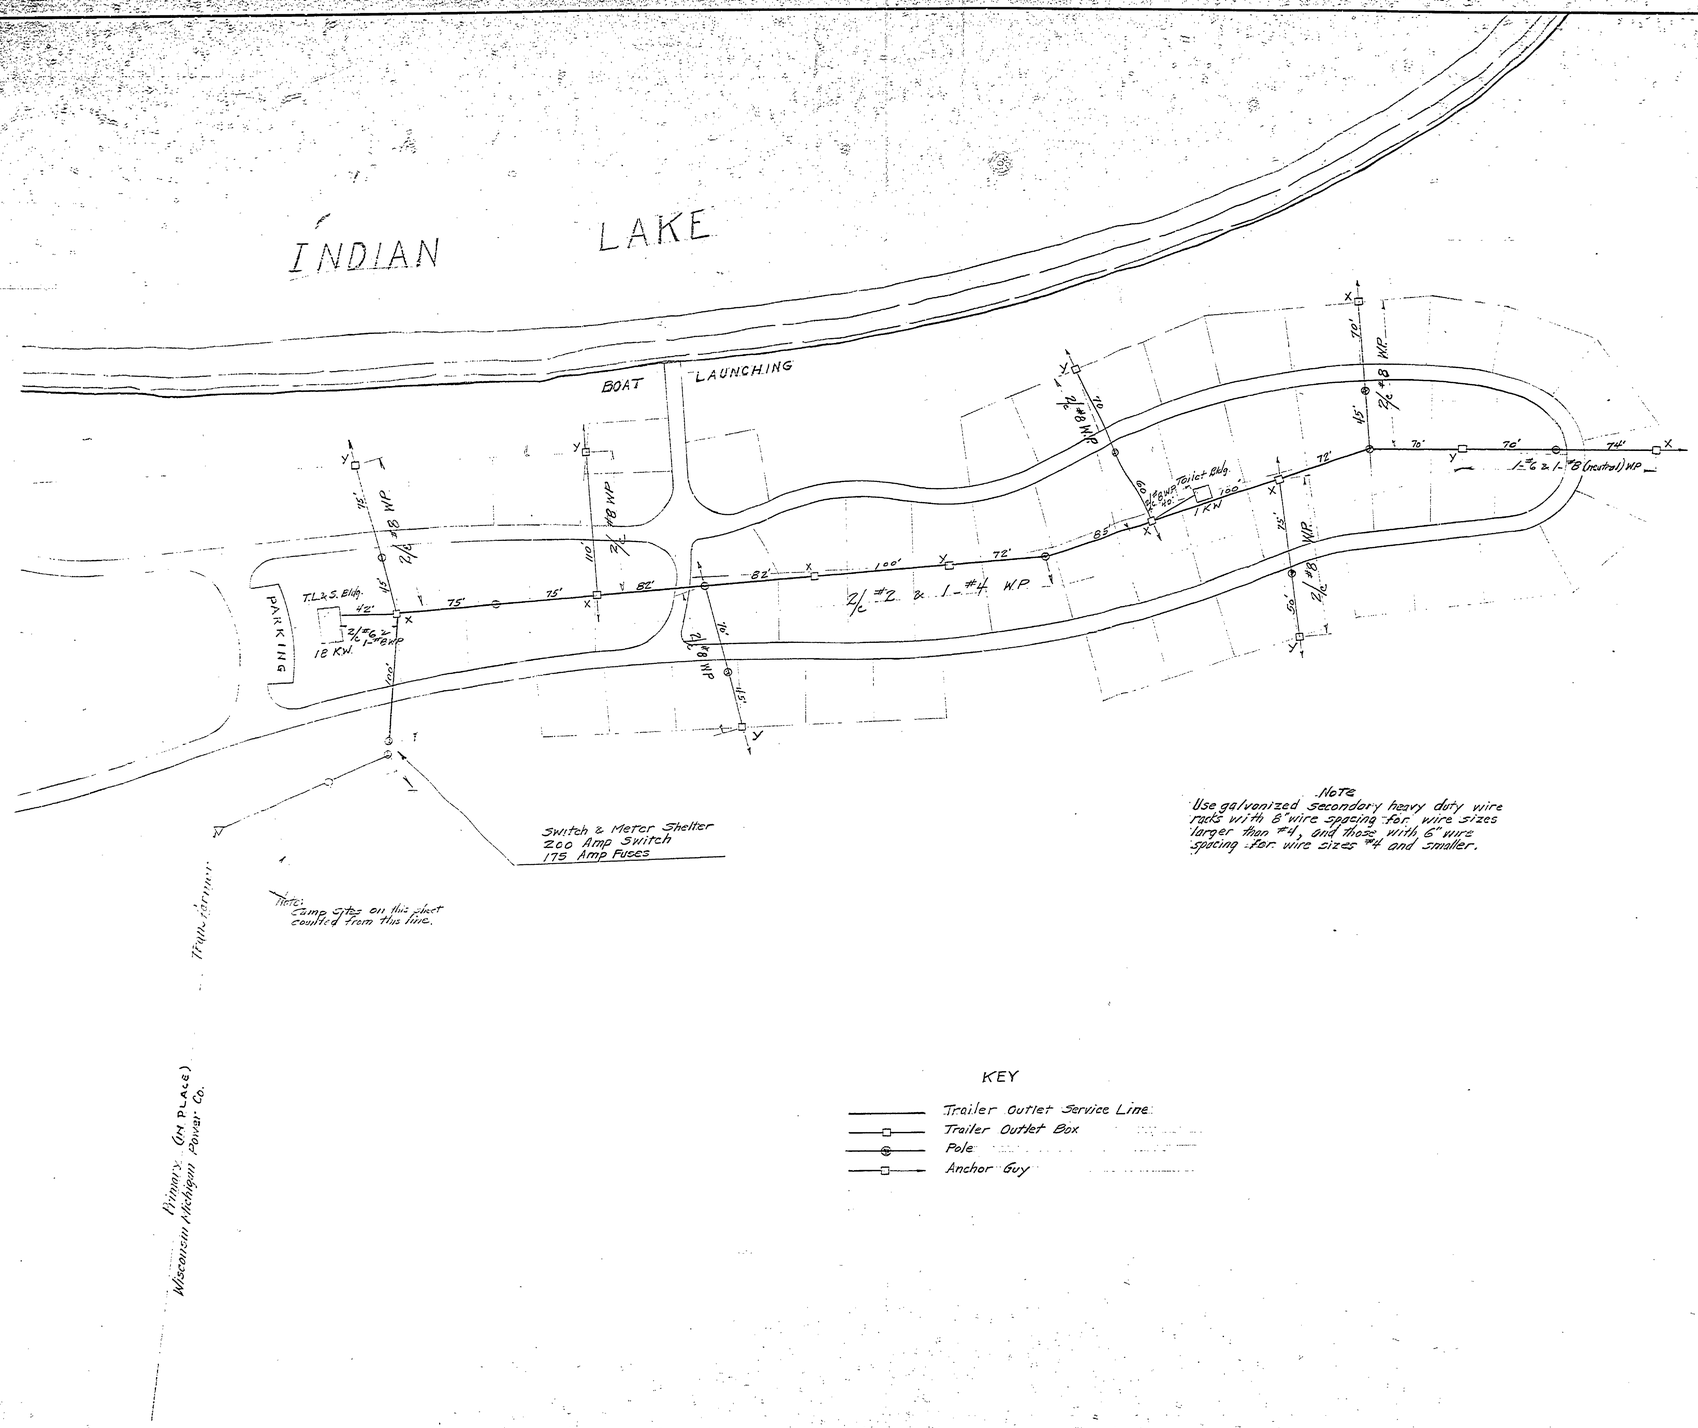

Note
Use galvanized secondary heavy duty wire racks with 8" wire spacing for wire sizes larger than #4, and those with 6" wire spacing for wire sizes #4 and smaller.

KEY

- Trailer Outlet Service Line
- Trailer Outlet Box
- Pole
- Anchor Guy

REVISIONS			
No.	DATE	BY	
1			
2			
3			
4			
5			
6			

APPROVED BY	DATE
ASSISTANT CHIEF IN CHARGE OF DESIGN	10-22-59
	10-22-59
	10-22-59

REVIEWED BY SECTIONS		
ARCHITECTURAL	J.T.R.	10-22-59
ENGINEERING	H.C.M.	22 Oct 59
LANDSCAPE	J.T.R.	10-22-59

DRAWN BY	CAK
TRACED BY	
CHECKED BY	
DATE	10/19/59

EAST CAMPGROUND

MICHIGAN
DEPARTMENT OF CONSERVATION
PARKS AND RECREATION DIVISION

INDIAN LAKE STATE PARK
CAMPGROUND ELECTRICAL DISTRIBUTION SYSTEM
Scale 1"=50'

SHEET NO. 1 OF 3

PLAN NO. E 115