




PLAN OF SEPTIC TANK
PAVILION-TOILET-LAUNDRY & SHOWER
SCALE 3/4"=1'-0"

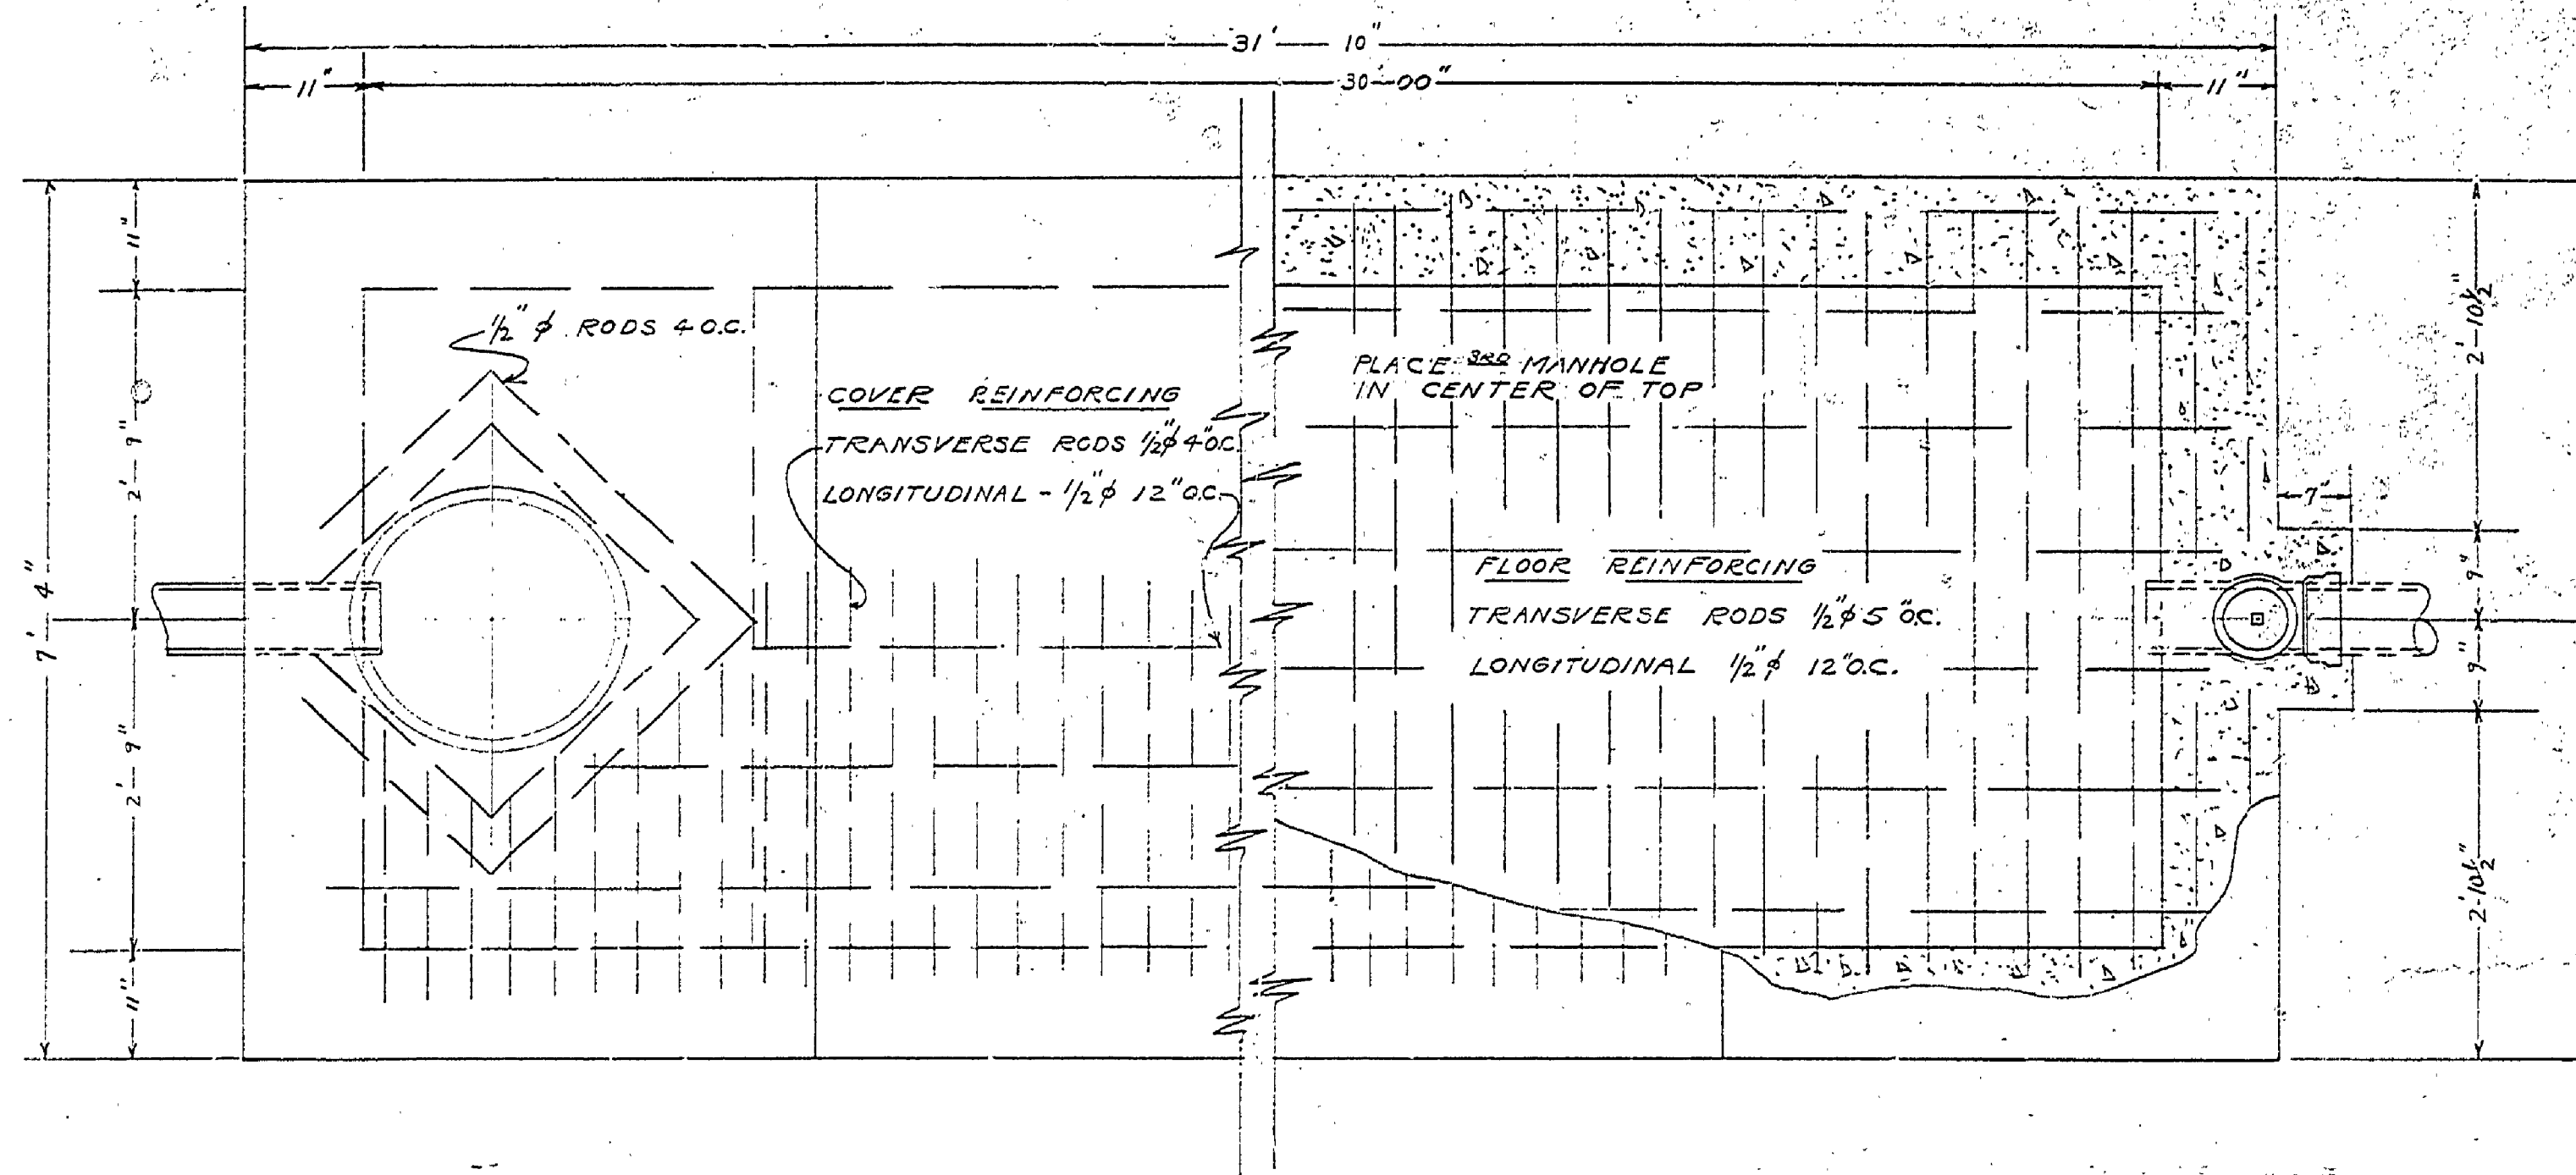

PLAN OF SEPTIC TANK
CAMP GROUND TOILET
SCALE 3/4"=1'-0"

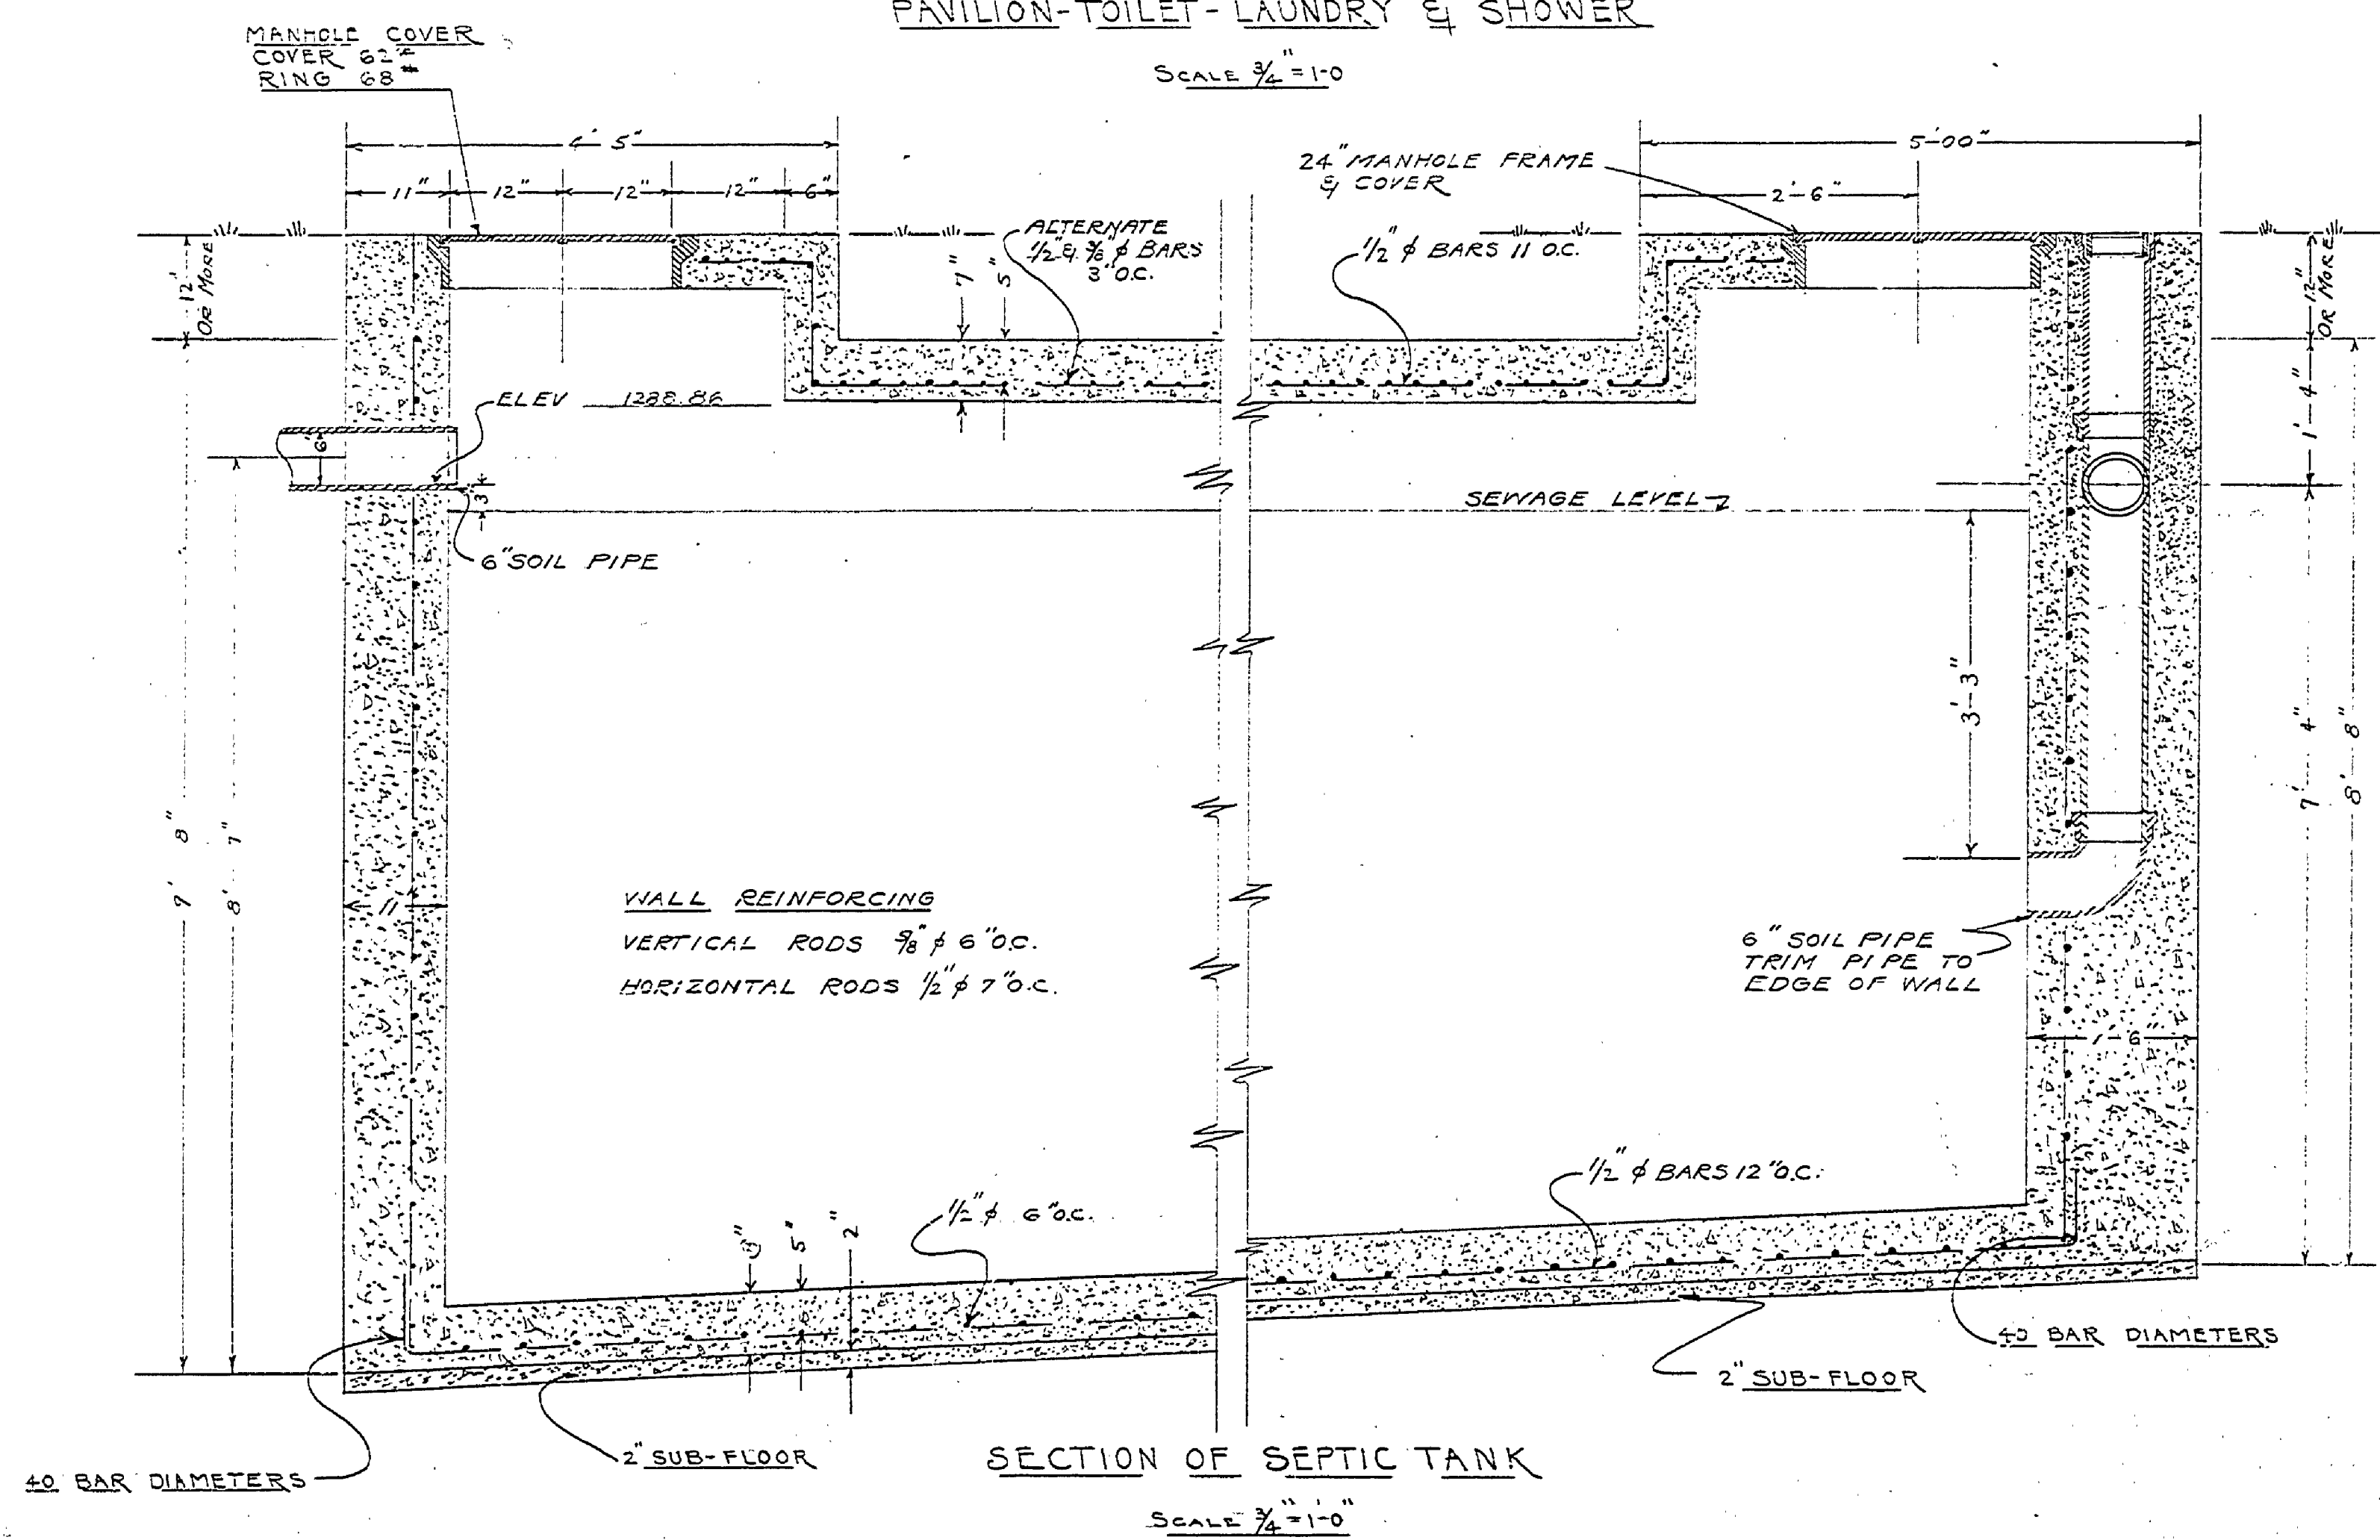

SECTION OF SEPTIC TANK
SCALE 1/4"=1'-0"

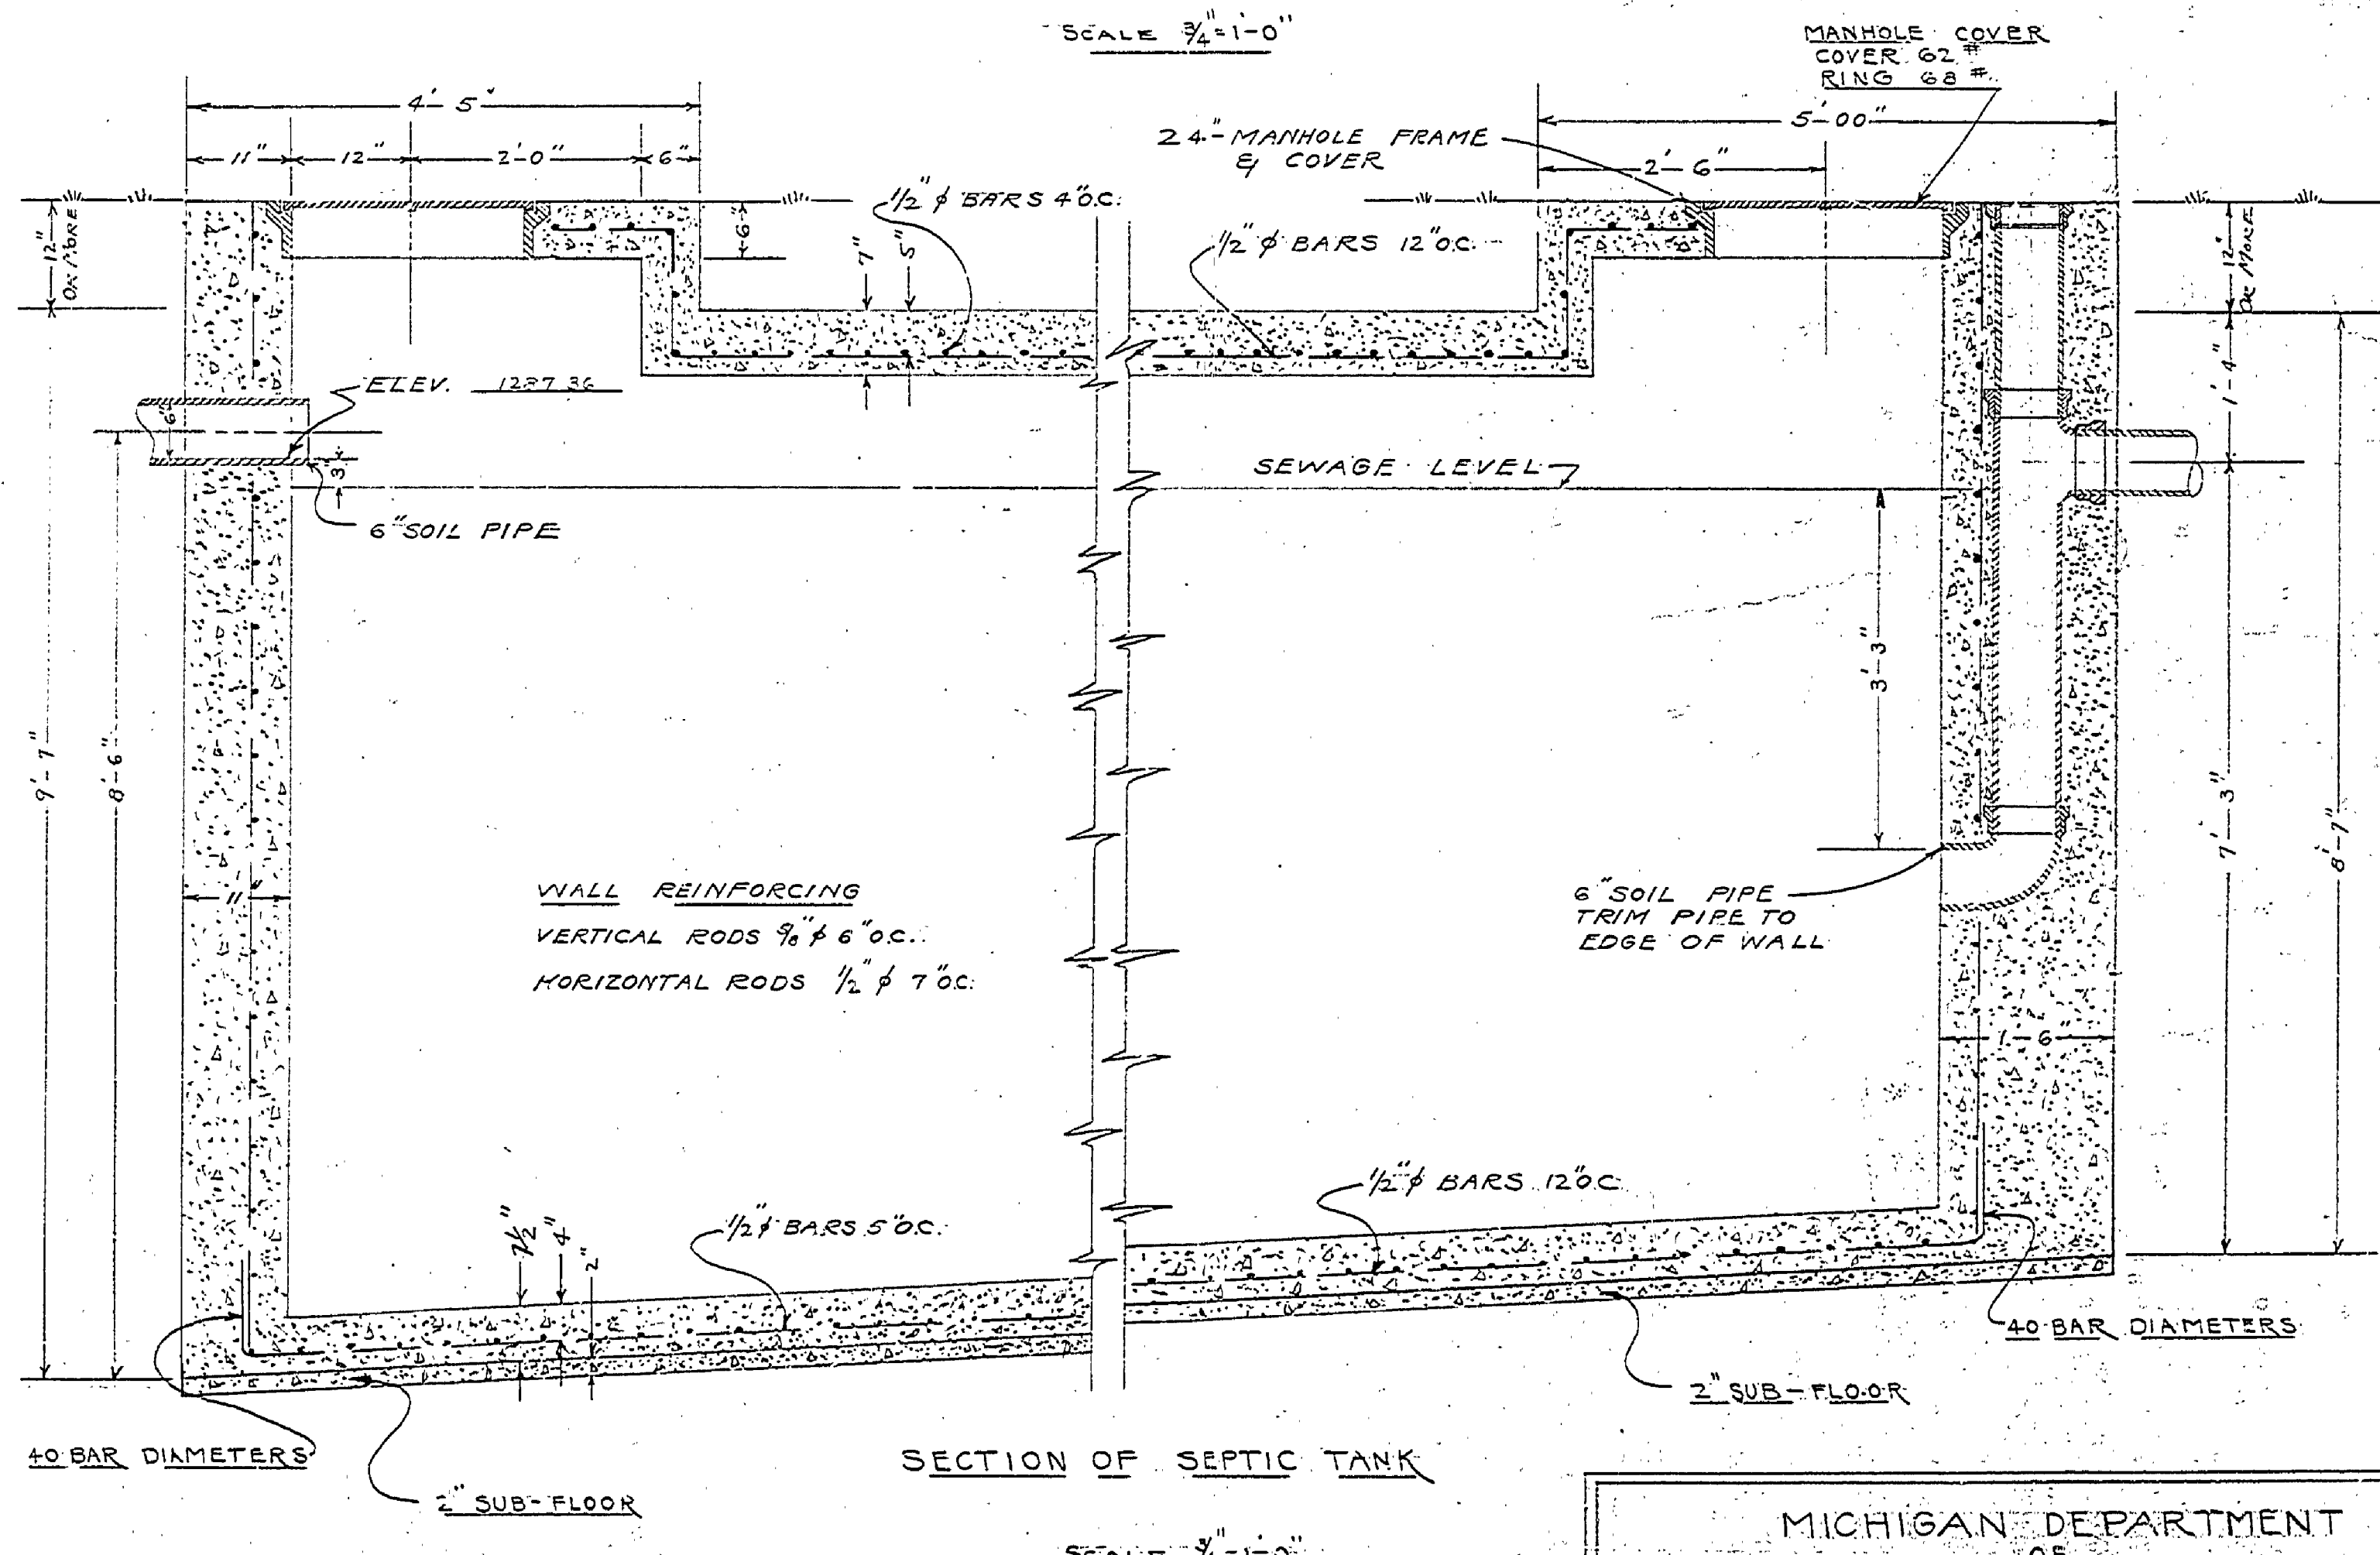

SECTION OF SEPTIC TANK
SCALE 1/4"=1'-0"

CONCRETE SPECIFICATIONS

The mix shall consist of 1 sack of cement, 2.81 cu. ft. of fine aggregate, 4.75 cu. ft. of coarse aggregate, and enough water to make a workable mix but not to exceed 6 gallons; or 1 sack of cement, 6.5 cu. ft. of bank run aggregate and enough water to make a workable mix but not to exceed 6 gallons. The aggregate shall be clean, free from clay balls, and shall all pass a 2" screen. The time of mixing shall be not less than 1 1/2 minutes. The concrete shall be placed in the forms in horizontal layers not over 2 feet thick and thoroughly spaded along the forms and around the reinforcing steel.

Note - To conform to U.S.G.S. Levels add 4.0' to elevations shown on plan. See Topo-plan-167-U.S.G.S. Bench Marks

REVISED
3-27-41

Michigan Department of Health
Bureau of Engineering
EXAMINED AND APPROVED
DEC 23 1940
John T. McPherson
DIRECTOR
CONSTRUCTION PERMIT No. 2074

MICHIGAN DEPARTMENT OF CONSERVATION
STATE PARKS DIVISION

DRAWN BY: G.S.	3 of 4
REVIEWED BY: H.C.M.	SCALE: AS SHOWN
CHECKED BY: DISPOSAL SYSTEM	DATE
PREPARED AND APPROVED BY: CHIEF OF STATE PARKS	DATE
APPROVED BY: SUPERVISOR	DATE

E-95