
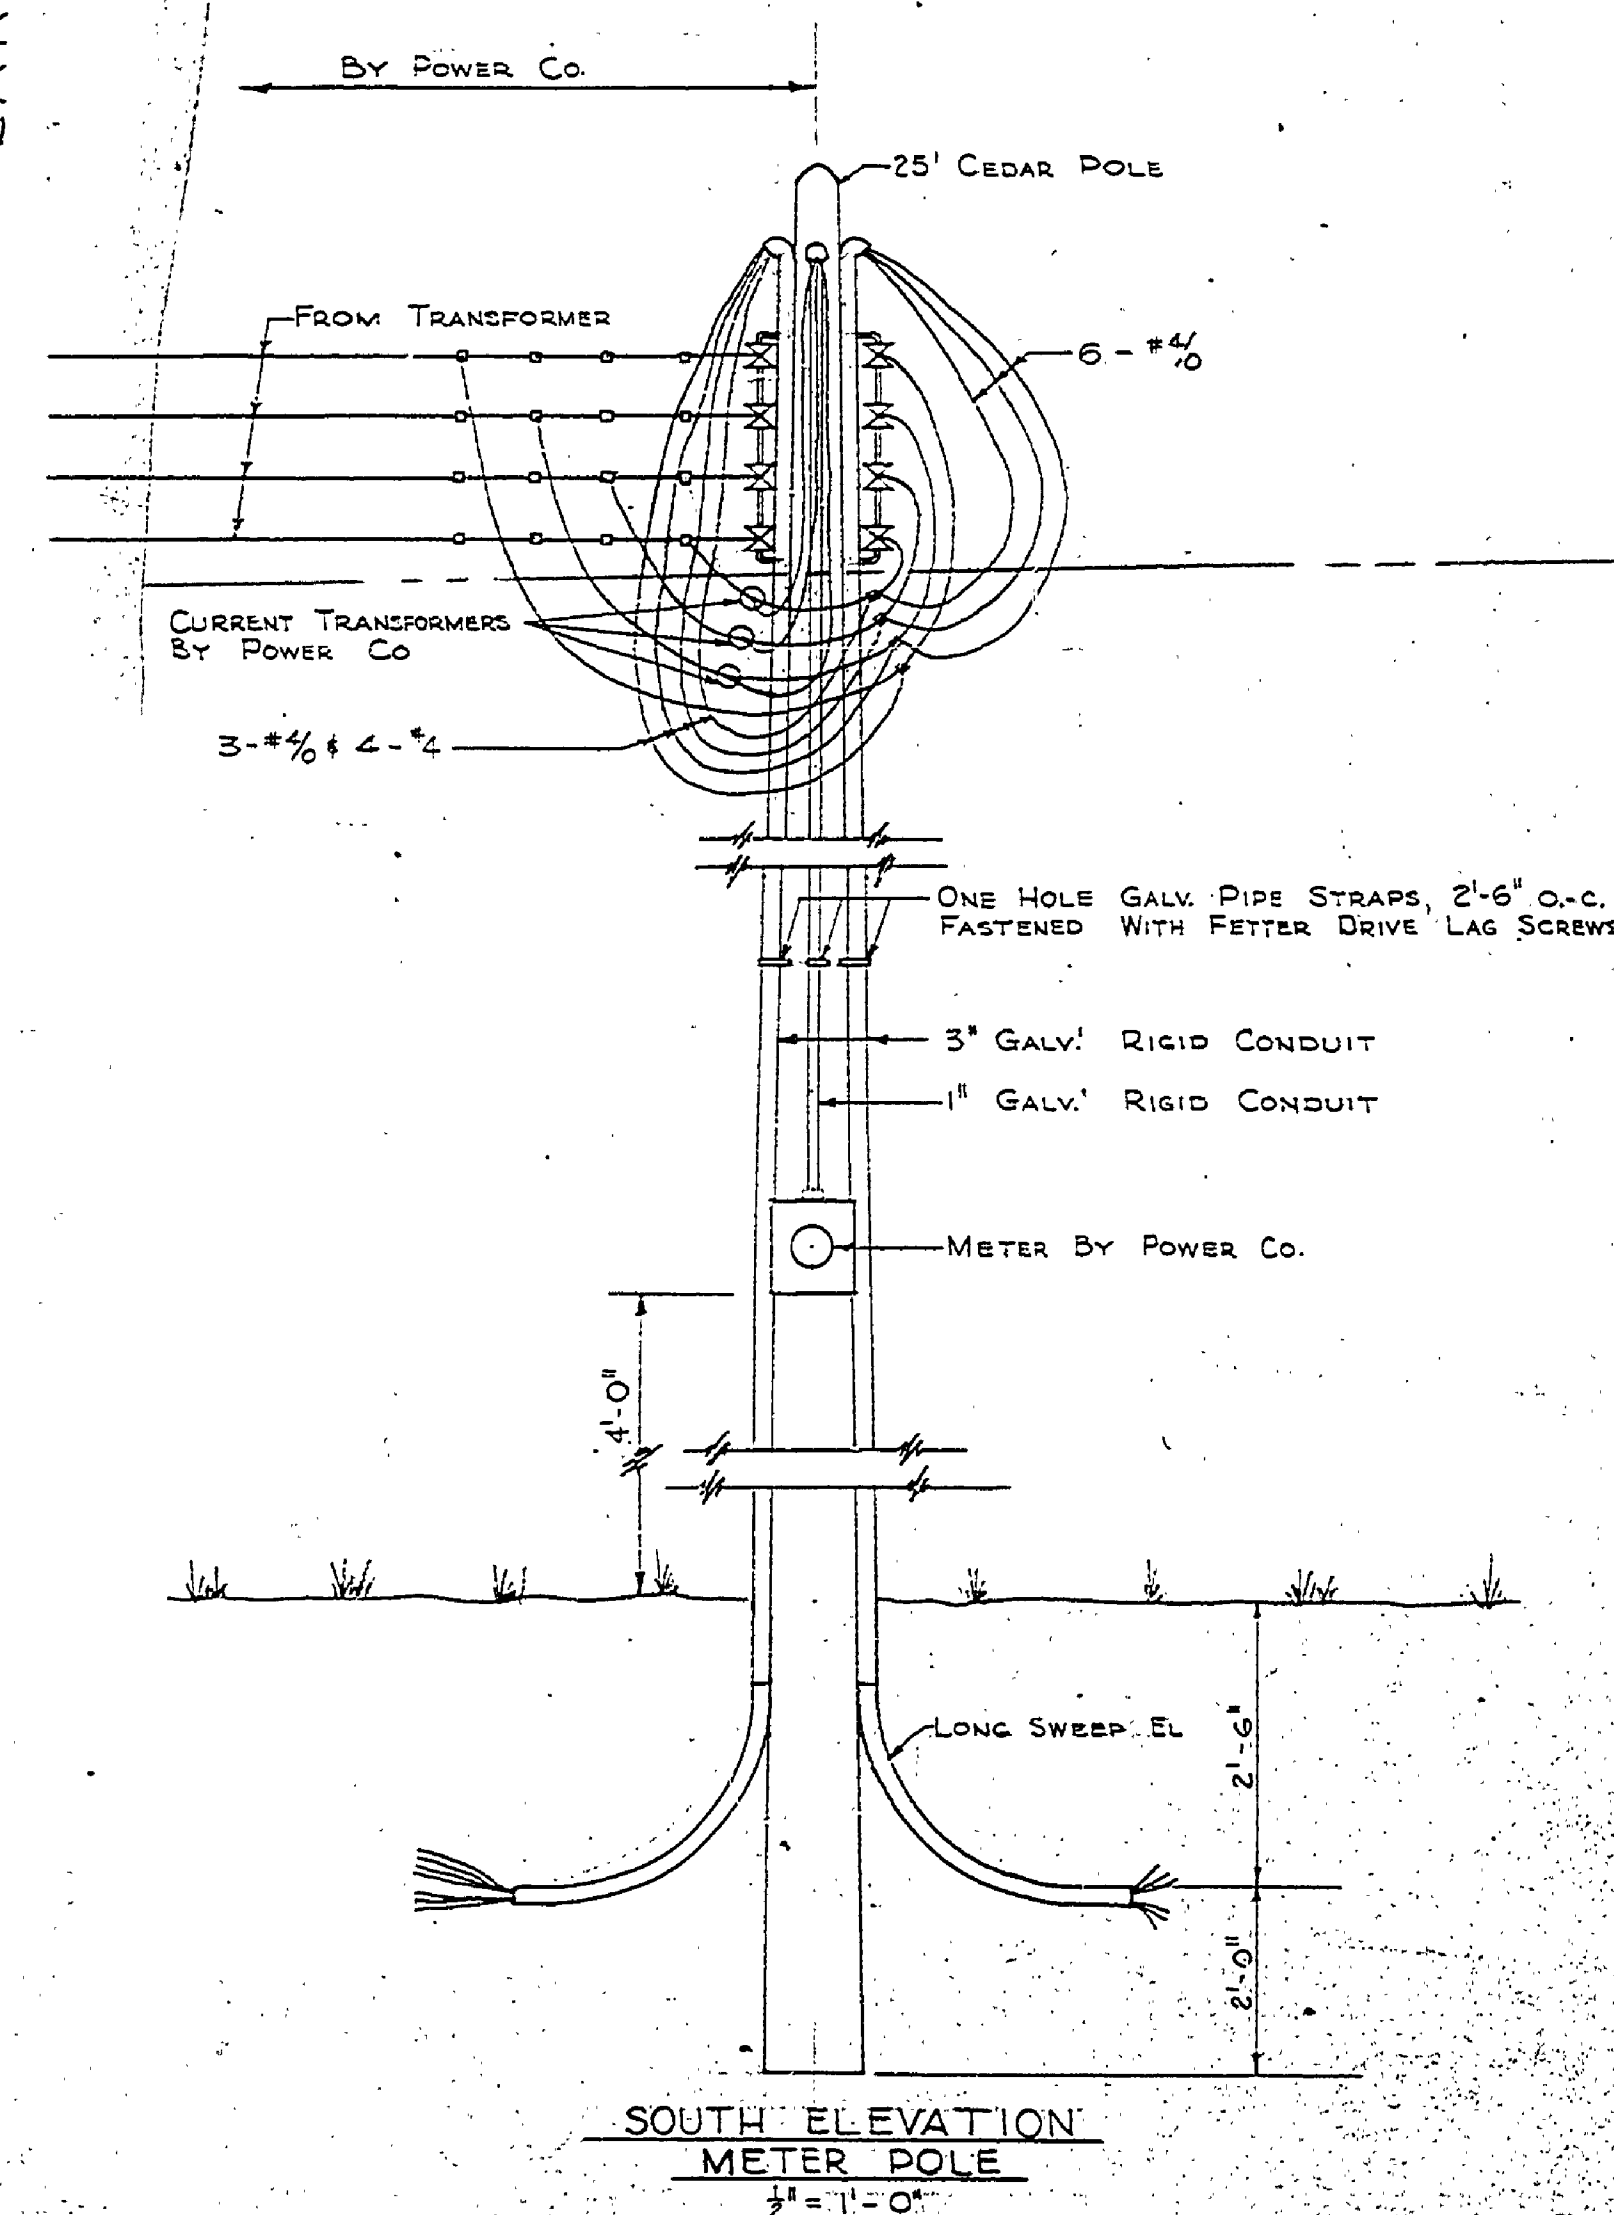
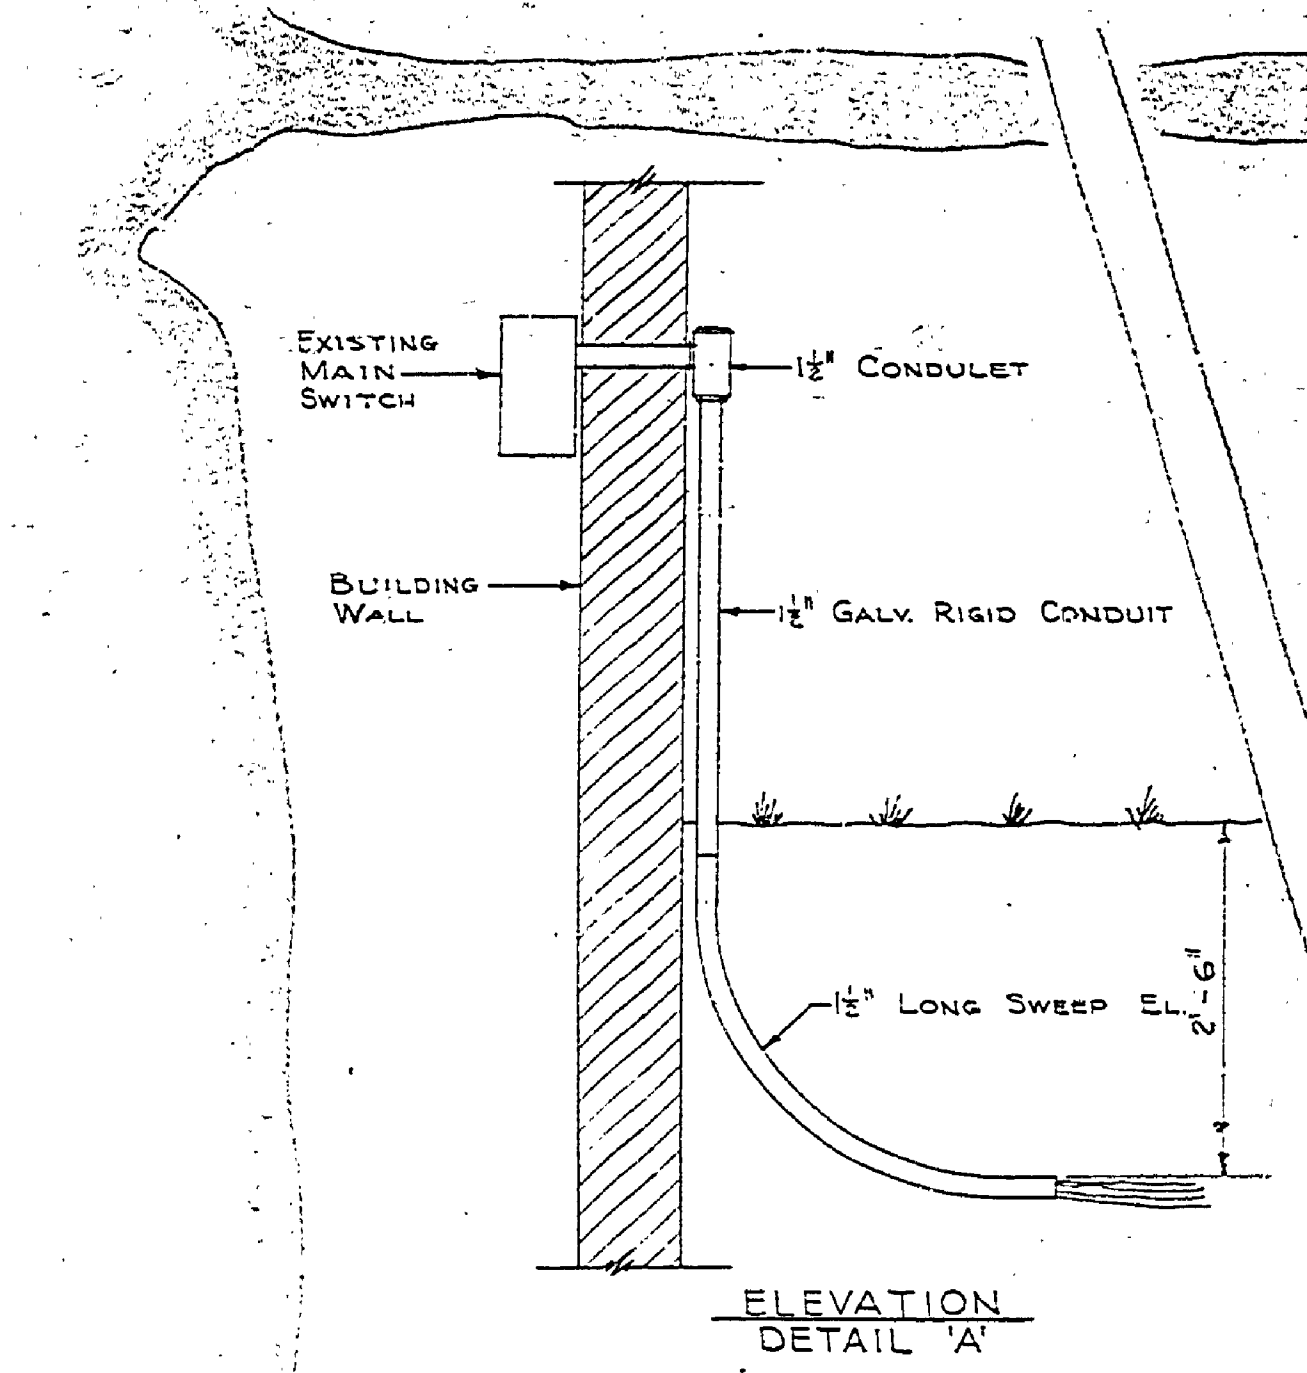


NO.	DATE	BY	REVISIONS
1	10-64	D.M.C.	THIS SHEET REPLACES E-102 SHEET (6-15-63) IS DESIGNED FOR 30 AMP SERVICE
2	10-64	D.M.C.	Revisions After Completion Cont.
3	1-21-64	Y.E.B.	
4	1-21-64	Y.E.B.	

DRAWN BY: S.H.G.-D.M.C. Nov. 63
 CHECKED BY: S.H.G. Dec. 63
 ENGINEERING: Y.E.B.
 LANDSCAPE: Y.E.B.

LAKE MITCHEL

LAKE CADILLAC

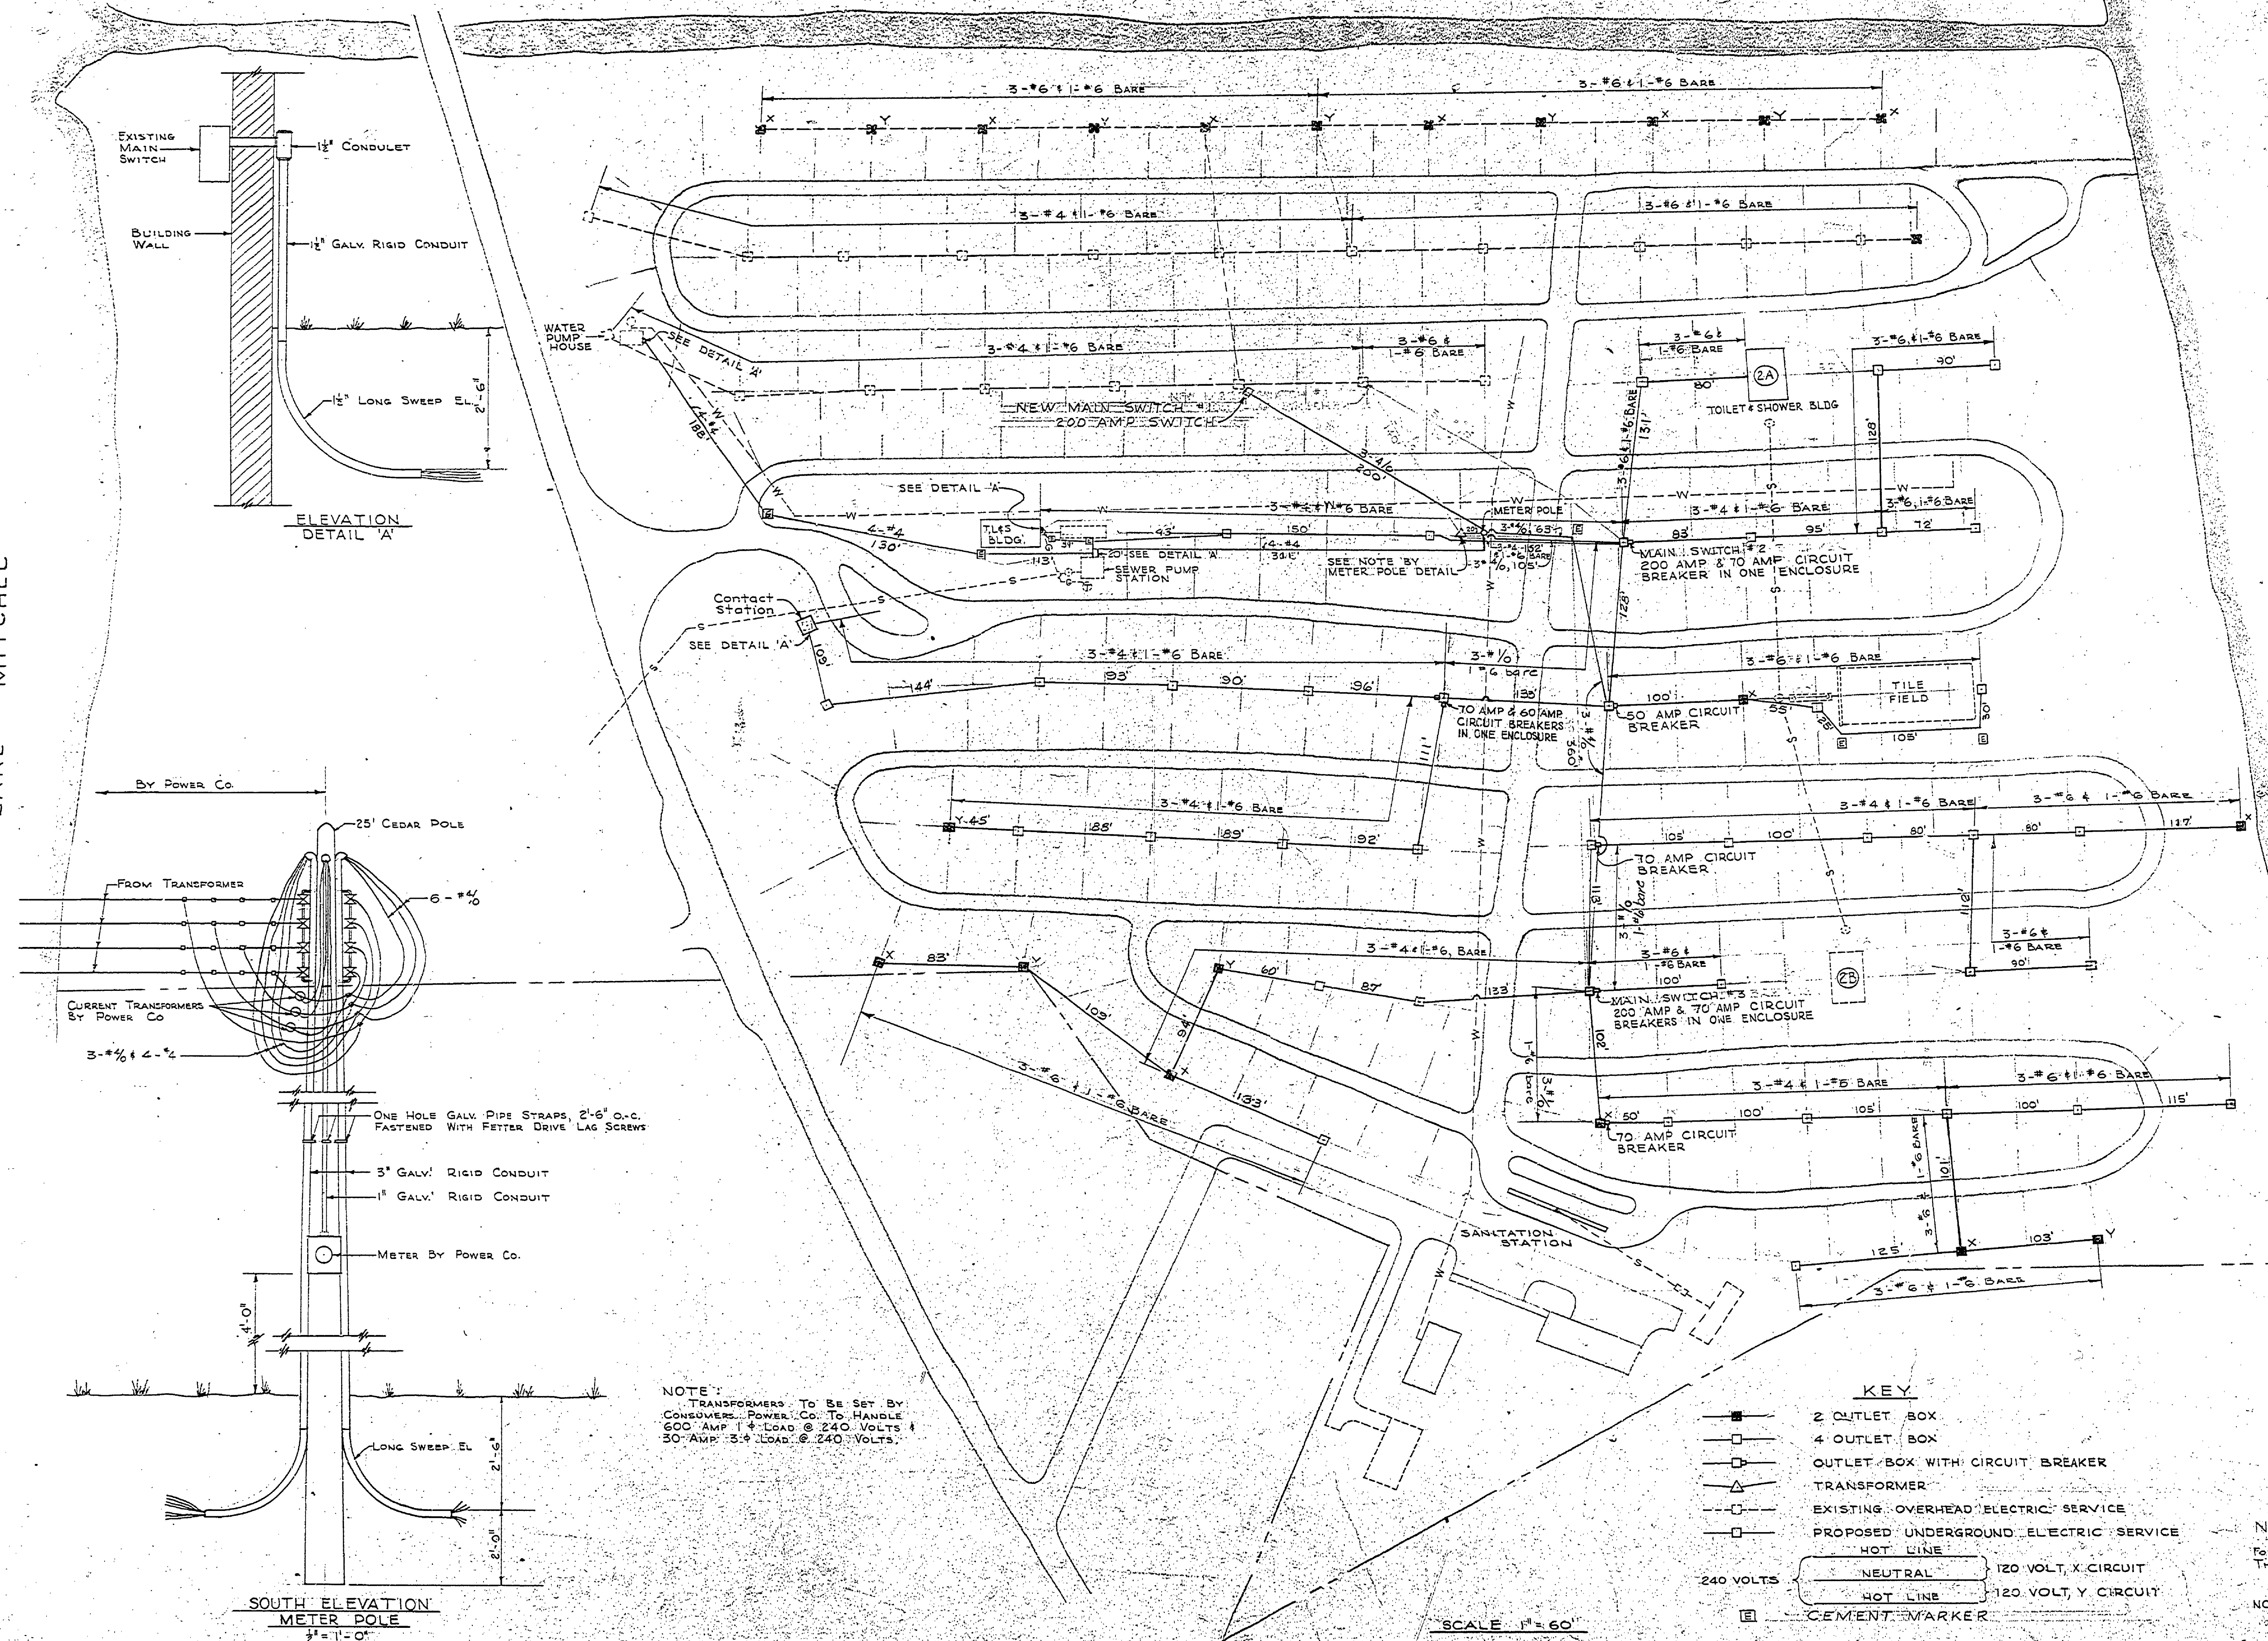

NOTE:
 TRANSFORMERS TO BE SET BY CONSUMERS. POWER CO. TO HANDLE 600 AMP 1-# LOAD @ 240 VOLTS & 30 AMP 3-# LOAD @ 240 VOLTS.

- KEY**
- 2 OUTLET BOX
 - 4 OUTLET BOX
 - OUTLET BOX WITH CIRCUIT BREAKER
 - TRANSFORMER
 - EXISTING OVERHEAD ELECTRIC SERVICE
 - PROPOSED UNDERGROUND ELECTRIC SERVICE
 - HOT LINE
 - 240 VOLTS NEUTRAL 120 VOLT, X CIRCUIT
 - HOT LINE 120 VOLT, Y CIRCUIT
 - CEMENT MARKER

NOTE:
 SEE SHEET FOR NORTH SECTION FOR UNDERGROUND WIRING IN THAT SECTION.
 SHEET 3 IS PLAN SE-136-A

SCALE 1" = 60'