
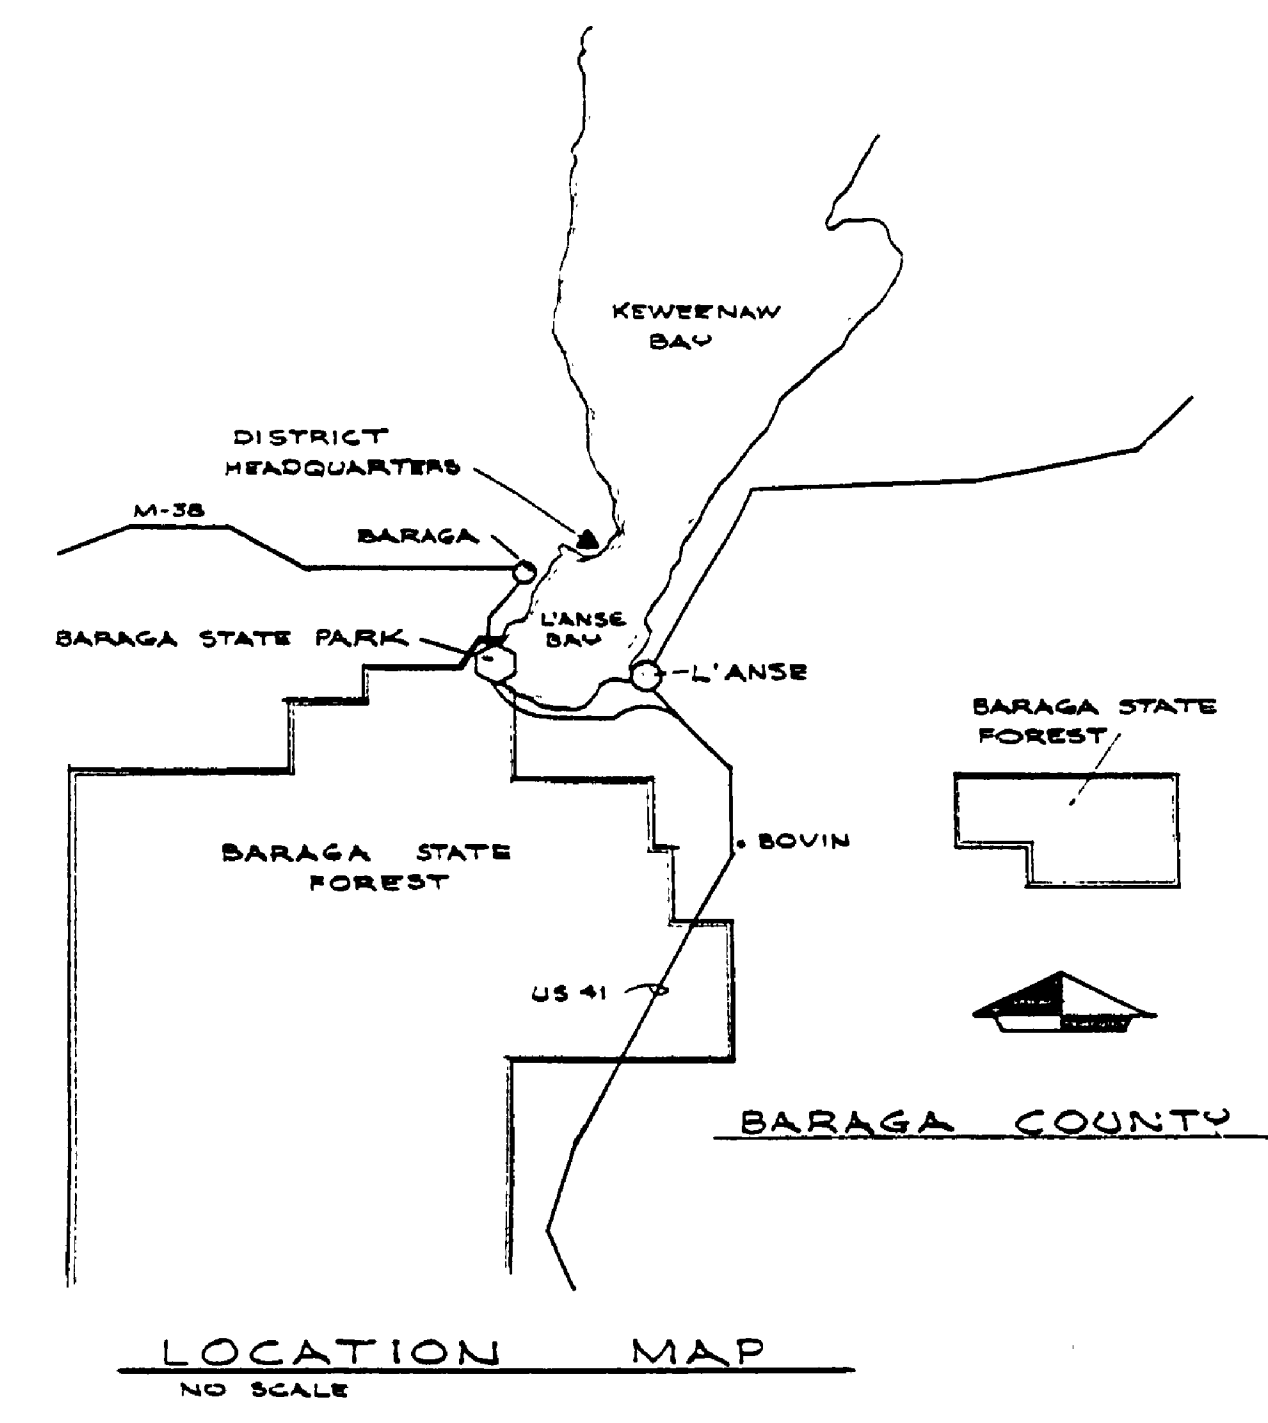


# BARAGA STATE PARK

## CONTACT STATION

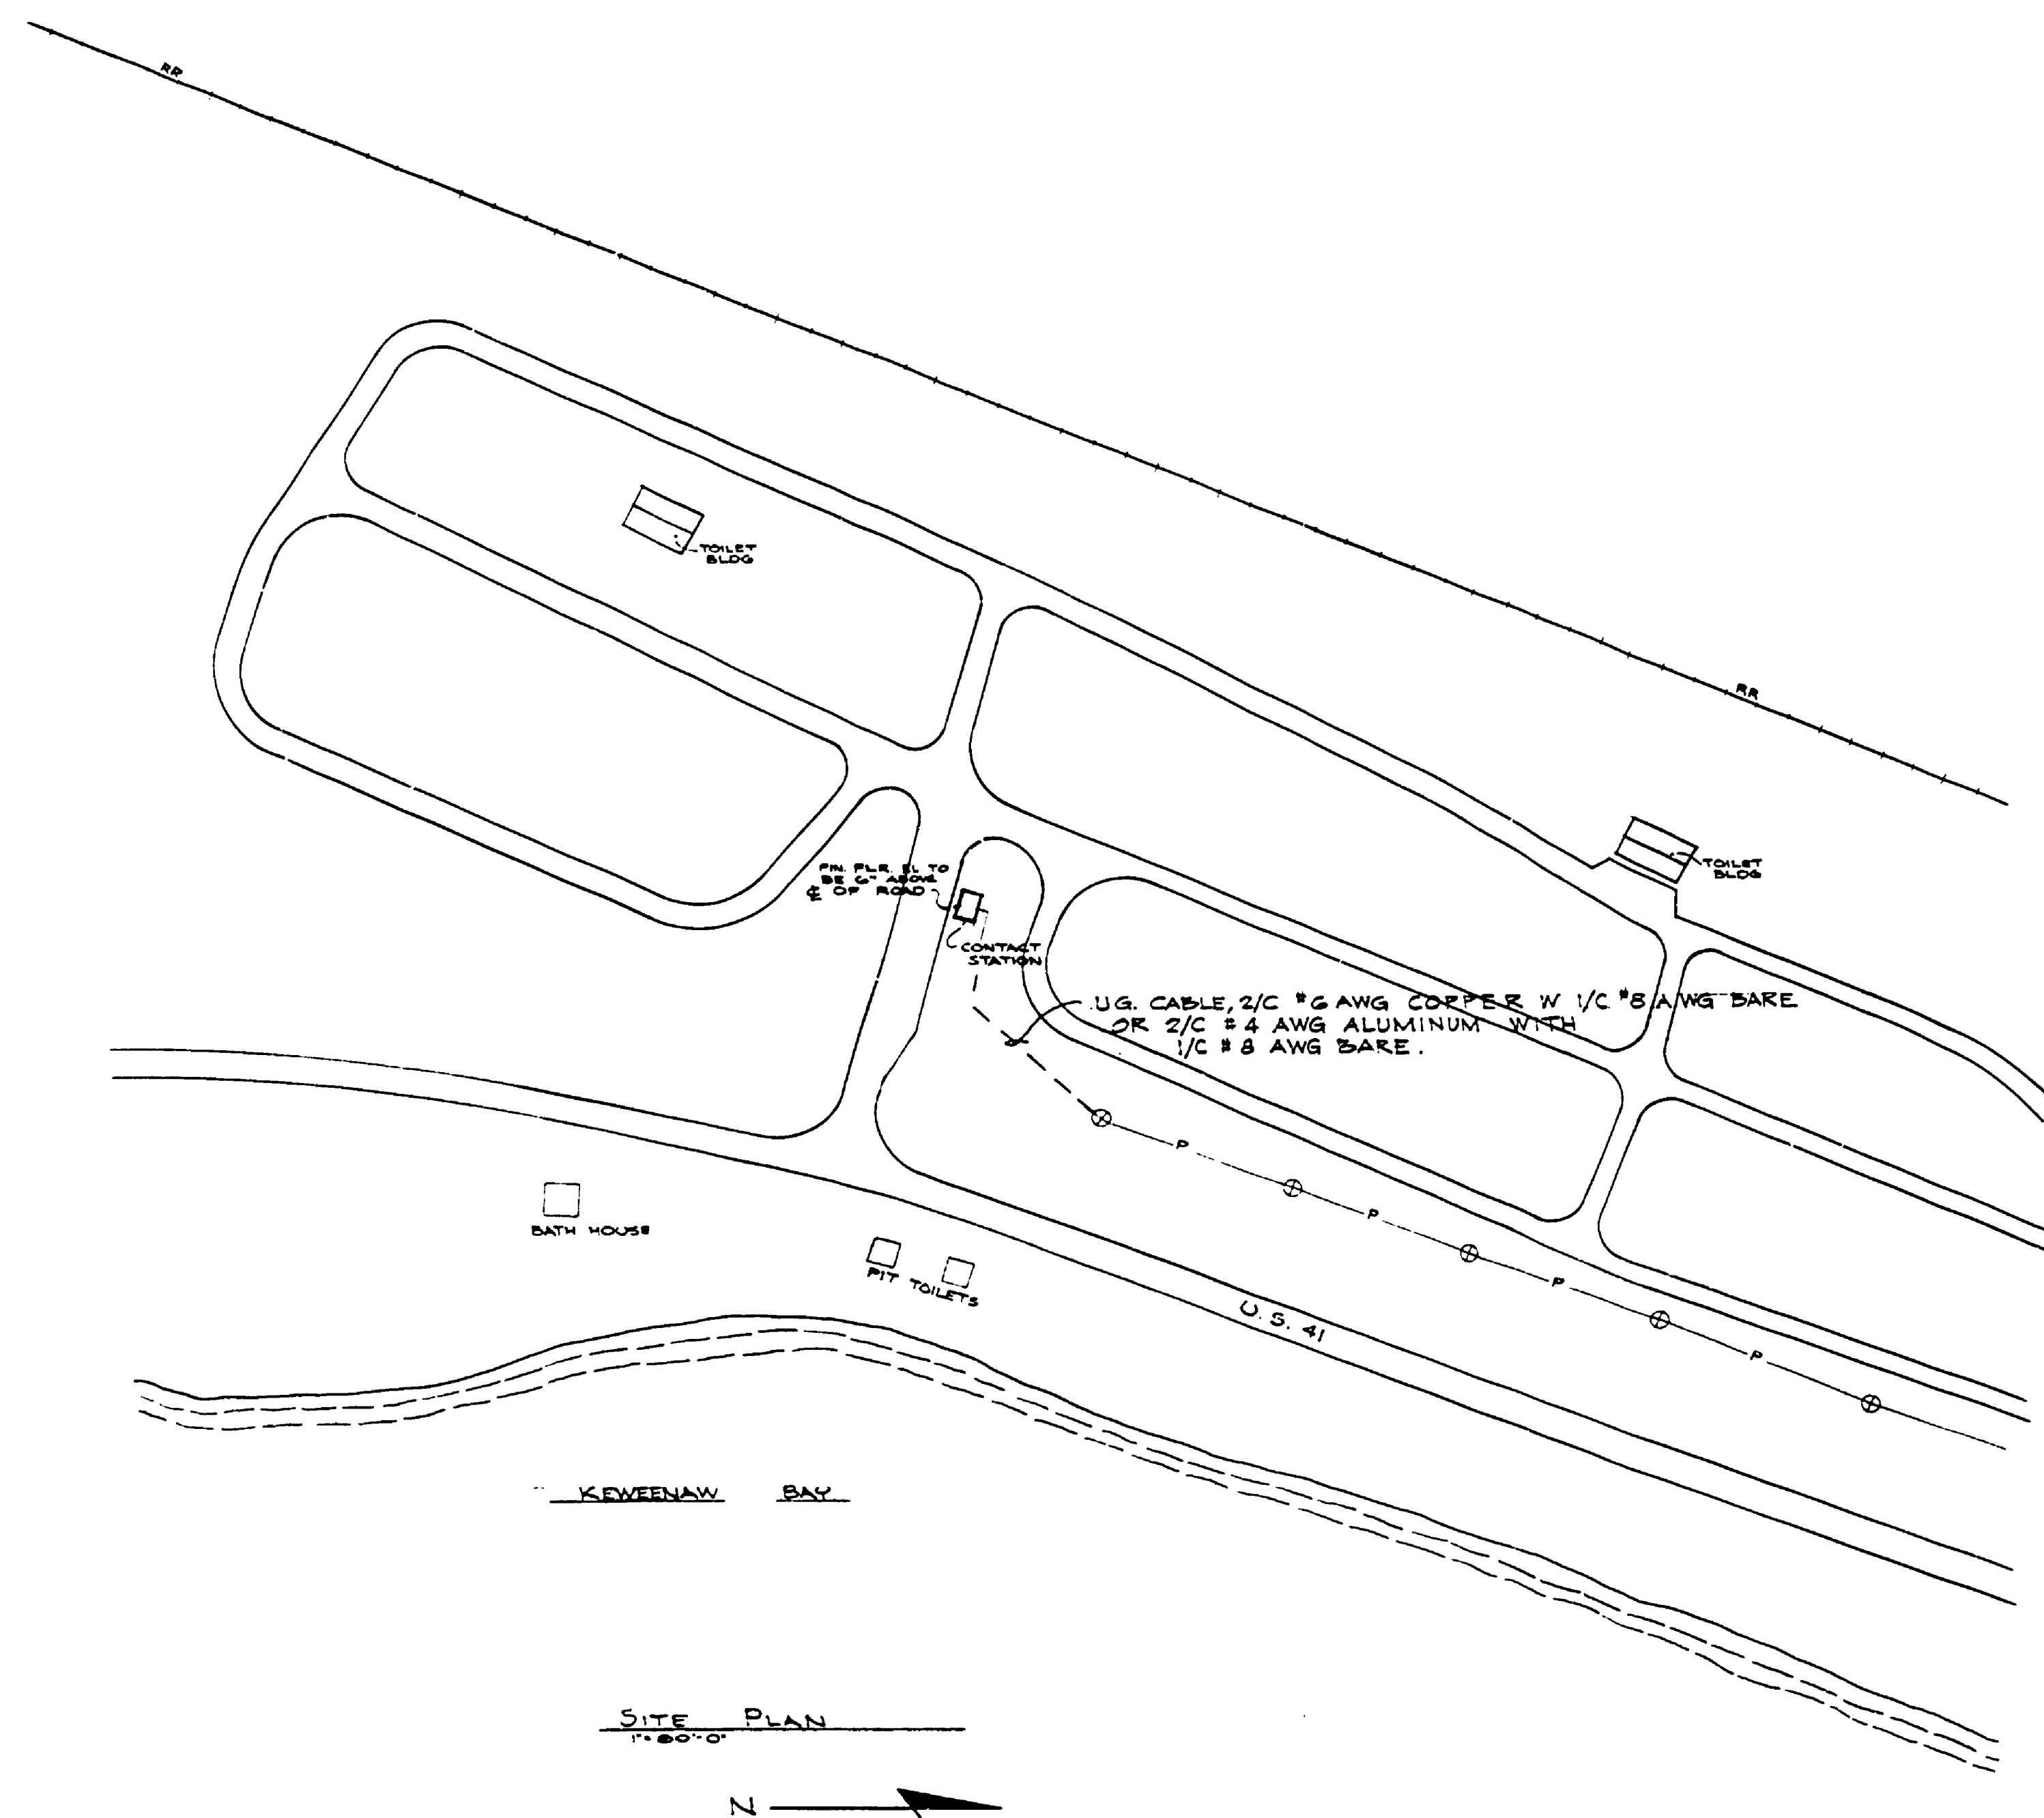

- NOTES:**
1. EXTEND 3RD WIRE ON OVERHEAD 3 WIRE LINE TO LAST POLE SOUTH NEAREST CONTACT STATION.
  2. TAP INTO OVERHEAD AT LAST POLE AND DROP DOWN POLE WITH SERVICE HEAD AND CONDUIT ATTACHED TO POLE. CONDUIT DROP TO BE EFFECTIVELY GROUNDED AT POLE.
  3. UNDERGROUND CABLE TO BE 75°C TEMP RATING.
  - 2/C #6 AWG COPPER OR 2/C #4 AWG ALUMINUM SUITABLE FOR DIRECT BURIAL WITH 1/C #8 AWG BARE COPPER NEUTRAL.
  4. MINIMUM BURY DEPTH TO BE 30 INCHES.

BUILDING COMMITTEE APPROVAL	
BY: _____	CHAIRMAN
DATE: _____	DATE
RECOMMENDED FOR APPROVAL: <i>WJL</i> - 2/14/75	
<small>ENGINEERING OR ARCHITECTURAL SUPERVISOR DATE</small>	
RECOMMENDED FOR APPROVAL: _____	
<small>PROGRAM AND PLAN COORDINATOR DATE</small>	
DIVISION/REGION APPROVAL	
BY: <i>WJL</i> - 2/14/75	DATE
<small>ENGINEERING DIVISION</small>	
APPROVED: <i>William C. Park</i> 2/14/75	DATE
<small>CIVIL ENGINEER</small>	

SURVEYED BY	DRAWN BY <i>S. ENGEL</i>	NO. <i>2/1/75</i>	DATE	BY	REVISIONS	NO.	DATE	BY	REVISIONS	MICHIGAN DEPARTMENT OF NATURAL RESOURCES	TITLE SHEET & SITE PLAN SHEET TITLE	BARAGA STATE PARK AREA OR PARK CONTACT STATION PROJECT	PROJECT NO. 24-1587 SHEET 1 OF 2 PLAN NO. A-104
DESIGNED BY	CHECKED BY	DATE	DATE	DATE	DATE	DATE	DATE	DATE	DATE				