COMMERCIAL BLUEPRINT SERVICE 696 4-63

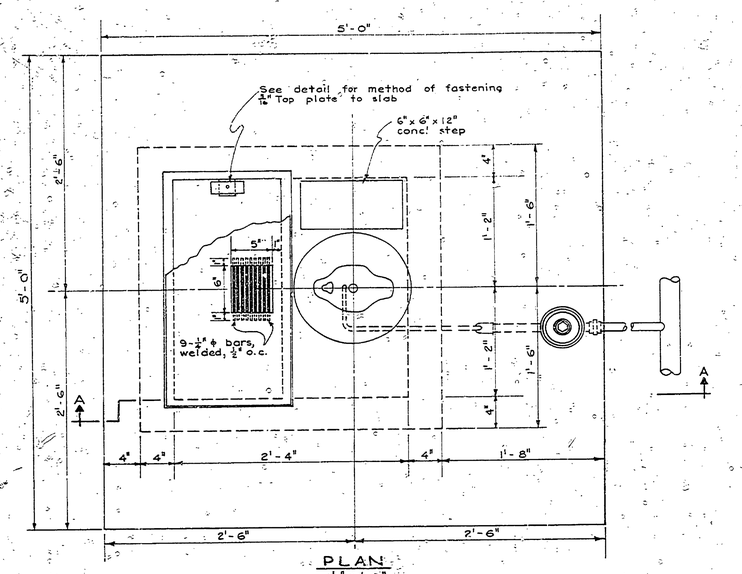

PLAN
1 1/2" = 1'-0"

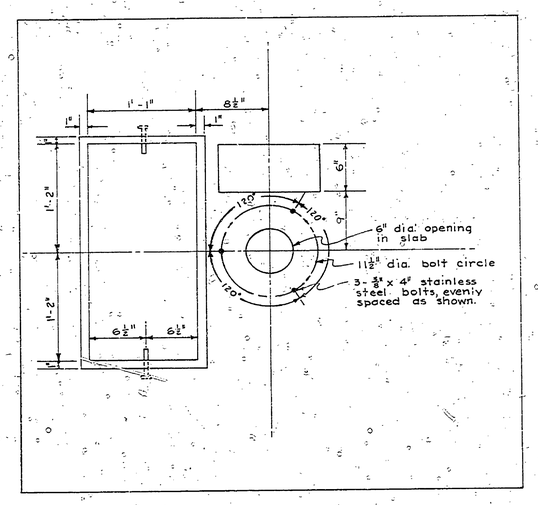

PLAN OF CONCRETE SLAB
1 1/2" = 1'-0"

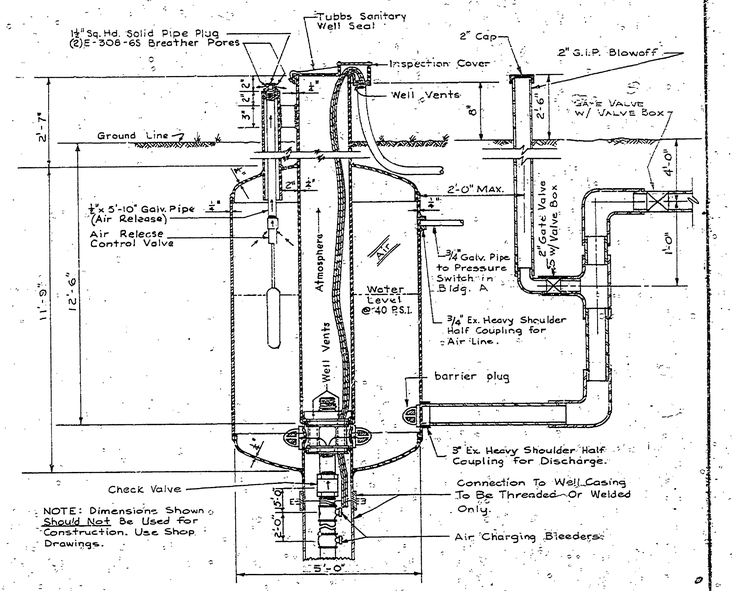

NOTE: Dimensions Shown Should Not Be Used for Construction. Use Shop Drawings.

1500 GALLON
PITLESS ADAPTER TANK
No. Scale

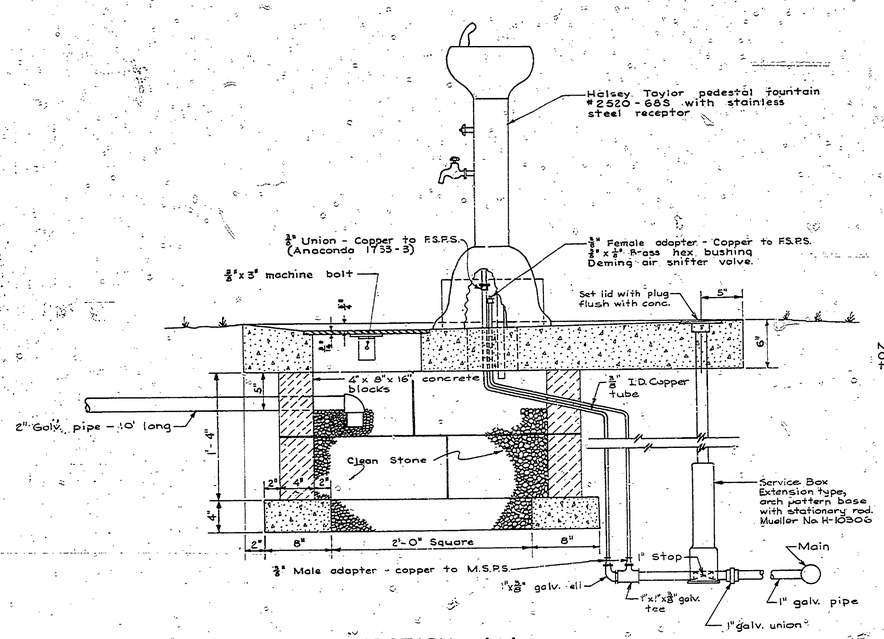

NOTE: Shut-off valve in service box. Open faucet on fountain and pump air through snifter valve for winter shut down.

SECTION A-A
1 1/2" = 1'-0"

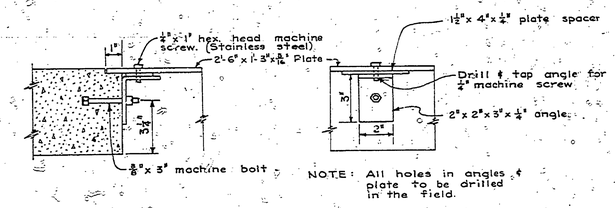

NOTE: All holes in angles & plate to be drilled in the field.

DETAIL FOR FASTENING GRATING TO CONCRETE SLAB
3" = 1'-0"

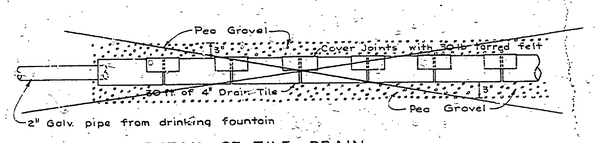

DETAIL OF TILE DRAIN

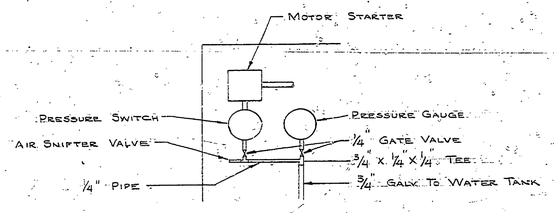

PUMP CONTROL DETAIL
IN TOILET BUILDING A

SURVEYED BY		DRAWN BY COTE	Sept. '65	NO.	DATE	BY	REVISIONS	NO.	DATE	BY	REVISIONS	MICHIGAN DEPARTMENT OF CONSERVATION	DRINKING FOUNTAIN PLAN & PITLESS ADAPTER TANK
DESIGNED BY BARKER	Oct. '61	CHECKED BY W.H.E.	9-65	1.	6-69	H.L.R.	Extension Type Service Box in Slab	3.					
	DATE		DATE	2.	8-69	JHH	Tank Connection to Casing	4.					

SHEET NO. ____ OF ____
FOR PROJECT NO. 24-1204

CLEAR LAKE STATE PARK
SHEET 3 OF 4 | PLAN NO. E-100