

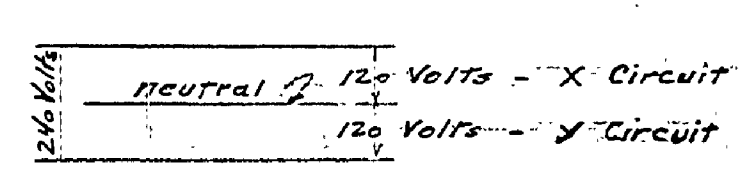
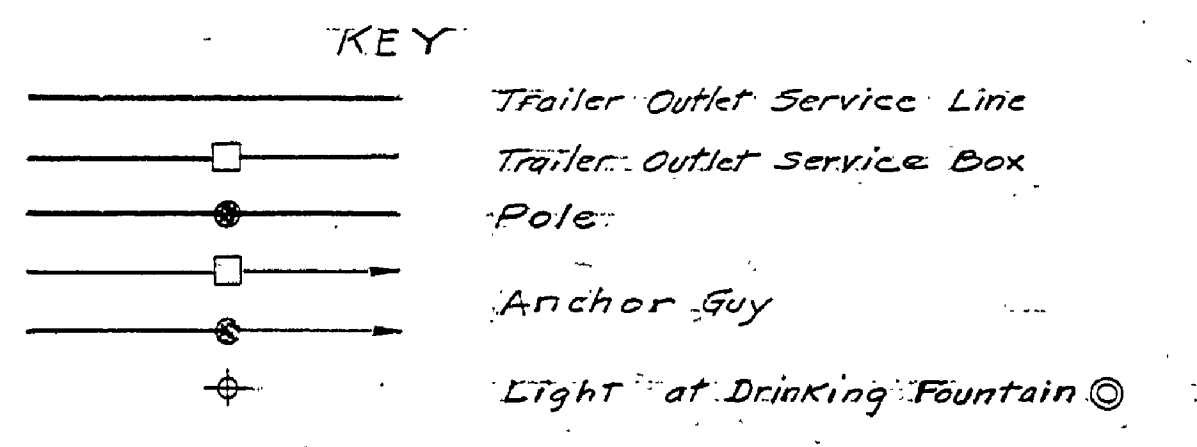


OTSEGO LAKE

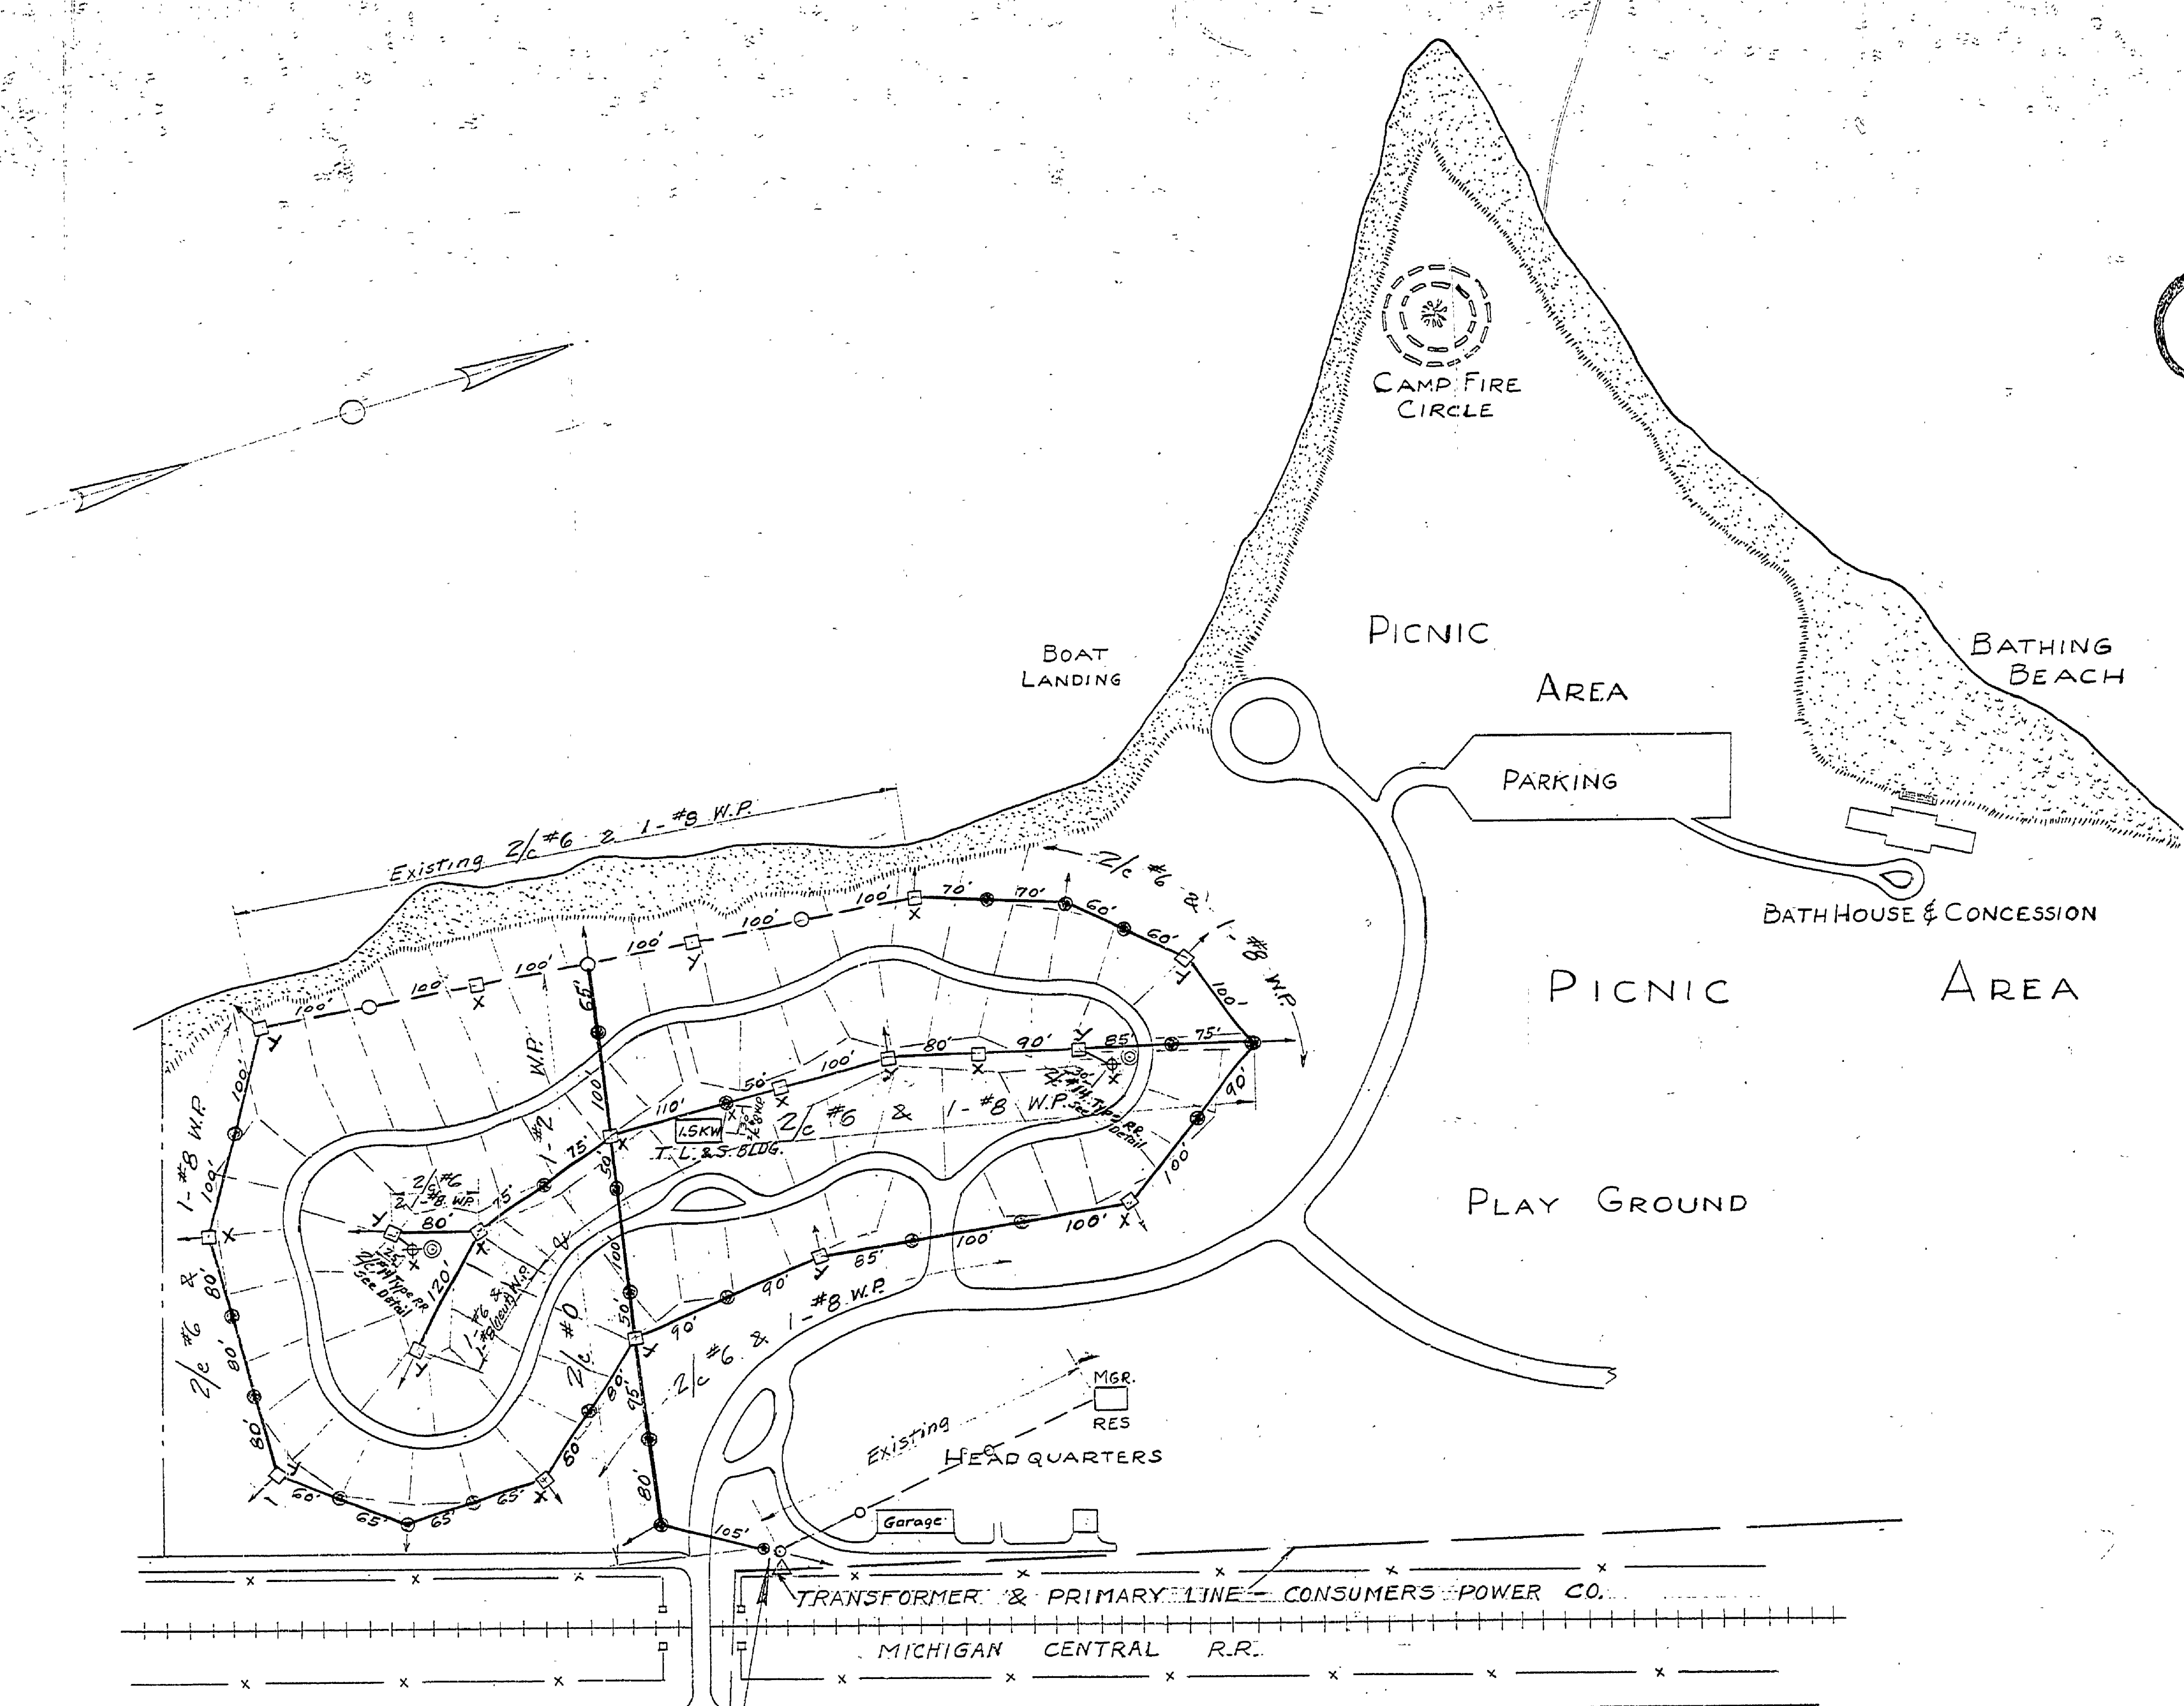

Note
 Use Galv. Sec. Heavy Duty Wire Racks with 8" wire spacing with 2/c #0 & 1-#2 and 6" wire spacing with 2/c #6 & 1-#8

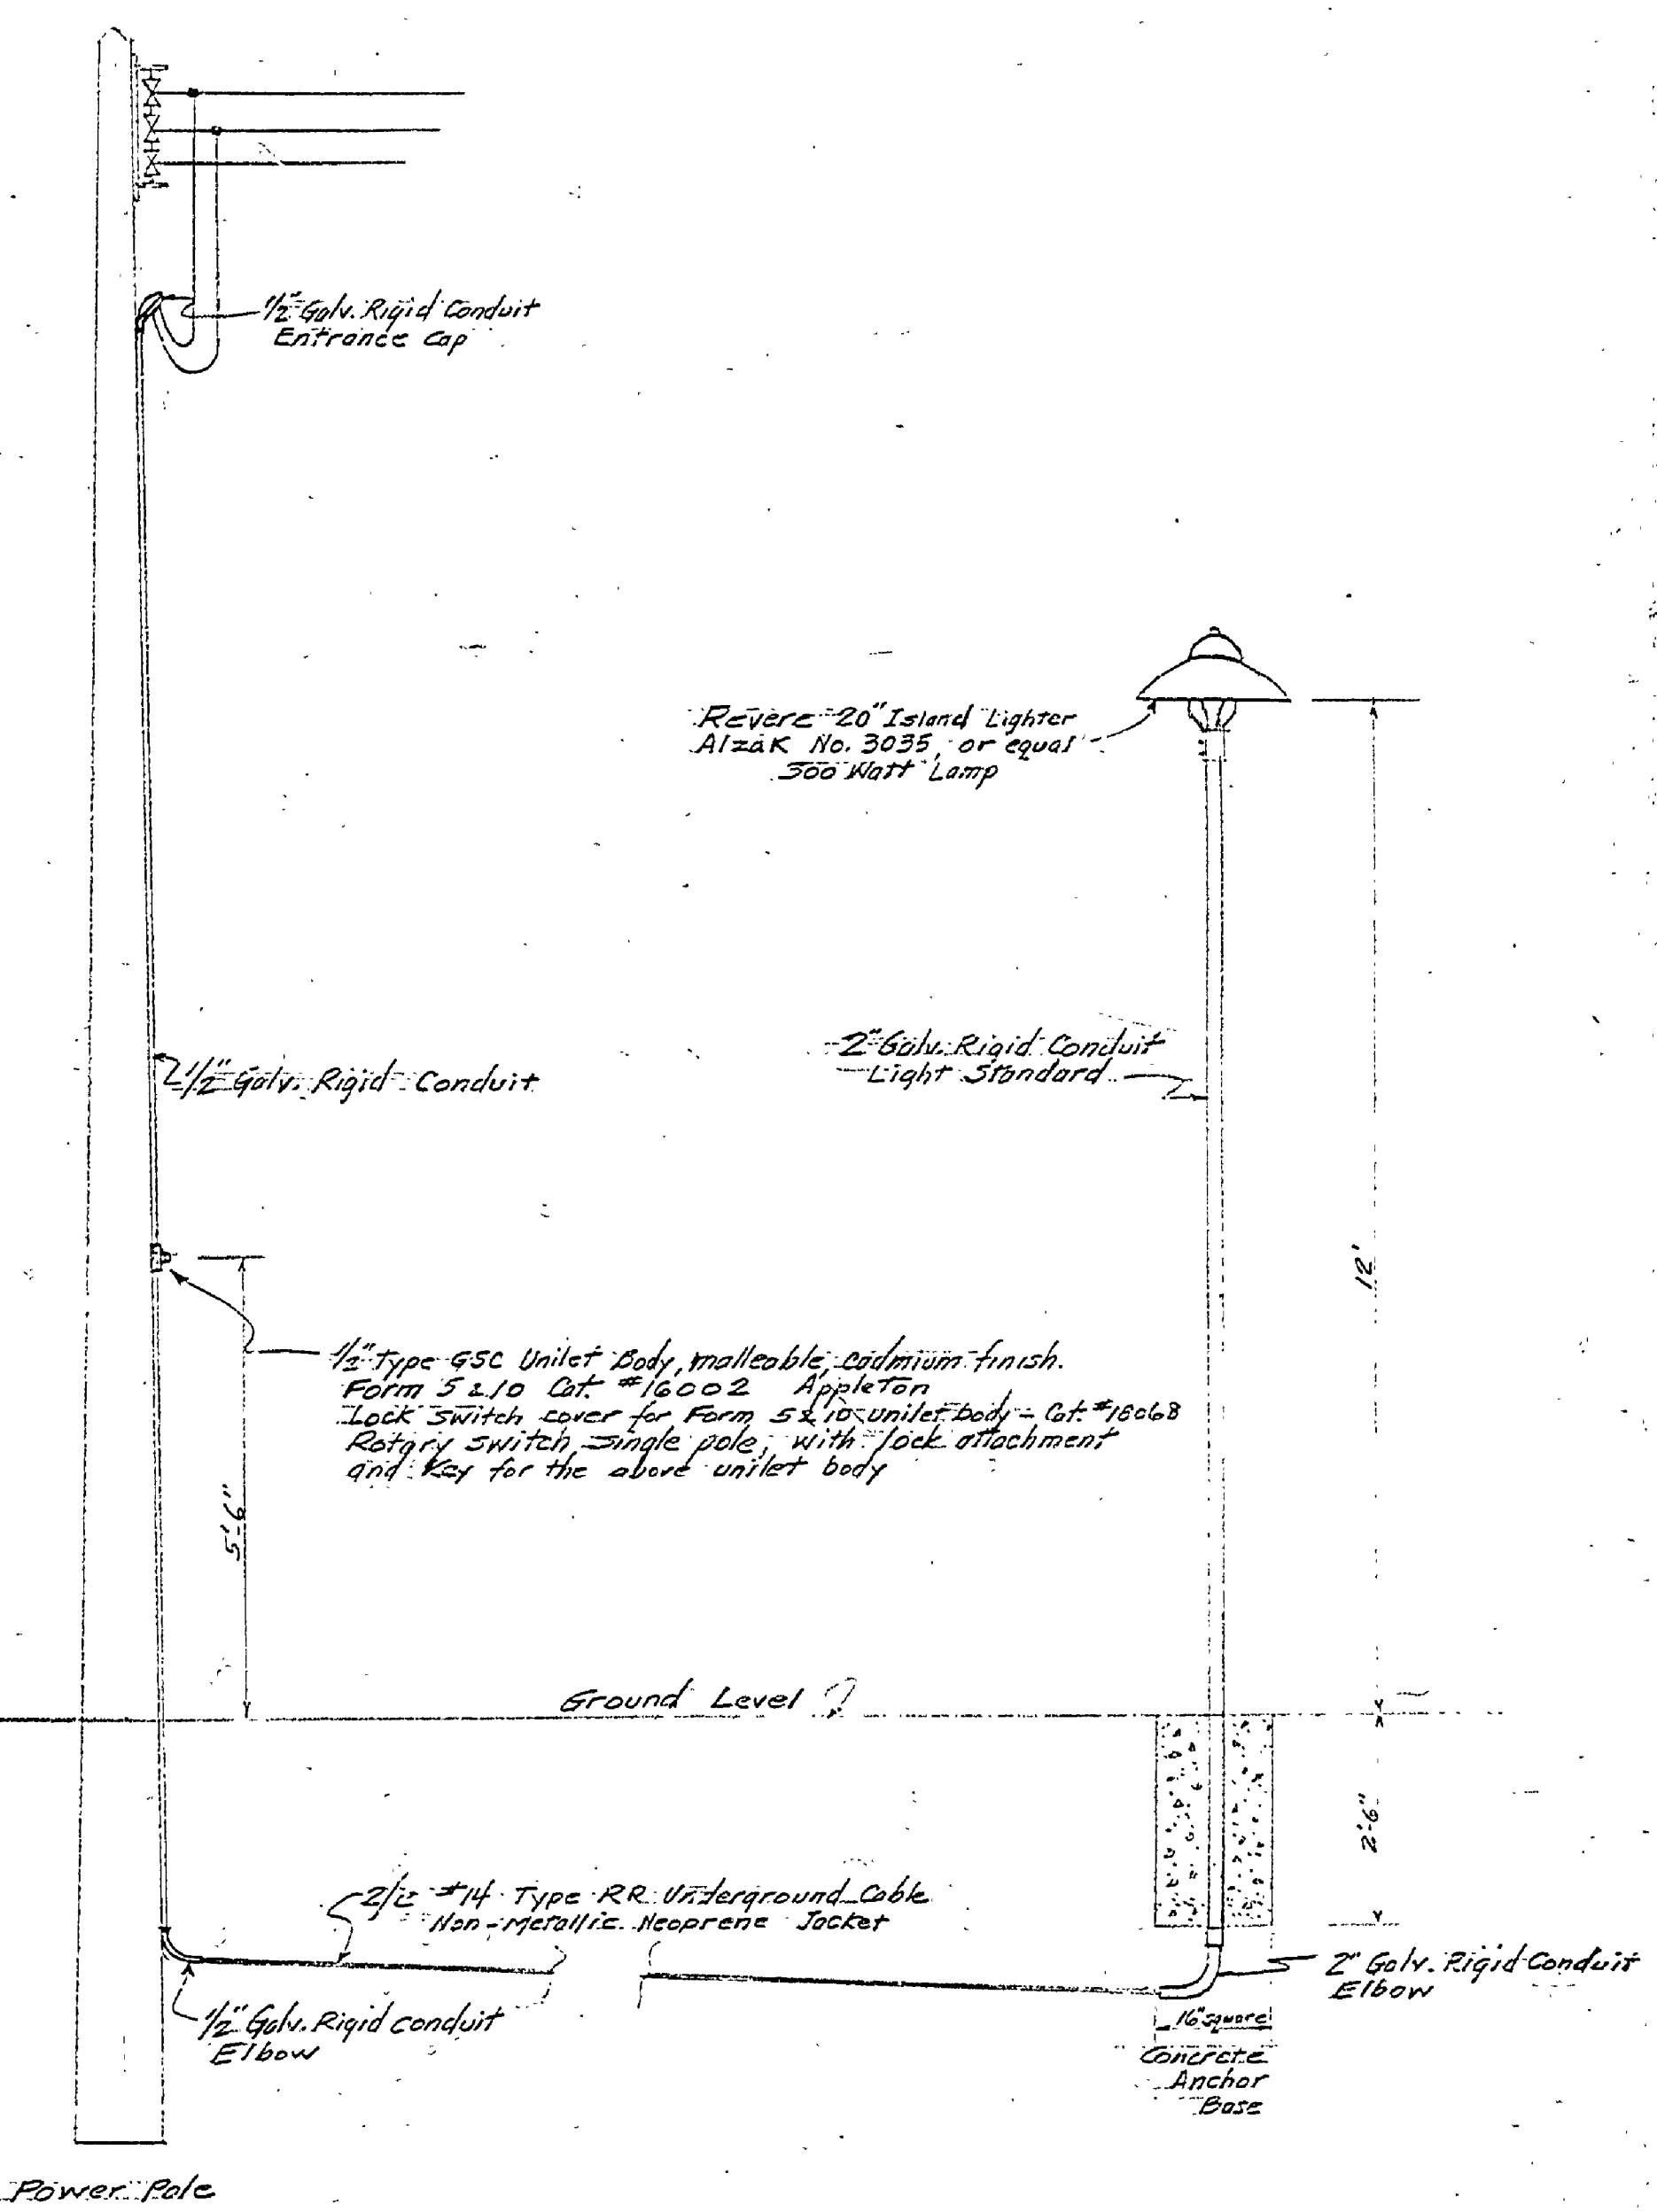

LIGHT AT DRINKING FOUNTAIN IS REQD.
 Scale 1/2" = 1'-0"

NO.	DATE	BY	REVISIONS
1			4
2			5
3			6

DATE	APPROVED BY	DATE	APPROVED BY
9-13-55	J.P.R.	9-13-55	J.P.R.
12-14-55	H.C.M.	9-13-55	J.P.R.
9-13-55	J.P.R.		

REVIEWED BY SECTIONS	DATE	APPROVED BY
ARCHITECTURAL		
ENGINEERING		
LANDSCAPE		

DATE	BY
9/2/55	P.M.

DATE	BY

SOUTH CAMPGROUNDS IMPROVEMENT

MICHIGAN DEPARTMENT OF CONSERVATION PARKS AND RECREATION DIVISION

OTSEGO LAKE STATE PARK
 ELECTRICAL DISTRIBUTION SYSTEM
 SCALE 1" = 100'

SHEET NO. 1 OF 3	PLAN NO. E-104
------------------	----------------