



PLAN OF SEPTIC TANK  
SCALE 3/4" = 1'-0"

DISTRIBUTION BOX DETAIL  
SCALE 1/2" = 1'-0"

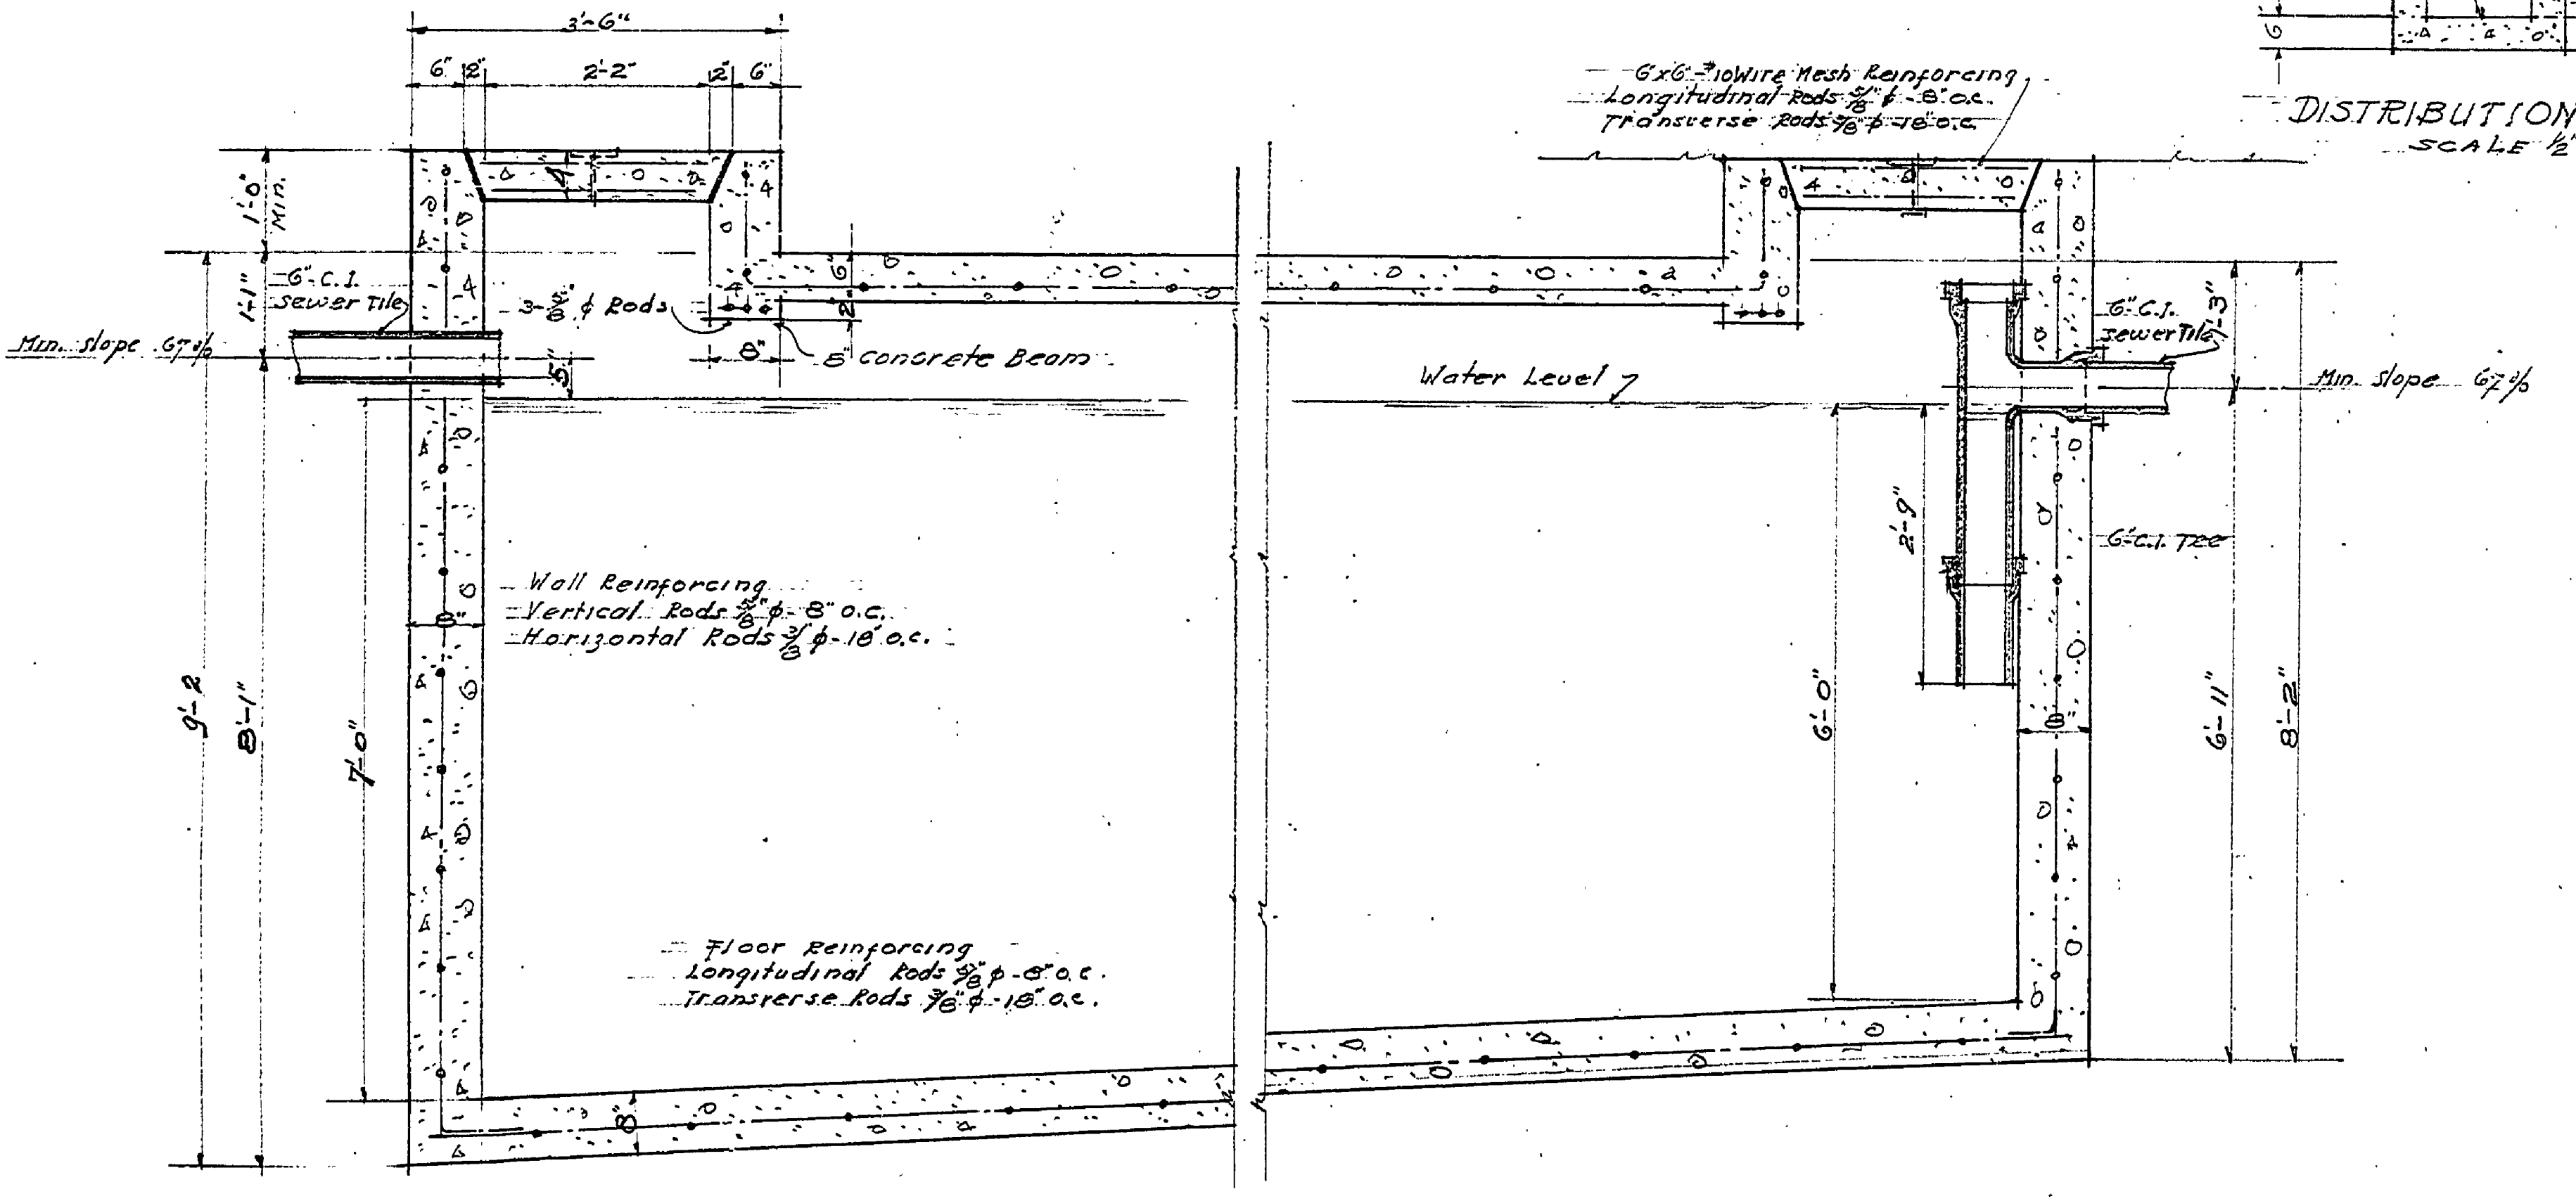

LONGITUDINAL SECTION SEPTIC TANK  
SCALE 3/8" = 1'-0"

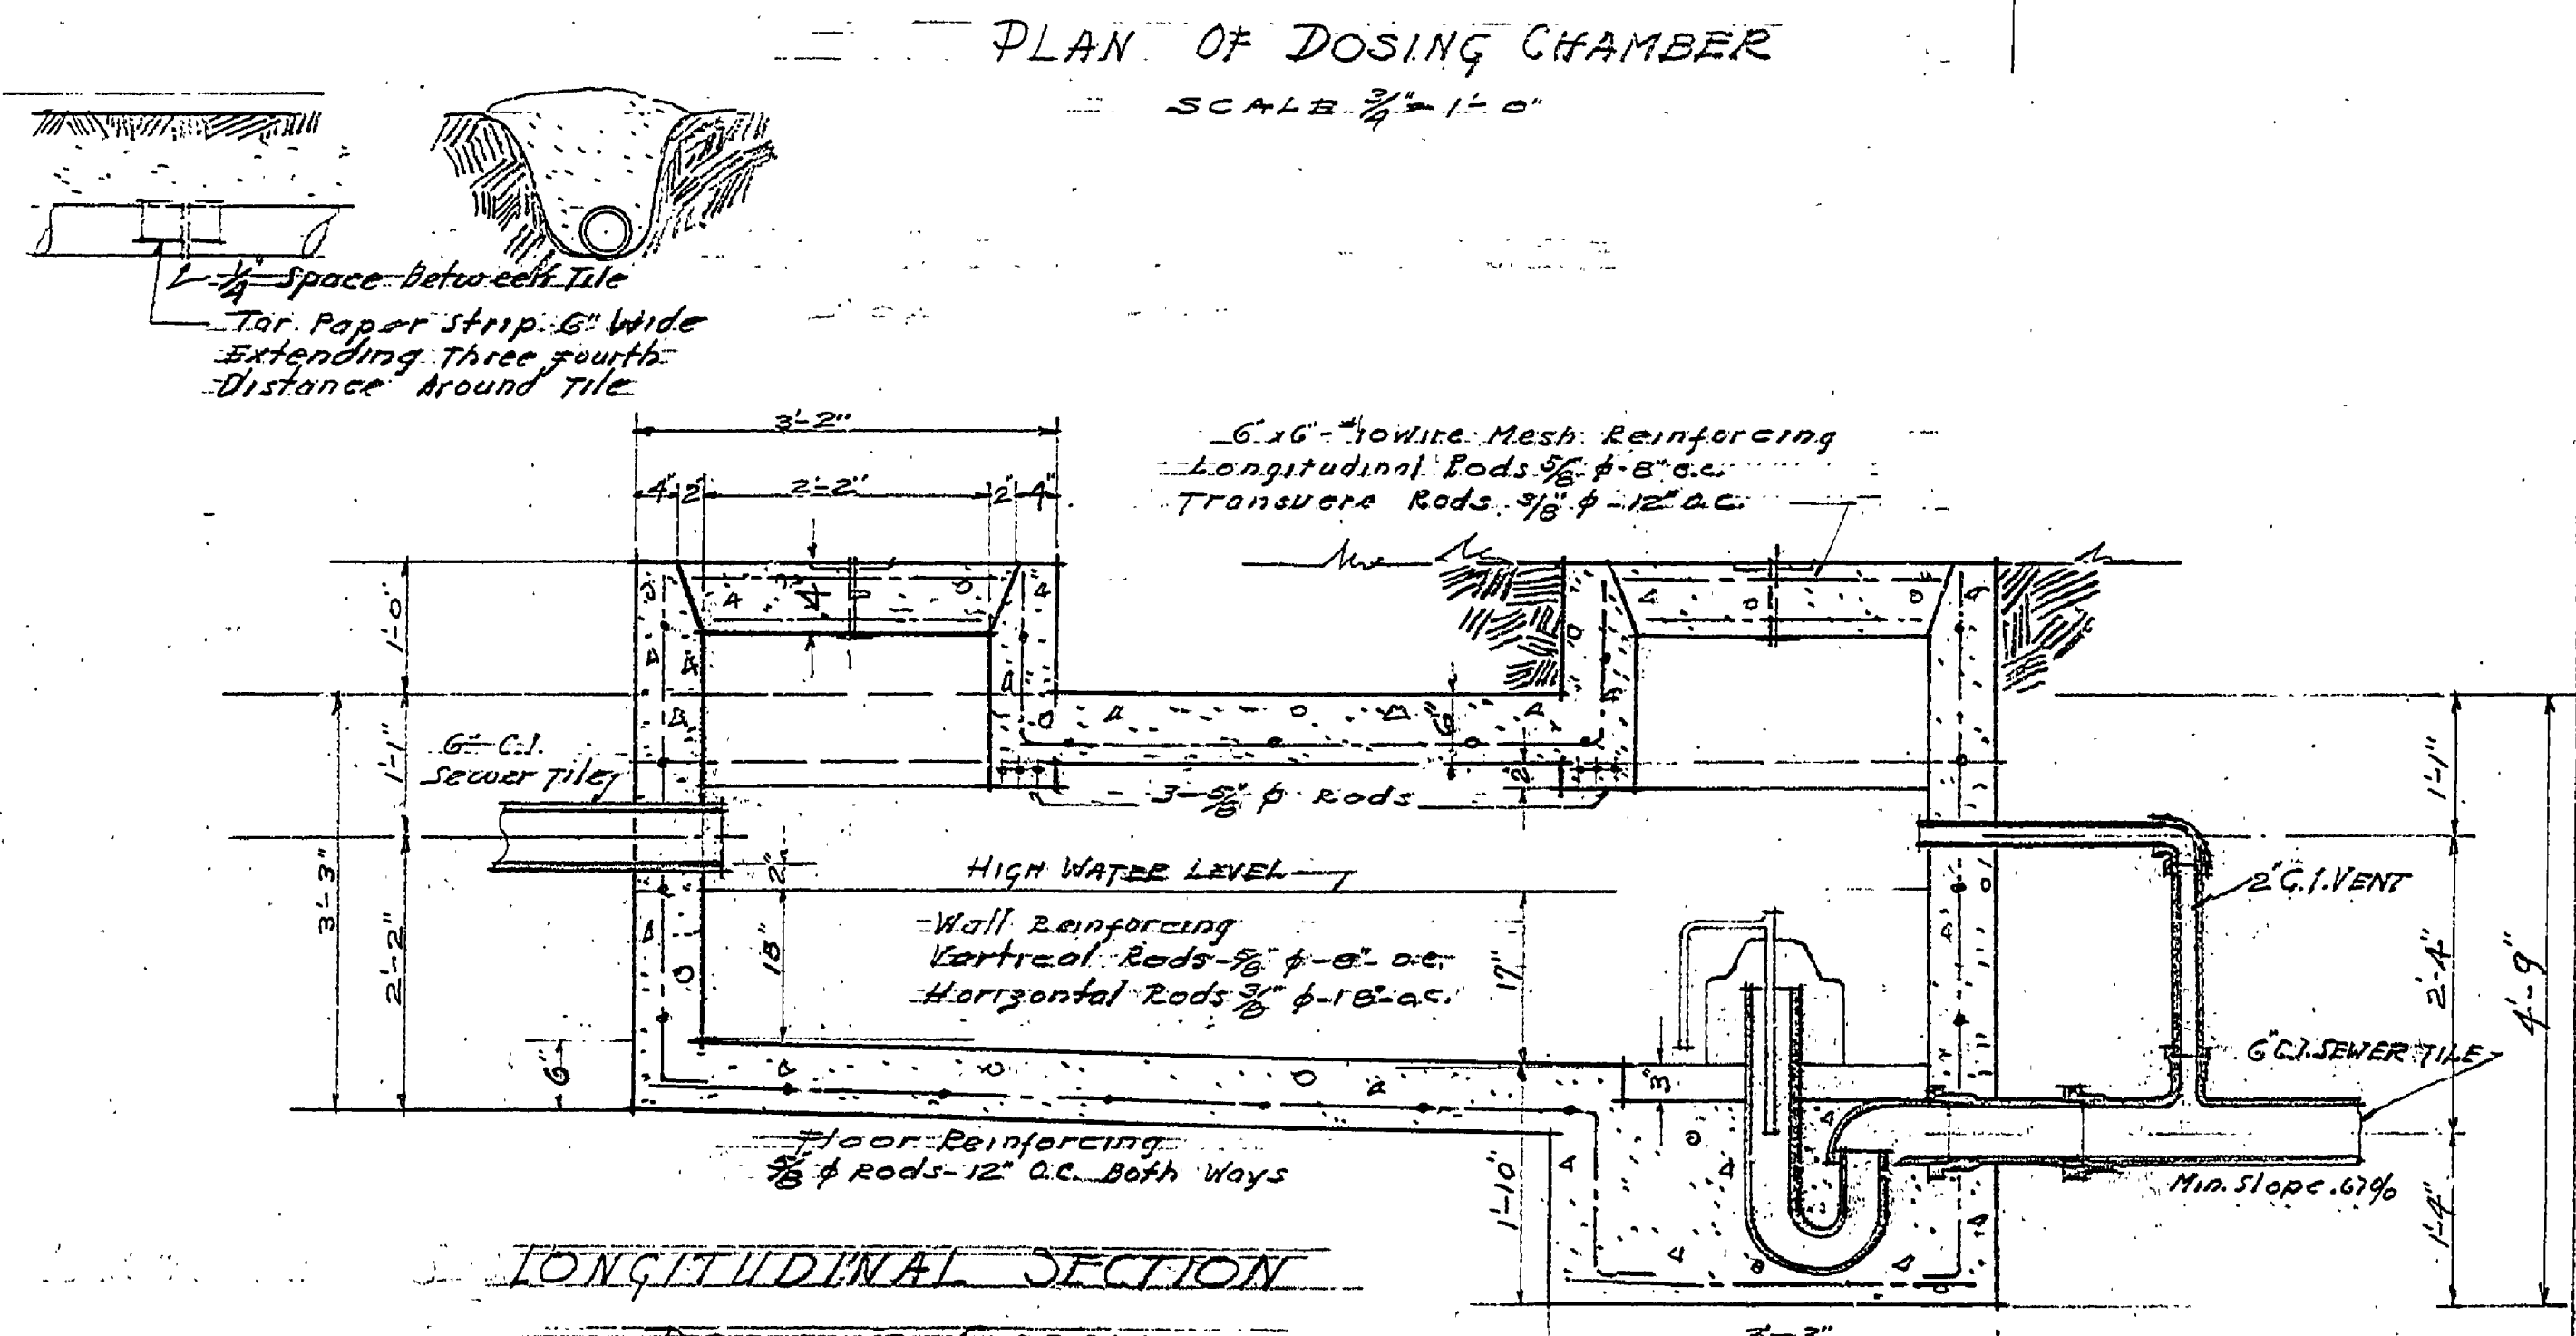

LONGITUDINAL SECTION  
DOSING CHAMBER  
SCALE 3/4" = 1'-0"

NOTE: Distribution tile lines should be laid to follow the contours of the ground, with a grade allowance of 2" to 3" for 100'. They should be approx. 3 ft. apart and not to be deeper than one foot below the ground surface. No tile line should exceed 100 ft. in length.

TOILET and LAUNDRY

MICHIGAN DEPARTMENT OF CONSERVATION PARKS DIVISION		
DRAWN BY TRACED BY	TRVERSE CITY STATE PARK	PROJECT NO. 101 SCALE As shown
CHECKED BY H.C.M.	COMBINATION BLDG. SEPTIC TANK	DATE 1-19-38
PREPARED BY ERNEST E. HARTWICK	ARCHITECT	DATE 1-19-38
APPROVED	CHIEF OF PARKS DIVISION	DATE
APPROVED		DATE

E-96