COMMERCIAL BLUEPRINT SERVICE, LANSING

NO.	DATE	BY	REVISIONS
1			4
2			5
3			6

	DATE	REVIEWED	DATE
DESIGNED BY B.H.Q.	3 Feb. '61	ARCHITECTURAL (V.H.C.	2-6-61
DRAWN BY B.H.Q.	3 Feb. '61	ENGINEERING E. J. P.	2-6-61
CHECKED BY E. J. P.	2-6-61	LANDSCAPE [illegible]	2-6-61

APPROVED
[signature]
CHIEF OF DIVISION
[signature]
DIRECTOR
[signature]
CHIEF OF PLANNING AND CONSTRUCTION

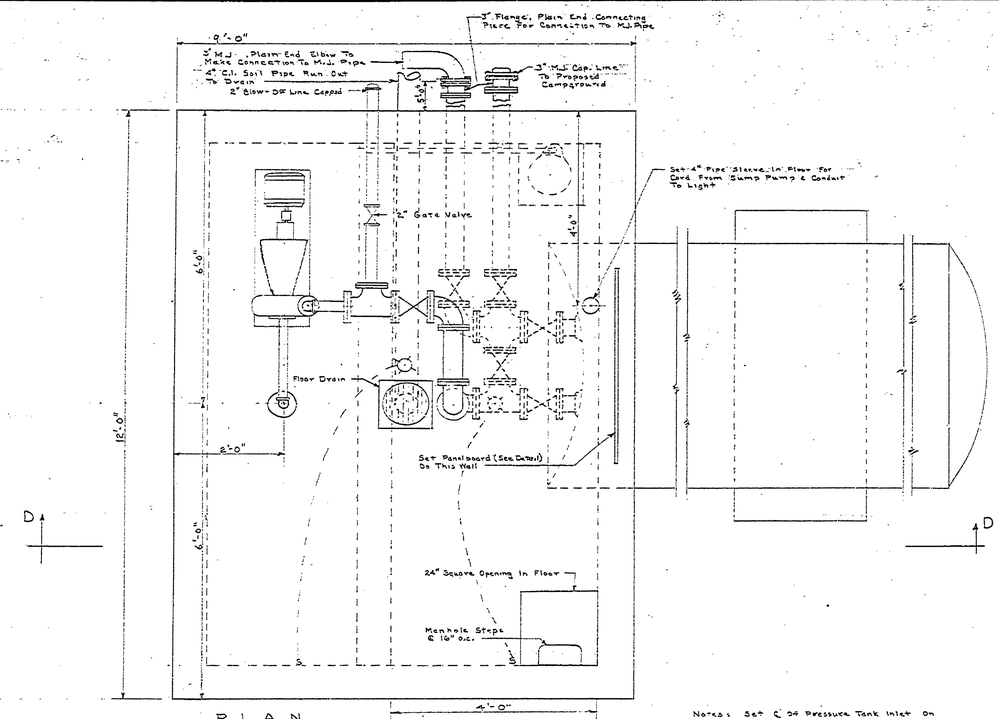



PUMP BASE DETAIL

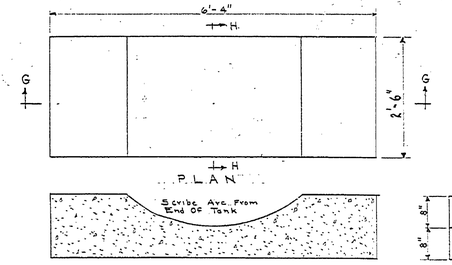

TANK SUPPORT DETAIL

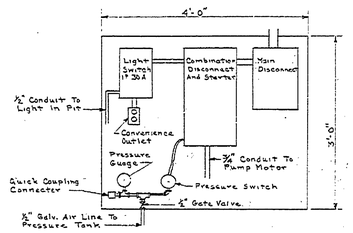

PANELBOARD DETAIL

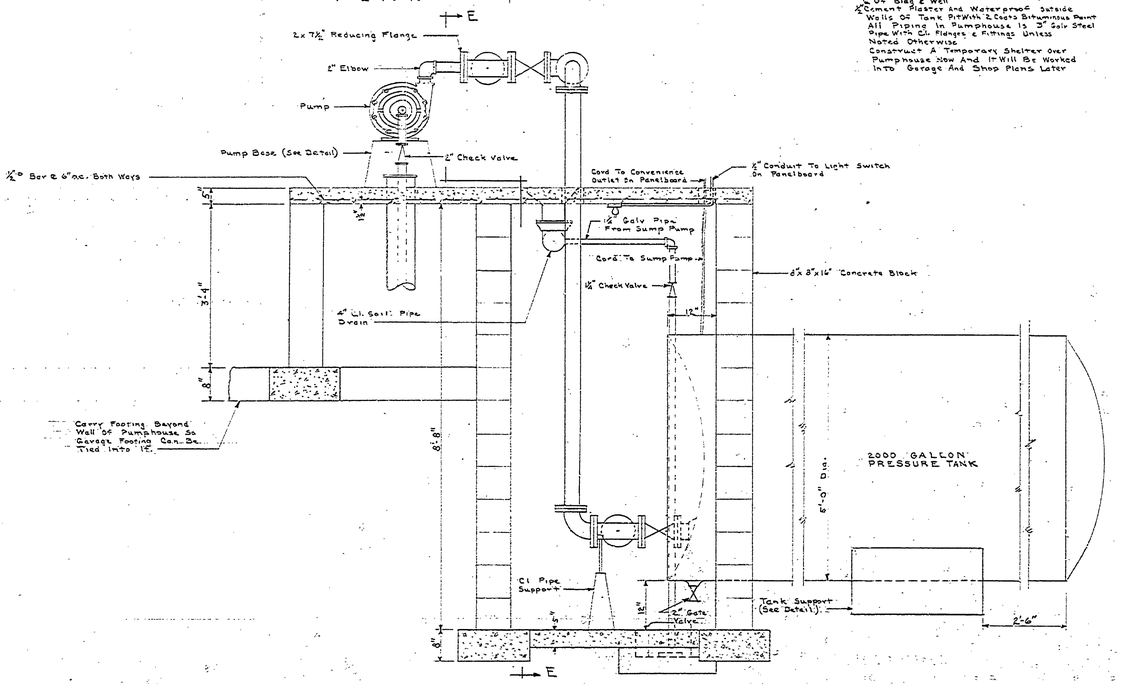

Notes: Set C.I. 24 Pressure Tank Inlet On S.W. Bldg. & Well
½" Cement Plaster And Waterproof Outside Walls Of Tank Pit With 2 Coats Bituminous Paint
All Piping In Pumphouse Is 3" Galv. Steel Pipe With Cl. Fittings & Fittings Unless Noted Otherwise.
Construct A Temporary Shelter over Pumphouse Now And It Will Be Worked Into Garage And Shop Plans Later

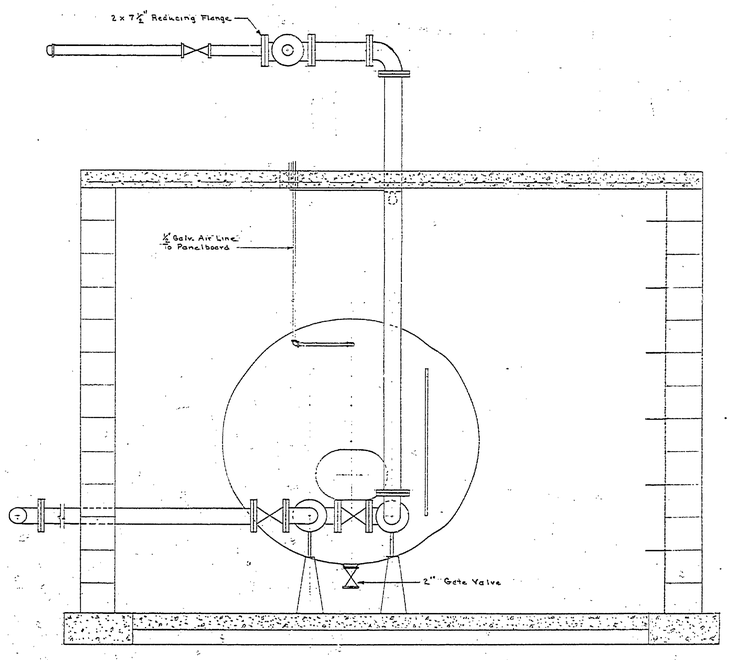

SECTION E-E

PUMPHOUSE DETAILS

MICHIGAN DEPARTMENT OF CONSERVATION PARKS AND RECREATION DIVISION	BURT LAKE STATE PARK WATER SYSTEM Scale ¾"=1'-0"	SHEET NO. 3 OF 4	PLAN NO. E-114