R-1638 COMMERCIAL BLUEPRINT SERVICE 5-59

"A" INCANDESCENT - SOLUX - A15FDGTP-150W RECESSED, CT. 15 FRAME

"B" INCANDESCENT - SOLUX - ARV-G4-(2) 100W WALL MOUNT

"C" STD. PORC. FIXTURE - PULL SWITCH

AIRSAN
(2) MWS. 36 1/8" DT.SR/CO2A - MAX. C.F.M. 6" x 16" DAMPERS - PLENUM 20" x 10", 19" DIA. VERTICAL DUCT TO EXHAUST FAN

EXHAUST FAN
ILG - U - CDF - 16 - 2056 C.F.M. @ 1/2 S.P. - 1/2 HP. - 230V WITH SPEED CONTROL - BIRD SCREEN - AUX BASE W/ GRAVITY SHUTTER

FLY FANS
(2) KING - AIR - KURTAIN, MODEL #5-150 1 1/2 H.P. - 60" WIDE

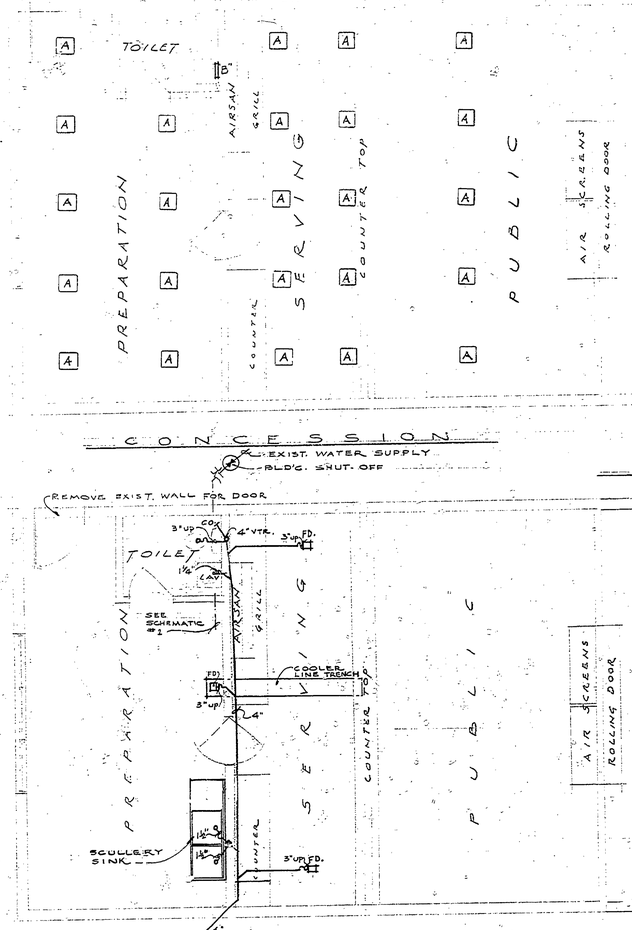

RELOCATE EXISTING FIXTURES IN THIS AREA TO GIVE GENERAL LIGHTING

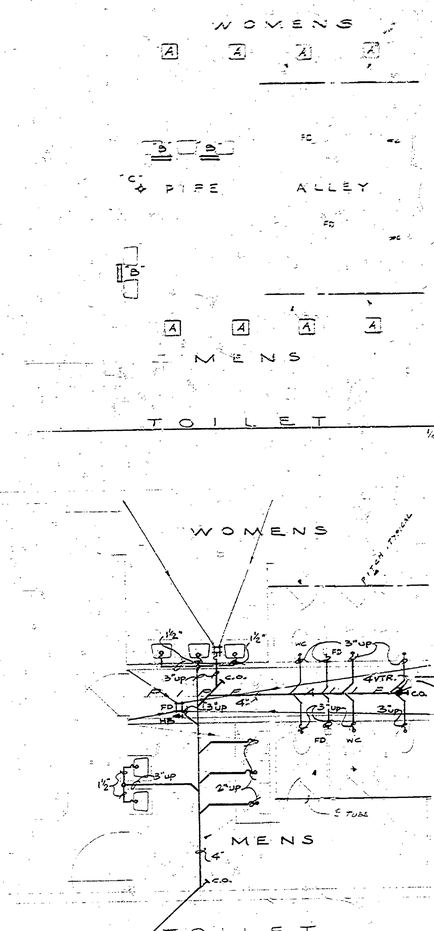

SYMBOLS

C.O. - CLEAN OUT
V.T.R. - VENT THRU ROOF
F.D. - FLOOR DRAIN
F. - FILTER
SC - SILL COCK
DC - DRAIN COCK
HB - HOSE BIBB
SO. - SHUT OFF

ELECTRICAL 1/4" = 1'-0"

PLUMBING 1/4" = 1'-0"

4" - 3/4" PER FT. FIELD CHECK

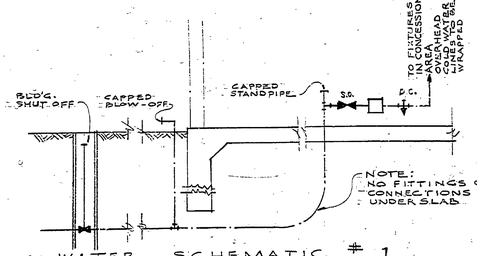

WATER - SCHEMATIC #1
CONCESSION STAND

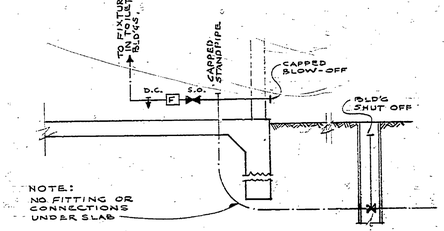

WATER - SCHEMATIC #2
TOILETS

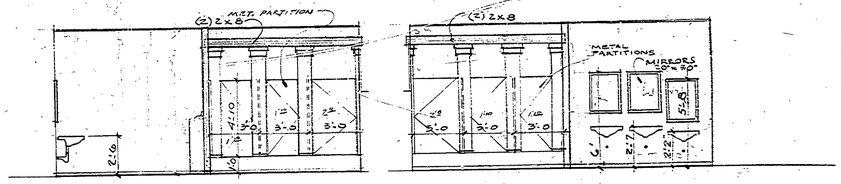

ELEVATIONS - TOILETS 1/4" = 1'-0"

SURVEYED BY		DRAWN BY		NO.	DATE	BY	REVISIONS	NO.	DATE	BY	REVISIONS	MICHIGAN DEPARTMENT OF NATURAL RESOURCES	ELECT. & PLUMBING & DETAILS (SHEET TITLE)	YANKEE SPRINGS (AREA OR PARK)	PROJECT NO. 24-1154
DESIGNED BY		CHECKED BY		1.				3.						REMODEL CONCESS. TOILET BLDG. (PROJECT)	SHEET 2 OF 2 — PLAN NO. A 144
	DATE		DATE	2.				4.							