


DISTRIBUTION BOX

INDEX	SIZE	LENGTH	No. Req.	DIAGRAM
B-1	1/2" Ø	5' 6"	38	1'2" 3' 2" 1'2"
B-2	" "	11' 10"	3	1'2" 9' 6" 1'2"
B-3	" "	9' 8"	3	1'2" 8' 6" "
B-4	" "	15' 8"	3	1'2" 13' 4" 1'2"
S-1	" "	10' 6"	5	STRAIGHT
S-2	" "	6' 3"	3	" "
S-3	" "	5' 6"	5	" "
S-4	" "	7' 0"	6	" "
S-5	" "	3' 2"	4	" "
S-6	" "	3' 7"	25	" "
S-7	" "	9' 11"	14	" "
S-8	" "	8' 7"	4	" "
S-9	" "	2' 9"	10	" "

SEPTIC TANK AND SIPHON
SCALE = 1/2 INCH = 1 FOOT

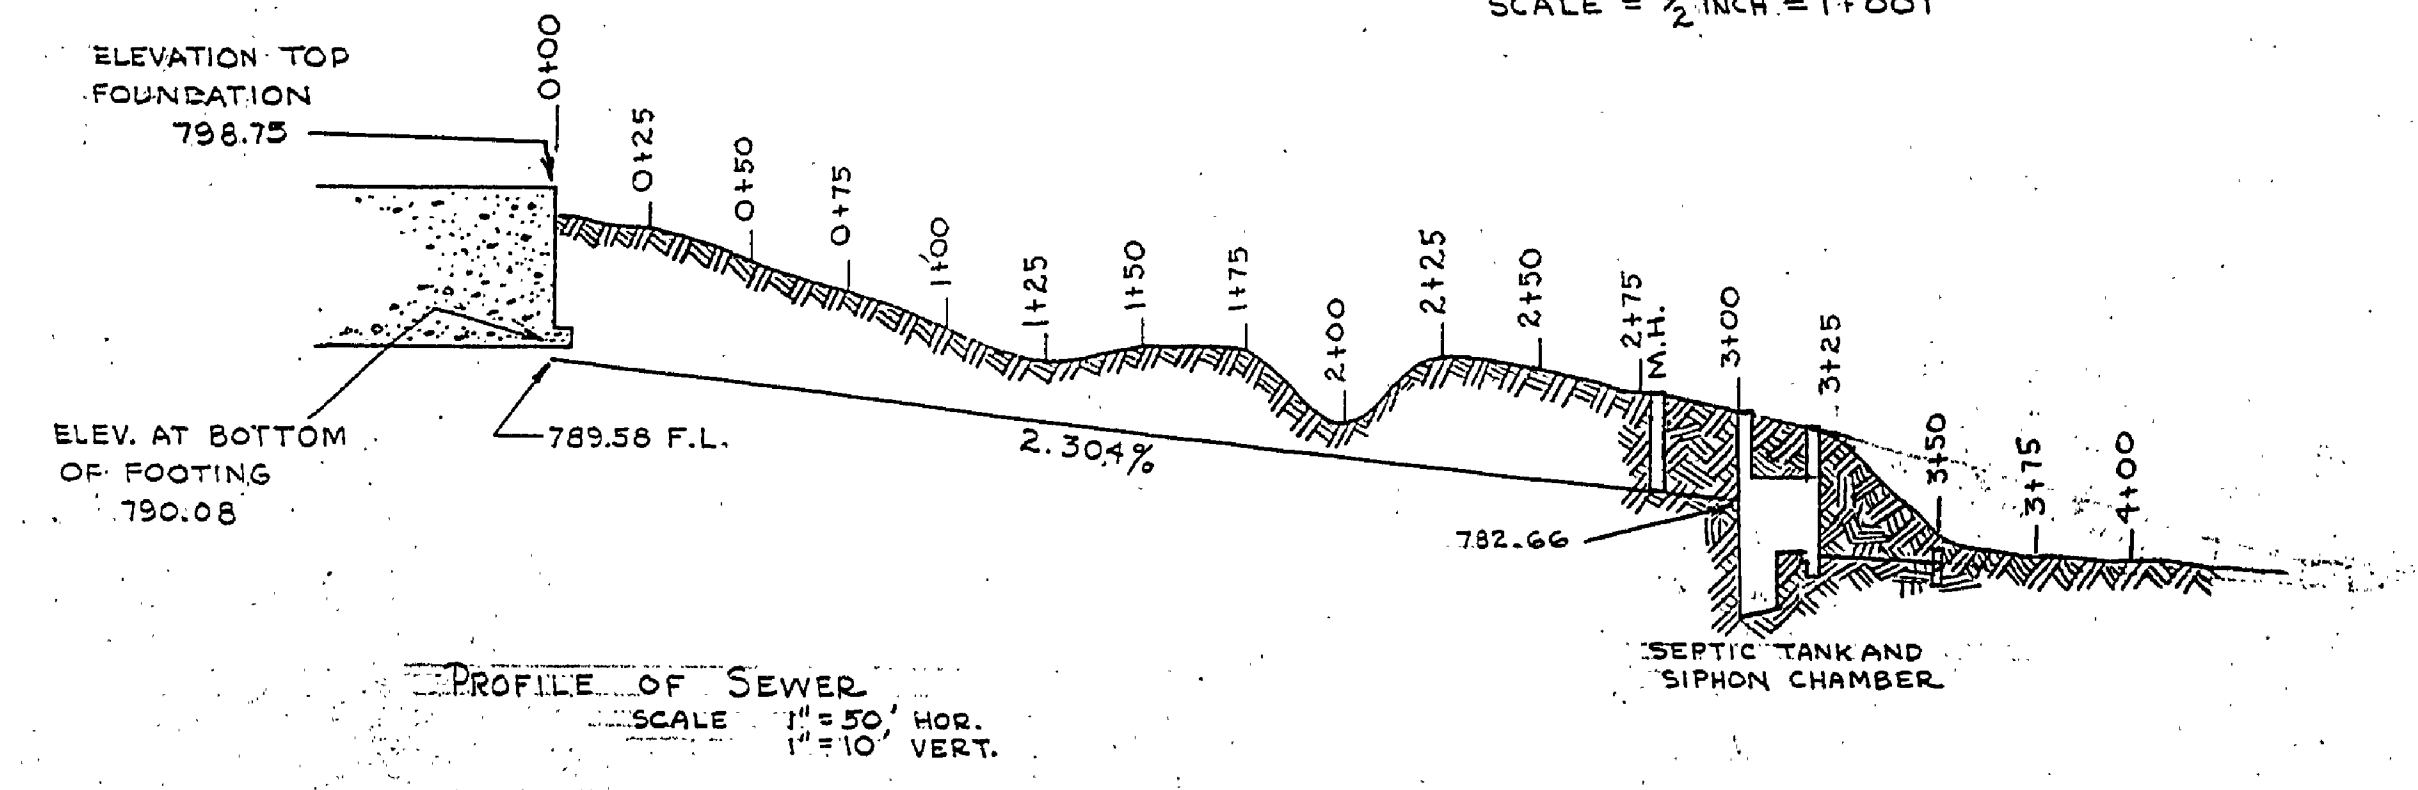

UNITED STATES
DEPARTMENT OF THE INTERIOR
NATIONAL PARK SERVICE
MICH. DEPT. OF CONSERVATION
COOPERATING

YANKEE SPRINGS AREA
ADMINISTRATION
SEWER SYSTEM
Supt. Residence

DATE 2/8/40

RECOMMENDED _____ AREA MANAGER _____ DATE _____
 RECOMMENDED _____ INSPECTOR _____ DATE _____
 APPROVED BY _____ PARK AUTHORITY OR SPONSOR _____ DATE _____
 APPROVED BY _____ REGIONAL DIRECTOR _____ DATE _____