
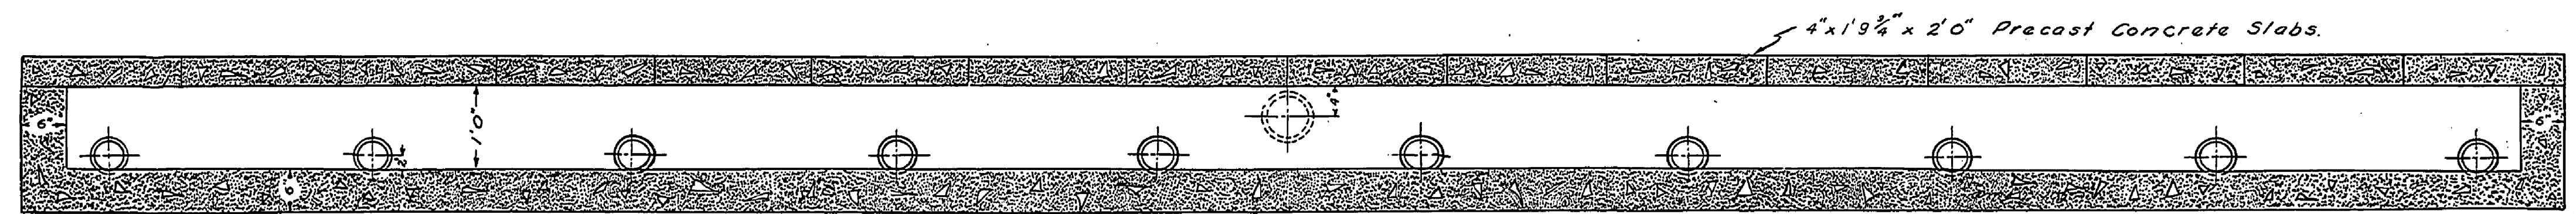



SECTION ALONG CENTER LINE

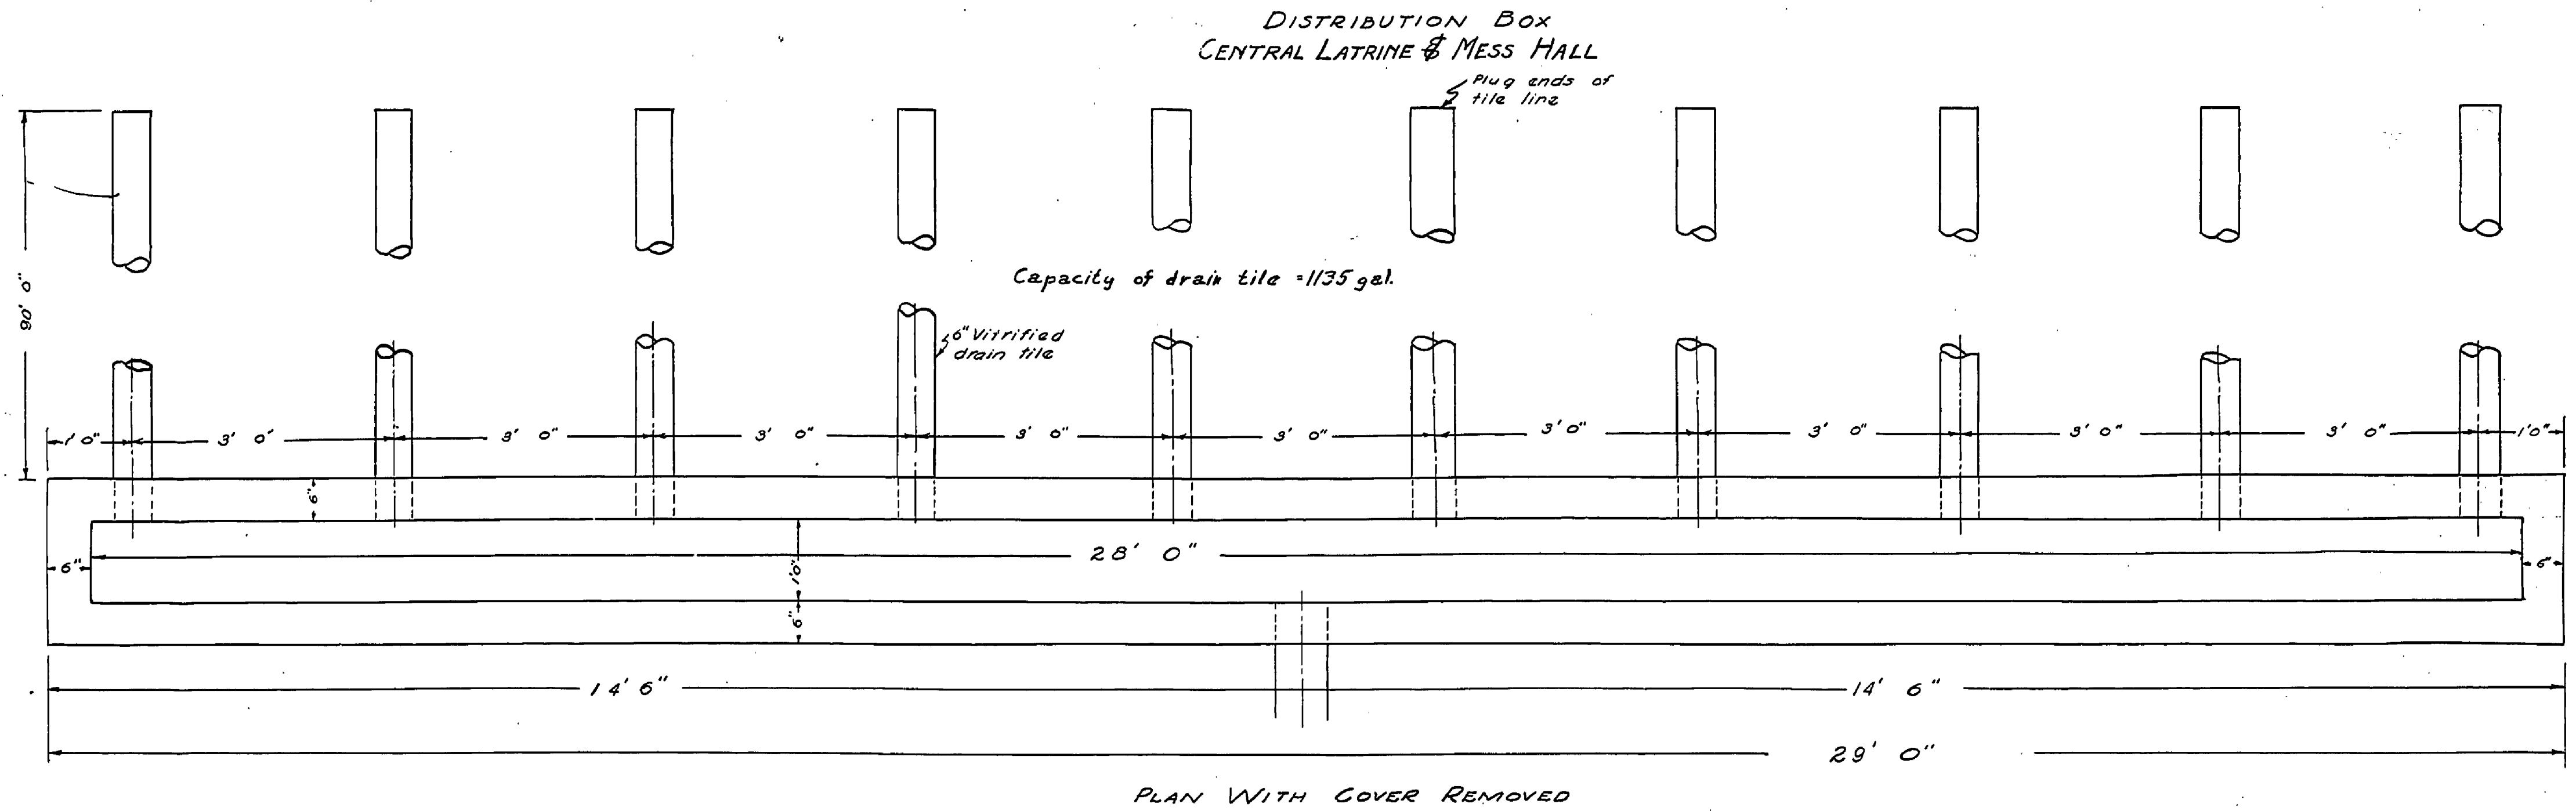

SECTION ALONG CENTER LINE

BILL OF 1/2" REINFORCING STEEL FOR INFIRMARY SYSTEM

Location of Bar	No. Pcs.	Lg. Ea.	Total Lg.
Longitudinal Bars in Bottom of Septic Tank	4	9' 2"	36' 8"
Transverse Bars in Bottom of Septic Tank & Chamber	11	4' 9"	52' 3"
Vertical Bars in Deep End of Tank	2	7' 0"	14' 0"
Horizontal Bars in Deep End of Tank	7	4' 9"	33' 3"
Vertical Bars in Shallow End of Tank	2	6' 5"	12' 10"
Horizontal Bars in Shallow End of Tank	6	4' 9"	28' 6"
Horizontal Bars in 2 Sides of Tank & Chamber	4	13' 9"	55' 0"
Horizontal Bars in 2 Sides of Tank	8	9' 2"	73' 4"
Vertical Bars in 2 Sides of Tank	2	7' 2"	14' 4"
" " " " " " " "	2	7' 1"	14' 2"
" " " " " " " "	2	7' 0"	14' 0"
" " " " " " " "	2	6' 11"	13' 10"
" " " " " " " "	2	6' 10"	13' 8"
" " " " " " " "	2	6' 9"	13' 6"
" " " " " " " "	2	6' 8"	13' 4"
" " " " " " " "	2	6' 7"	13' 2"
Longitudinal Bars in Bottom of Chamber	2	6' 6"	13' 0"
Vertical Bars in Deep End of Chamber	2	3' 10"	7' 8"
Horizontal Bars in Deep End of Chamber	3	4' 0"	14' 3"
Vertical Bars in 2 Sides of Chamber	2	3' 6"	7' 0"
" " " " " " " "	2	3' 7"	7' 2"
Bars in Top Slabs	6	3' 10"	23' 0"
Total	22	3' 0"	66' 0"

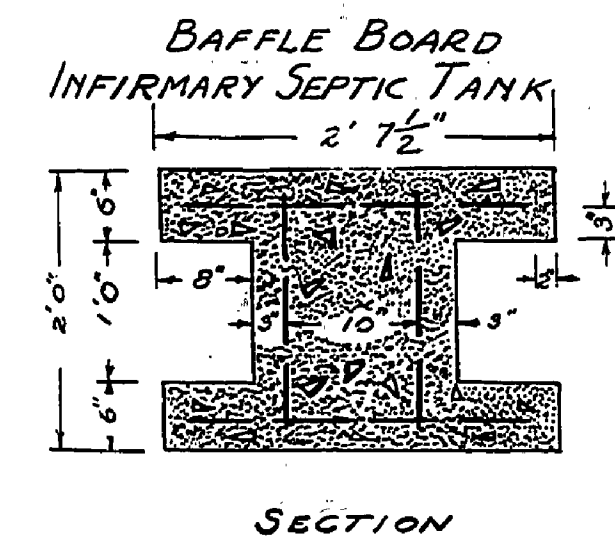

APPROVED BY
MICHIGAN DEPT. OF HEALTH
Edward K. Kich
DIRECTOR BUREAU OF ENGINEERING

APPROVED BY
INSPECTOR
APPROVED BY
MICHIGAN CONSERVATION COM.
J. S. Conner
SUPT. OF STATE PARKS

UNITED STATES
DEPARTMENT OF THE INTERIOR
NATIONAL PARK SERVICE
COOPERATING WITH
MICHIGAN CONSERVATION COMMISSION

DRAWN BY J.L.A.	YANKEE SPRINGS LONG LAKE DISPOSAL TANKS DETAILS	PLAN 90-55 NO. 2 SCALE 3/4" = 1' DESIGNATION CAMP R.D.P.-MI-6 DATE 2-13-37
CHECKED BY R.L.H.	PREPARED BY <i>J. S. Conner</i>	DATE May 3-37
RECOMMENDED BY <i>J. S. Conner</i>	RECOMMENDED BY <i>J. S. Conner</i>	DATE 6-7-37
PREPARED BY STATE PARK AUTHORITY OR SPONSOR	INSPECTOR REGIONAL OFFICE	DATE
ASSISTANT DIRECTOR		