



PLAN

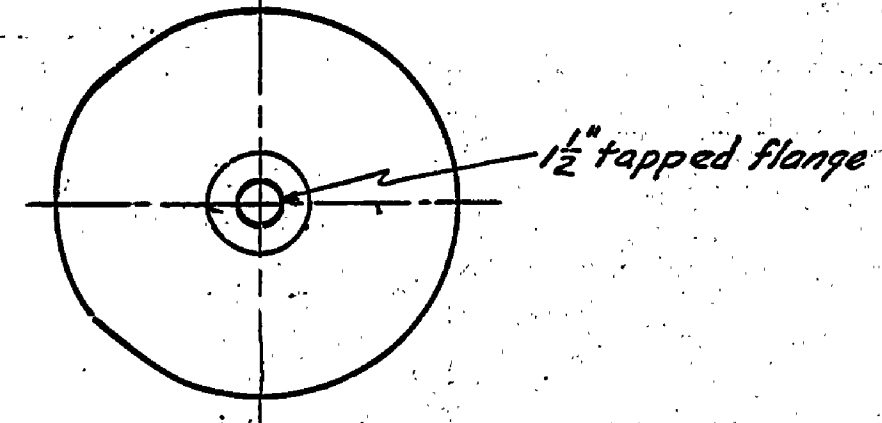


ELEVATION

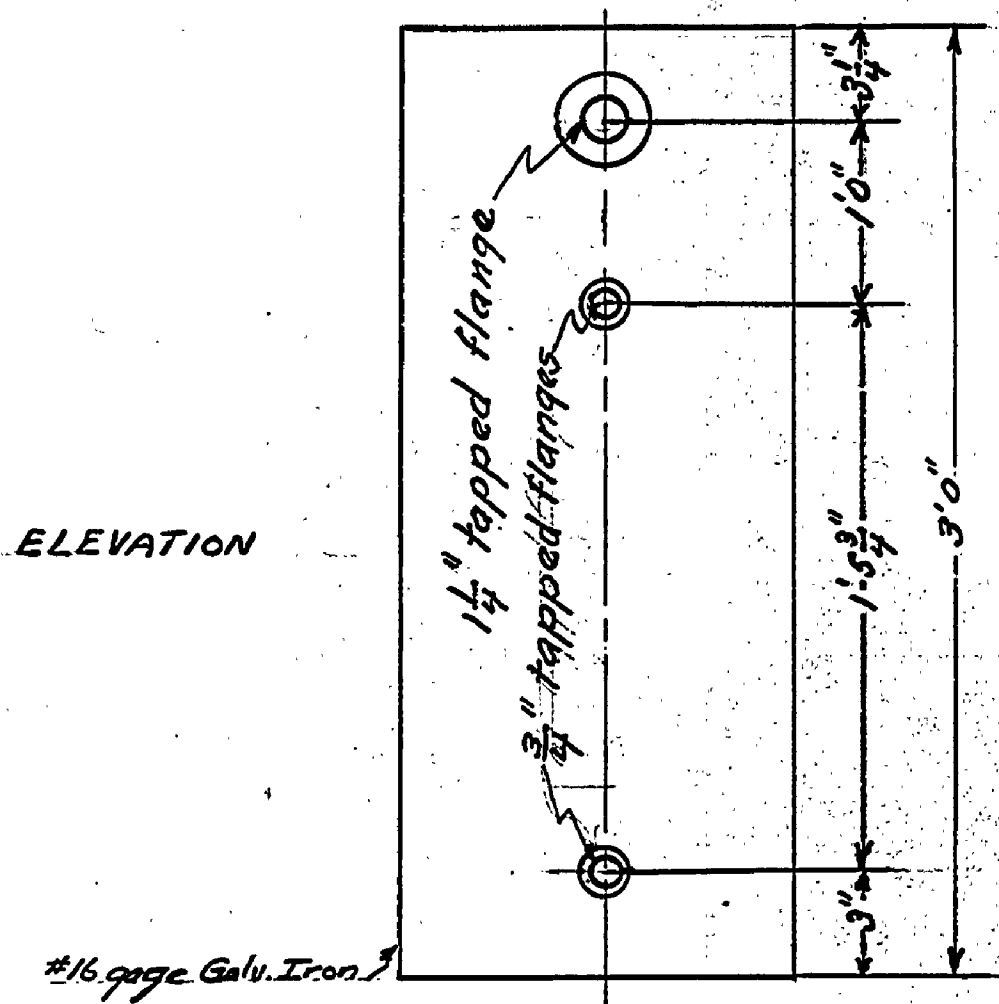

Note: Tank to be tested for 150<sup>psi</sup> working pressure 75<sup>psi</sup> Metal to be galvanized inside and out. All flanges to be tapped for the size of pipe indicated. Tank may be either inverted or welded.

BOTTOM

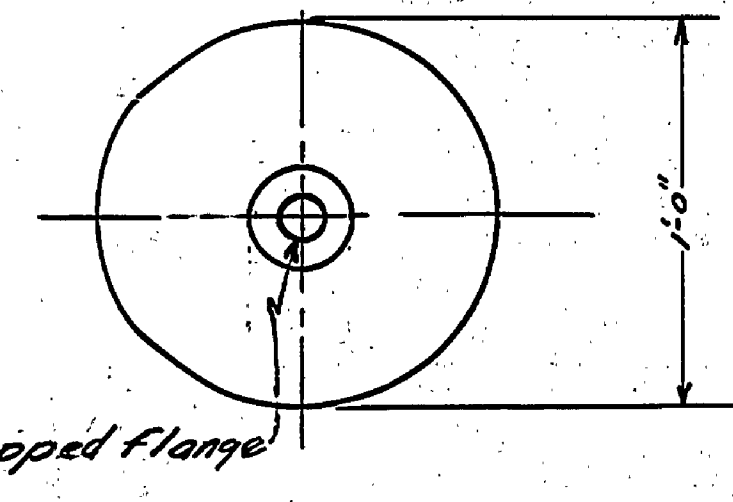

PRESSURE TANK  
YANKEE SPRINGS PROJECT  
NATIONAL PARK SERVICE  
Scale 1" = 6" Sept 14, 1937

E-113

JOB # 27