


Shed	X	2	—	—
Central Latrine	N	20	5	7
Group Lodges	L	3	3	2
Group Lodges	J	1	—	—
Infirmery	F	3	1	1
Kitchen	A	3	—	—
Staff Quarters	M	1	—	—

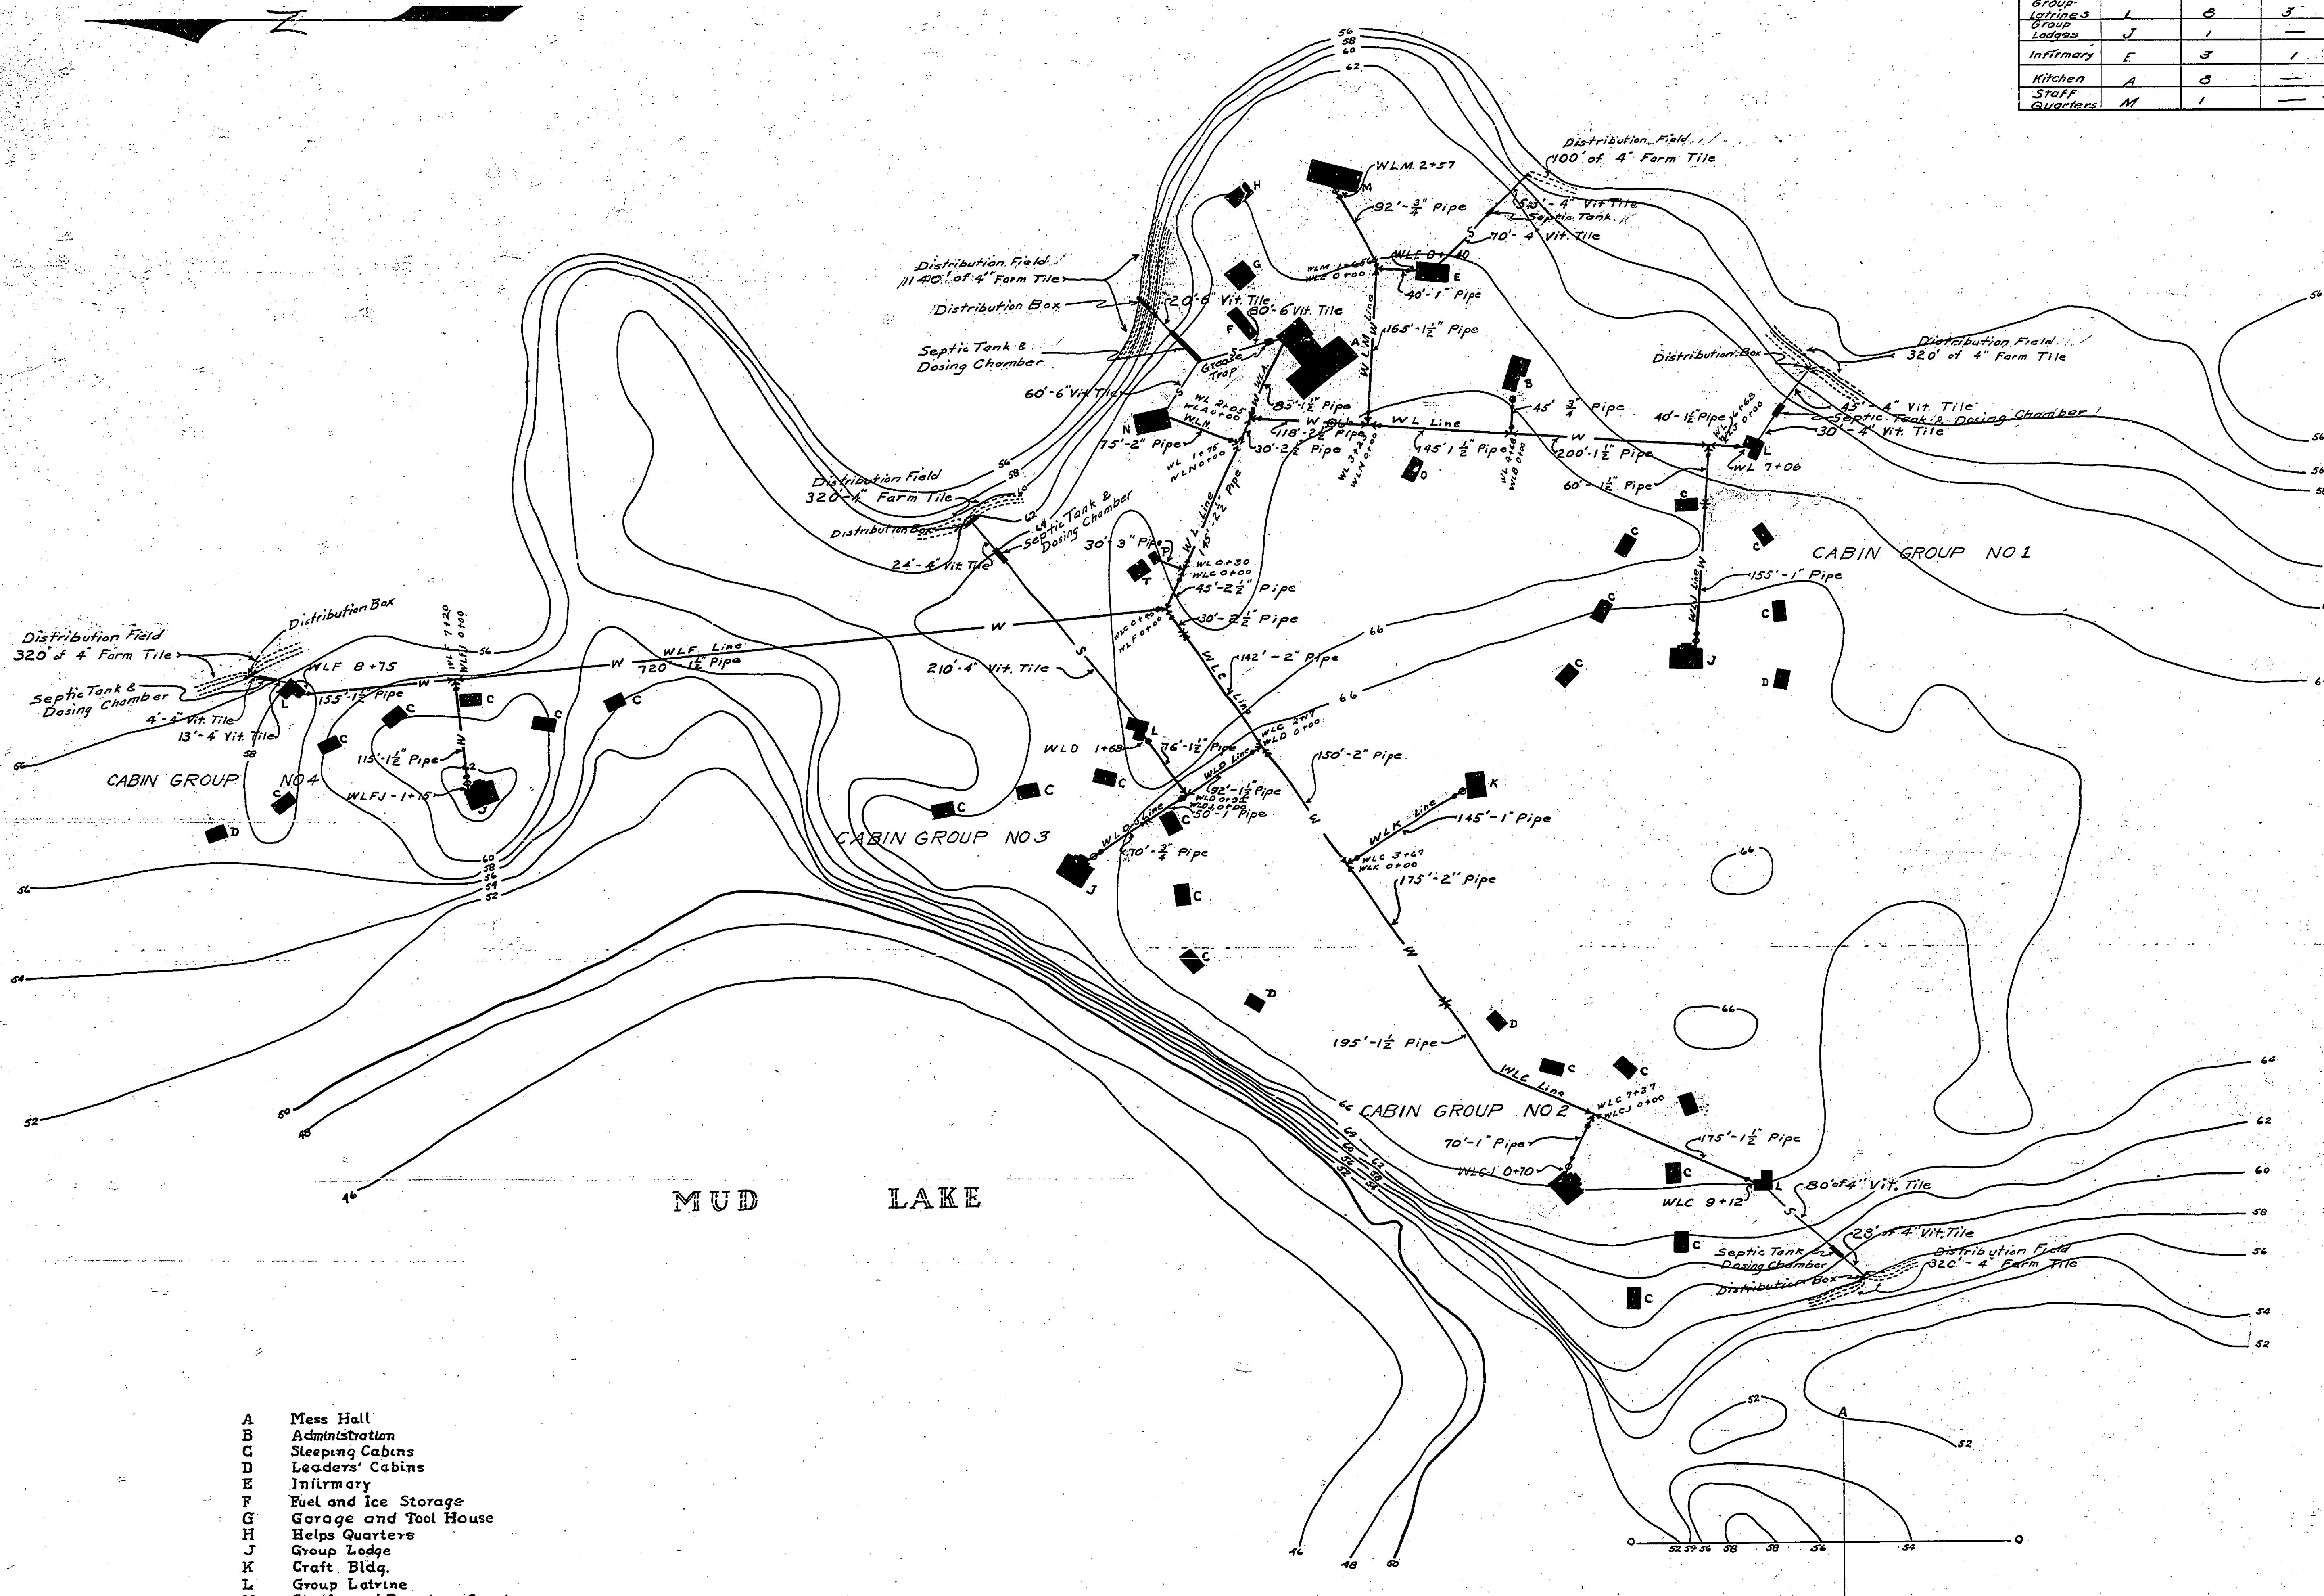

- A Mess Hall
- B Administration
- C Sleeping Cabins
- D Leaders' Cabins
- E Infirmery
- F Fuel and Ice Storage
- G Garage and Tool House
- H Help Quarters
- J Group Lodge
- K Craft Bldg.
- L Group Latrine
- M Staff and Directors Quarters
- N Central Latrine, Wash House, & Laundry
- O Museum
- P Pump House
- T Water Storage Tank
- W Water Lines
- S Sewer Lines
- Septic Tank, Distribution Box, & Field
- Hydrant
- Shut off and Drain
- Fountain
- Grease Trap

TOP OF DISTRIBUTION TILE TO BE FROM ONE FOOT TO ONE AND A HALF FEET BELOW GROUND SURFACE.
 ALL SEWER LINES TO BE LAID AT A MINIMUM DEPTH OF THIRTY INCHES.
 MINIMUM DEPTH OF WATER LINES TO BE FOUR FEET BELOW GROUND SURFACE.
 ALL SEWERAGE SYSTEM DATA NOT SHOWN WILL BE FOUND ON SEWERAGE DETAIL PLAN.

DF-
E-124
1st SHEET

FRAME ONE OF TWO FRAMES

M. Mitchell 9/14/36
Consul. Engr.

APPROVED BY MICHIGAN DEPT. OF HEALTH <i>Edward D. Rieck</i> 7-16-36 DIRECTOR BUREAU OF ENGINEERING		DEPARTMENT OF THE INTERIOR NATIONAL PARK SERVICE	
APPROVED BY <i>Stanley M. Smith</i> INSPECTOR		LDMIS YANKEE SPRINGS RECREATIONAL DEMONSTRATION PROJECT MUD LAKE WATER SUPPLY & SEWERAGE SYSTEM LAYOUTS	
APPROVED BY MICHIGAN CONSERVATION COMMISSION <i>W. H. Smith</i> Supt. of State Parks		Date drawn 9/11/36	Date submitted
Drawn by T.M.Z.	Traced by G.H.W.	Checked by R.S.R.	Scale 1" = 80'
Submitted by	Date 9/15/36	Sheet No. 70-08	File No.
Approved by	Regional Director	11-1-36	