




PROFILE of SEWER from LAUNDRY (N)

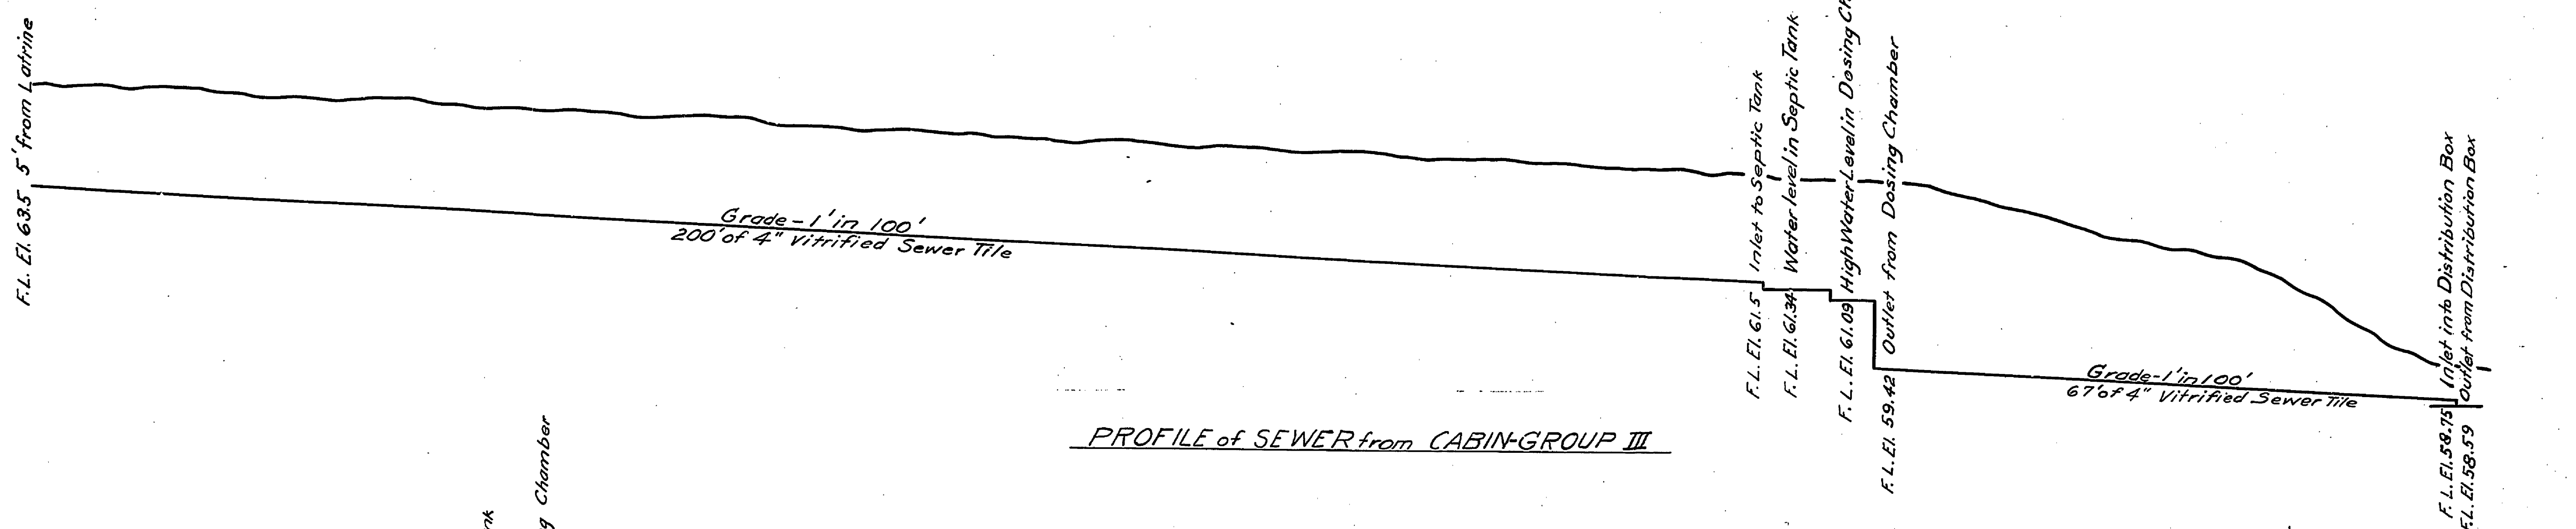


PROFILE of SEWER from CABIN-GROUP III

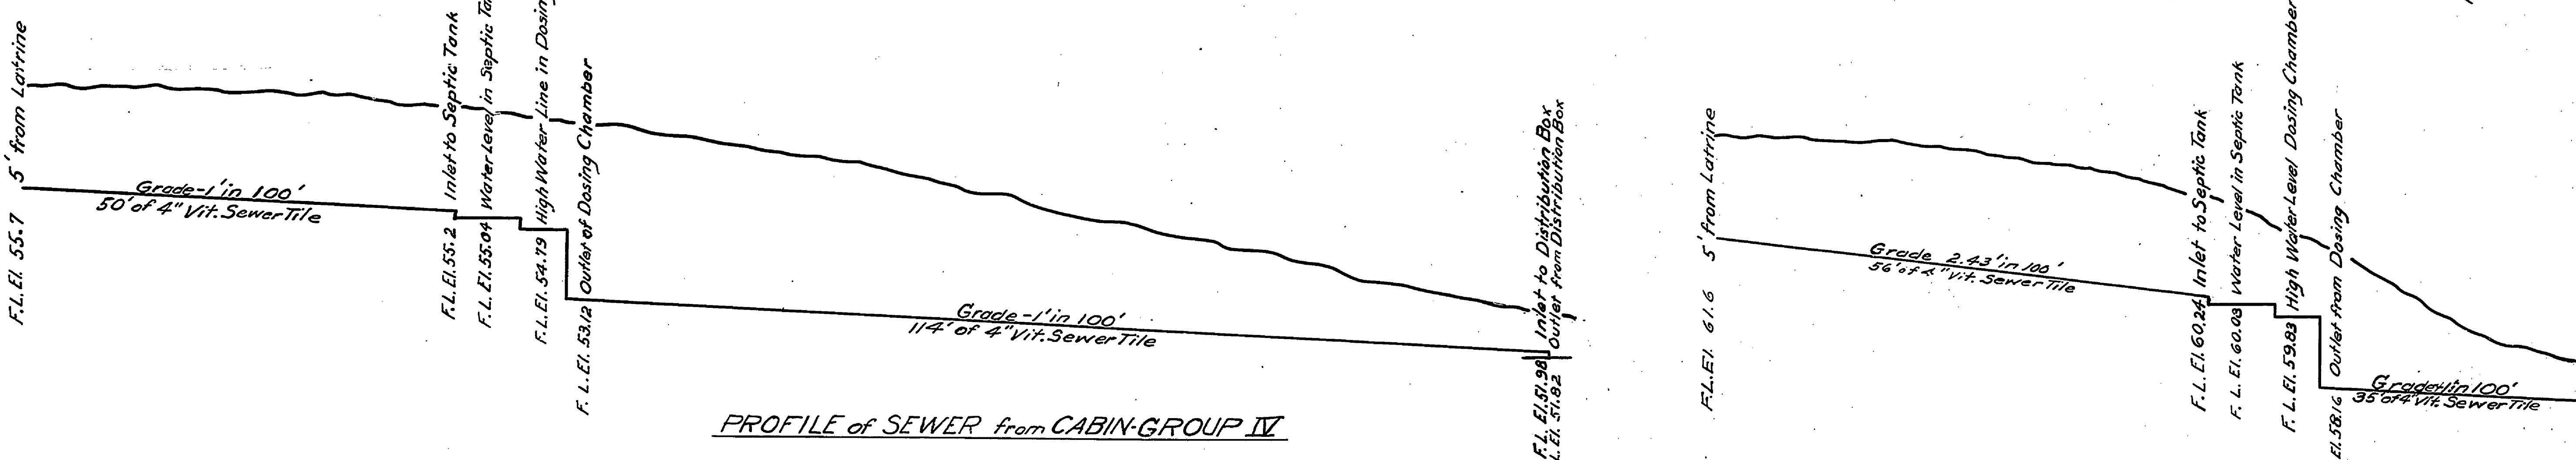

PROFILE of SEWER from CABIN-GROUP IV

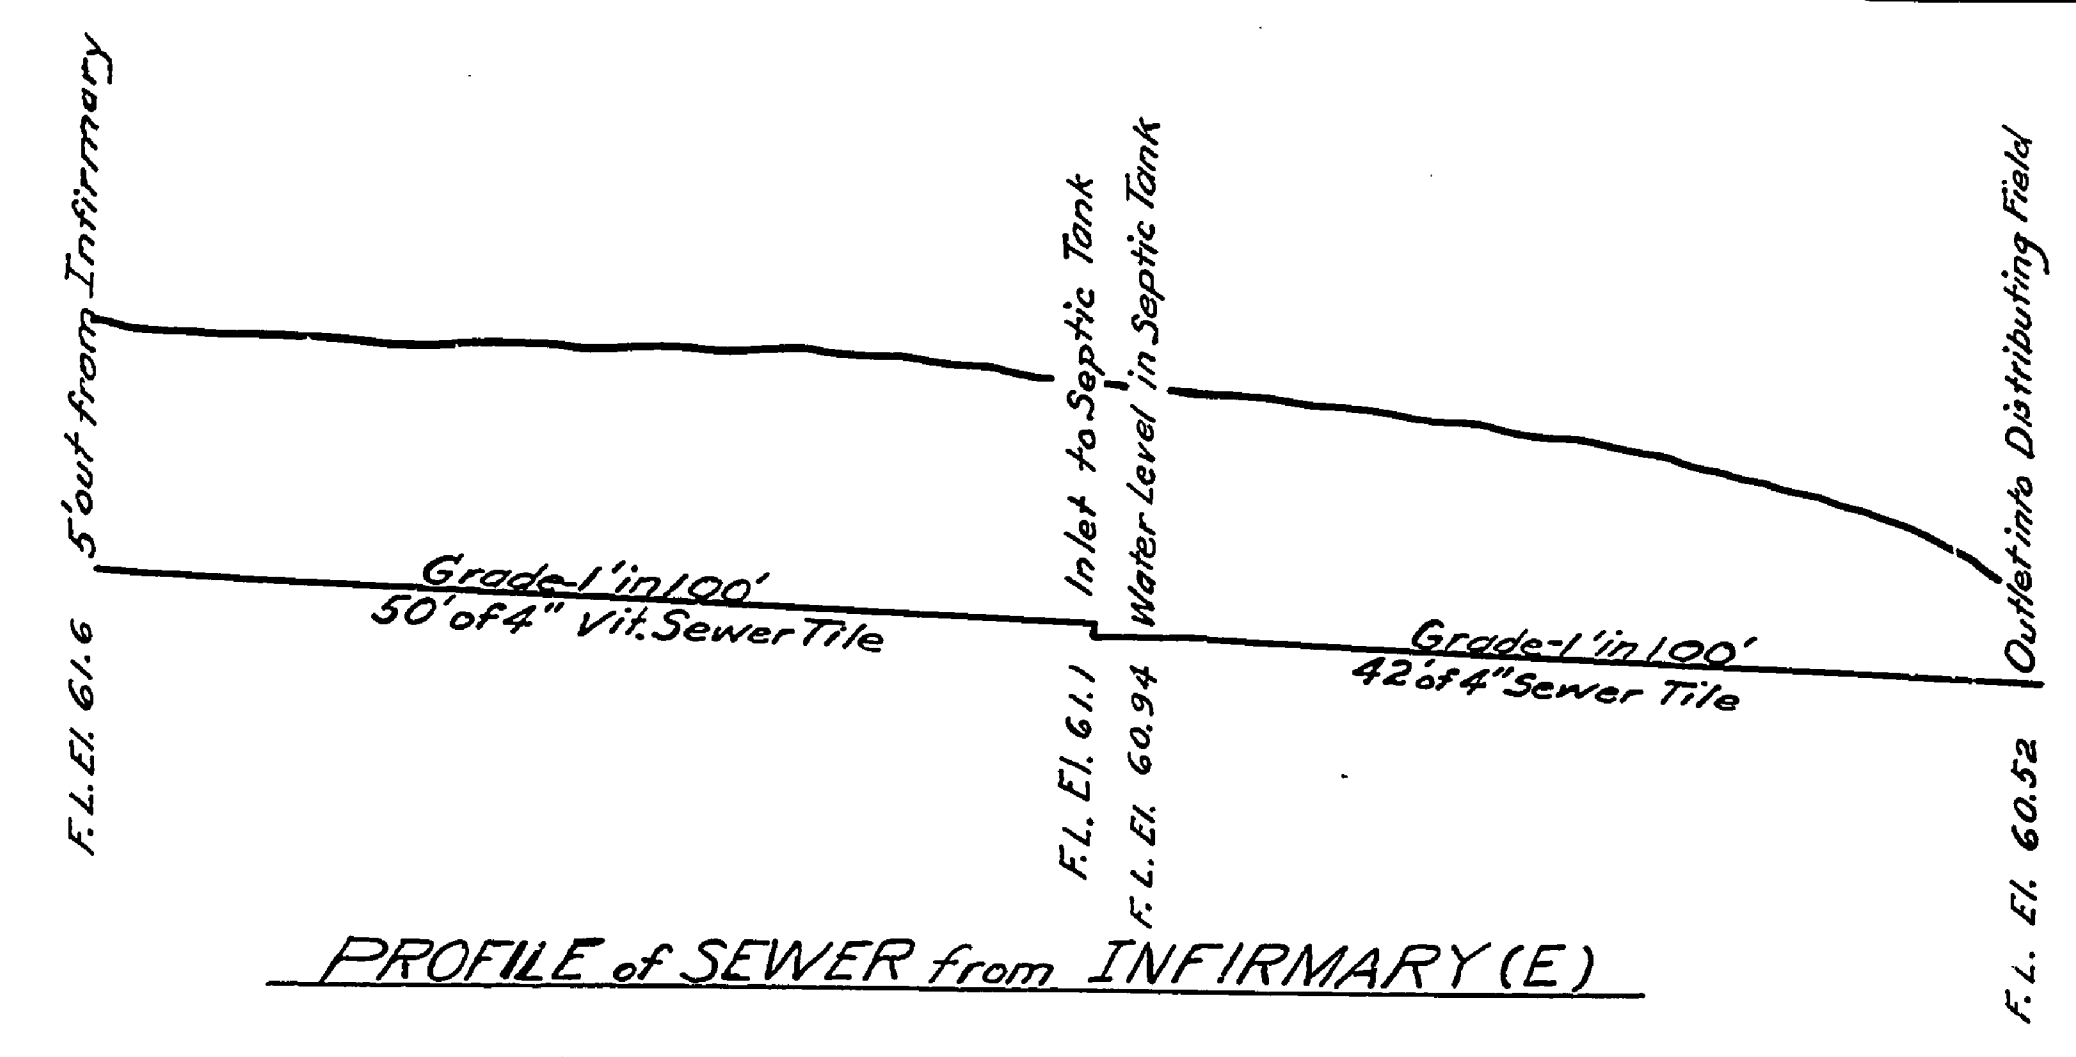

PROFILE of SEWER from INFIRMARY (E)

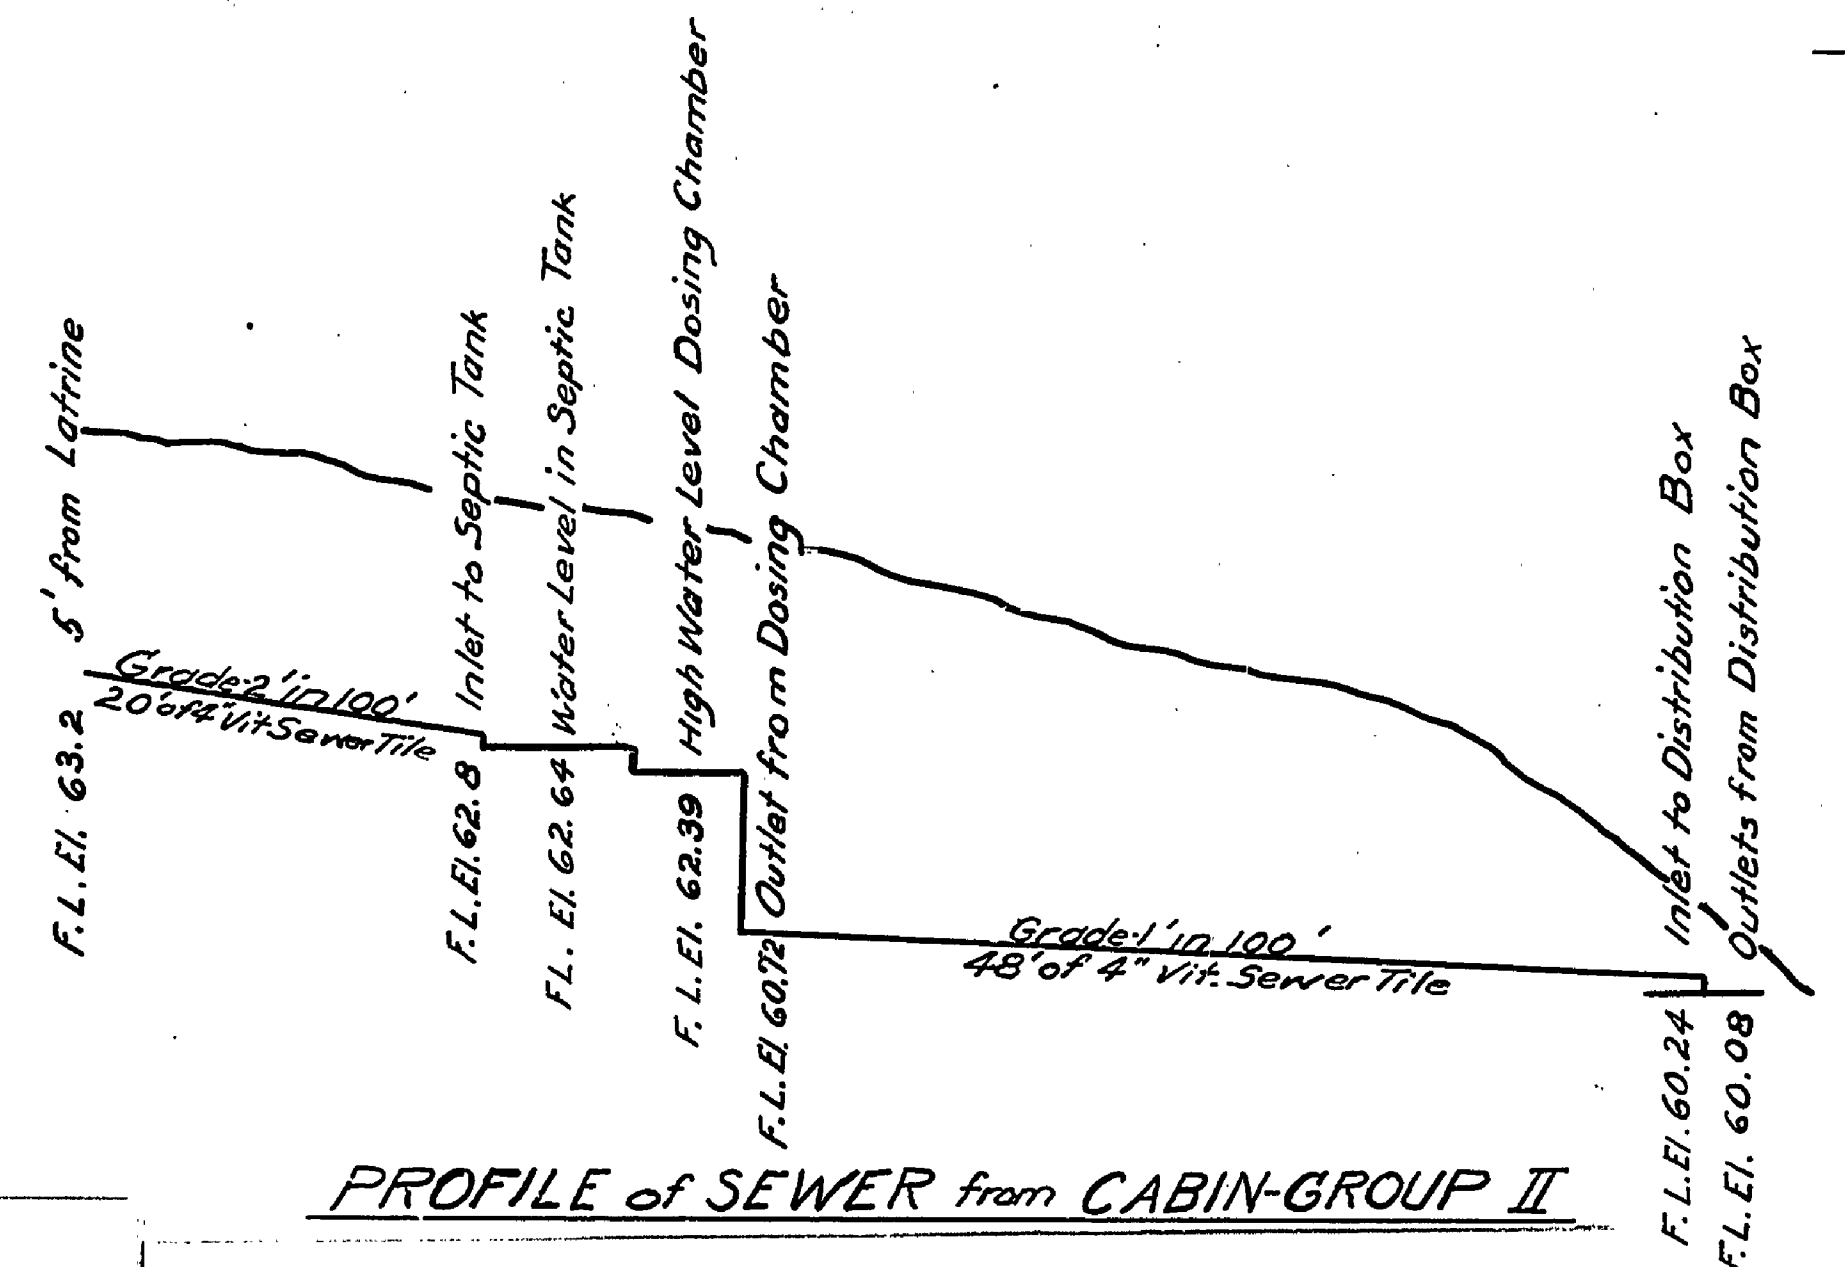

PROFILE of SEWER from CABIN-GROUP II

PROFILE of SEWER from CABIN-GROUP I

NOTE: Septic Tanks and Distribution Boxes to be so located in relation to topography of ground that the tile in the Distributing Fields can be laid with tops of tile from 1' to 1 1/2' below ground surface. Length of pipe between Dosing Chambers and Distribution Boxes to be such as will best secure this result.  
 All Sewer Pipe shall be laid to a minimum depth of 30".  
 Grade of all Sewer Pipe to be not less than 1' in 100'.

of-  
E-124  
4th SHEET

FRAME ONE OF TWO FRAMES

APPROVED BY		DEPARTMENT OF THE INTERIOR NATIONAL PARK SERVICE COOPERATING WITH	
MICHIGAN DEPT. of HEALTH DIRECTOR BUREAU of ENGINEERING		RESETTLEMENT ADMINISTRATION DIVISION of LAND UTILIZATION REGION TWO	
MAINTAINING AGENCY MICHIGAN CONSERVATION COMMISSION		YANKEE SPRINGS RECREATIONAL DEMONSTRATION PROJECT	
S.U.P.T. of STATE PARKS		PROFILES of MUD LAKE SEWER LINES	
INSPECTOR		Date Drawn 5-27-36 Date Submitted	
Submitted By		SCALE	
Project Manager		SHEET NO	
Approved By		FILE NO	
Regional Officer			
Approved By			