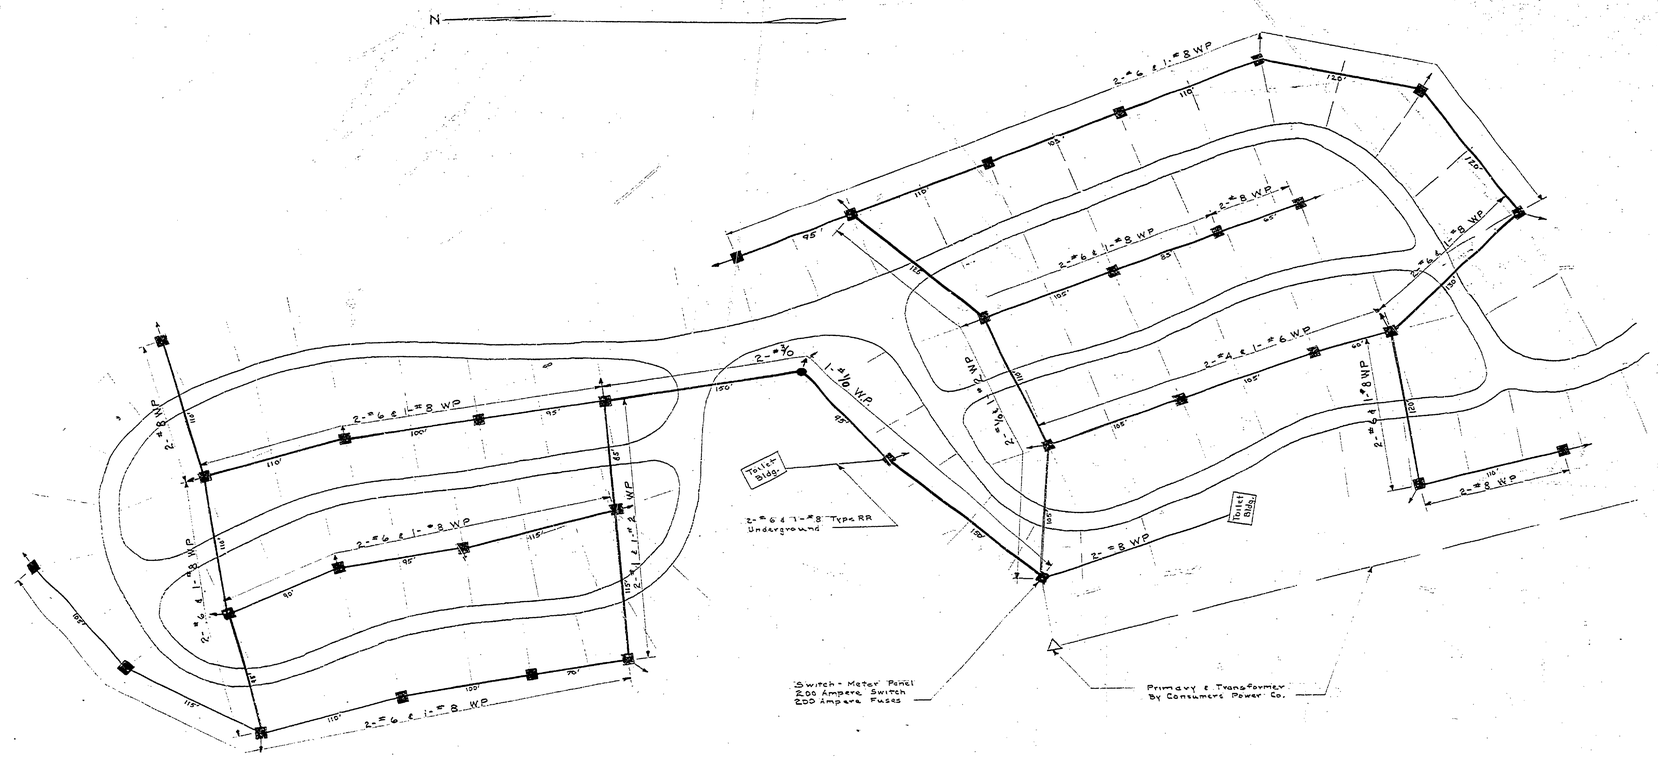

PLAN
Scale 1" = 50'

KEY

- Trailer Outlet Service Line And Box
- Pole
- Anchor Guy

240 Volts { Neutral } 110 Volt X - Circuit / 110 Volt Y - Circuit

		DATE
DESIGNED BY	B.H.G.	13 Dec '61
DRAWN BY	B.H.G.	13 Dec '61
CHECKED BY		

REVIEWED		DATE
ARCHITECTURAL	W.H.G.	12-14-61
ENGINEERING	G.Q.P.	12-14-61
LANDSCAPE	R.H.G.	12-14-61

APPROVED
CHIEF, DIVISION OF PARKS
CHIEF, DIVISION OF ENGINEERING
CHIEF, DIVISION OF PLANNING AND CONSTRUCTION

REVISIONS

NO.	DATE	BY		DATE	BY
1	13 Dec.	B.H.G.	No. of Composites Increased On Staking In Field. This Sheet Replaces Sheet No. 2 Plan No. E-117 Dated 13 Dec. 1961	4	
2	1961			5	
3	26 Feb. 62	B.H.G.	Redesigned For 30 Amp Fuses In Outlet Boxes	6	

CONSUMERS BLUEPRINT SERVICE, LANSING

MICHIGAN
DEPARTMENT OF CONSERVATION
PARKS AND RECREATION DIVISION

LUDINGTON STATE PARK
BEECHWOOD CAMPGROUND ELECTRICAL SYSTEM
Scale As Shown

SHEET NO. 2 OF 2

PLAN NO. E-117