


GENERAL NOTES:

1. ALL DUCTWORK TO BE 24 GA. GALVANIZED SHEET METAL
2. ALL DUCT JOINTS TO BE SEALED WITH SILICONE SEALER
3. ALL DUCTS TO BE SUPPORTED WITH 1/2" WIDE GALVANIZED METAL STRAPS 4'-0" O.C.
4. COORDINATE DUCTWORK INSTALLATION WITH PLUMBING CONTRACTOR
5. EXACT LOCATION OF DUCTS BASED ON FIELD CONDITIONS

EXHAUST FAN SCHEDULE	
EF 1	GREENHECK DSQ 120 DIRECT DRIVE 300 CEM @ 3/8" EP 120 V 1/2 1/4 H.P. w/HANGING ISOLATORS
OTHER MAKE OF EQUAL QUALITY AS DETERMINED BY PROJECT MANAGER WILL BE ACCEPTABLE	

MECHANICAL FLOOR PLAN
 SCALE 1/4" = 1'-0"

Bernath-Coakley Associates, Architects
 4104 W. St. Joseph Hwy.
 Lansing, Michigan 48917
 (517) 321-9525

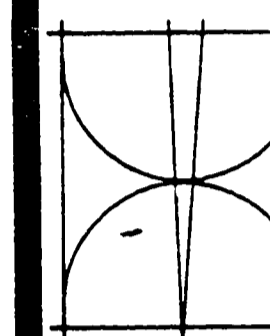

STATE OF MICHIGAN
 DEPARTMENT OF MANAGEMENT AND BUDGET
Office of Facilities

TOILET AND SHELTER BUILDING
 BAY CITY STATE PARK
 STATE OF MICHIGAN
 DEPARTMENT OF NATURAL RESOURCES
 PARKS DIVISION
 CONTRACTING MICHIGAN'S FUTURE BOND PROGRAM ACCT. NO. 60747525450-4ADD

Revisions
 Date: JULY 27, 1999
 Comp. No.: 9034
 Sheet No.:

M1

L-123